


# Appendix 5:


Lighting Circuiting Plans  
And Single Line Diagrams



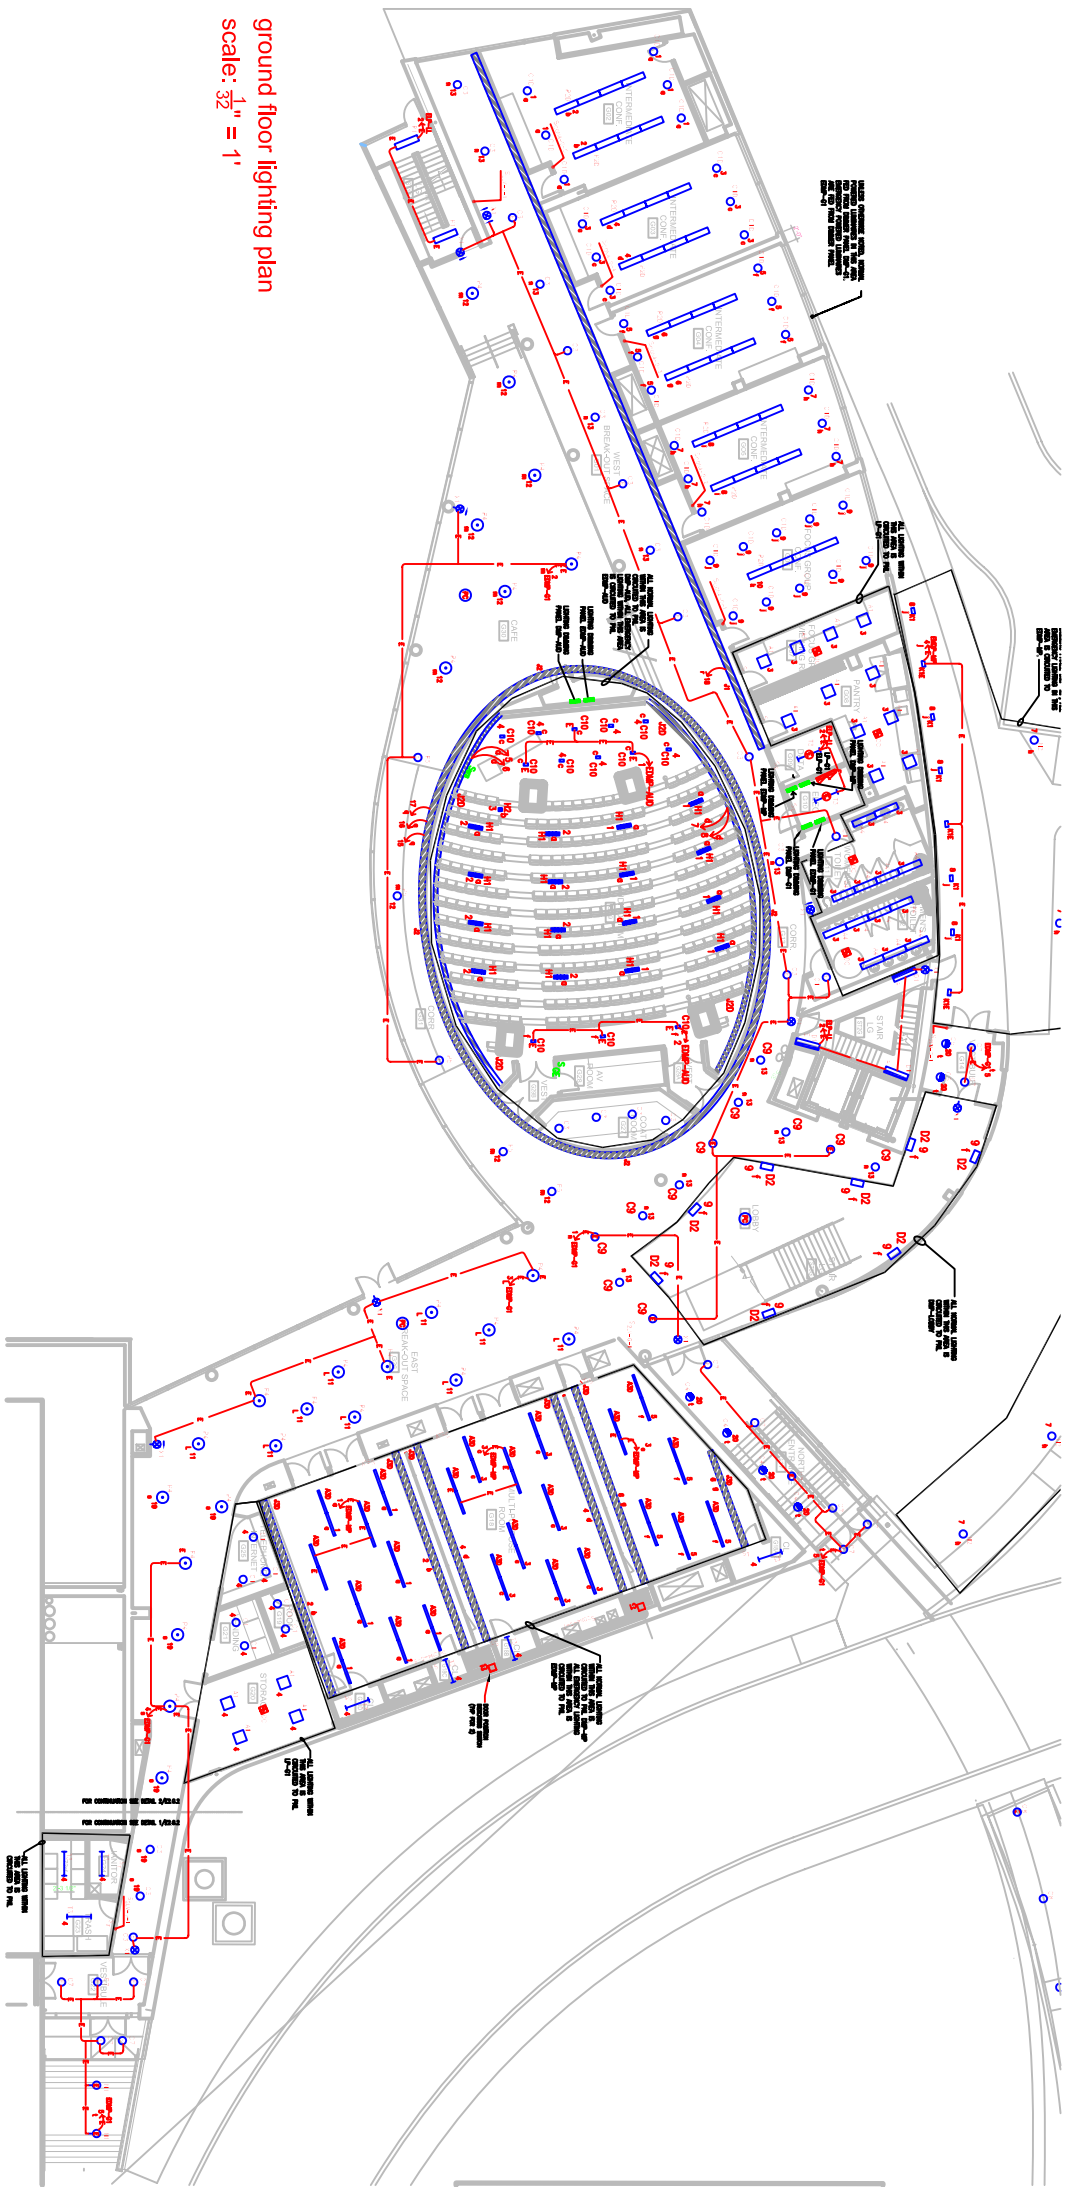

ground floor lighting plan  
 scale:  $\frac{1}{32}'' = 1'$

first floor lighting plan  
 scale:  $\frac{1}{16}'' = 1'$

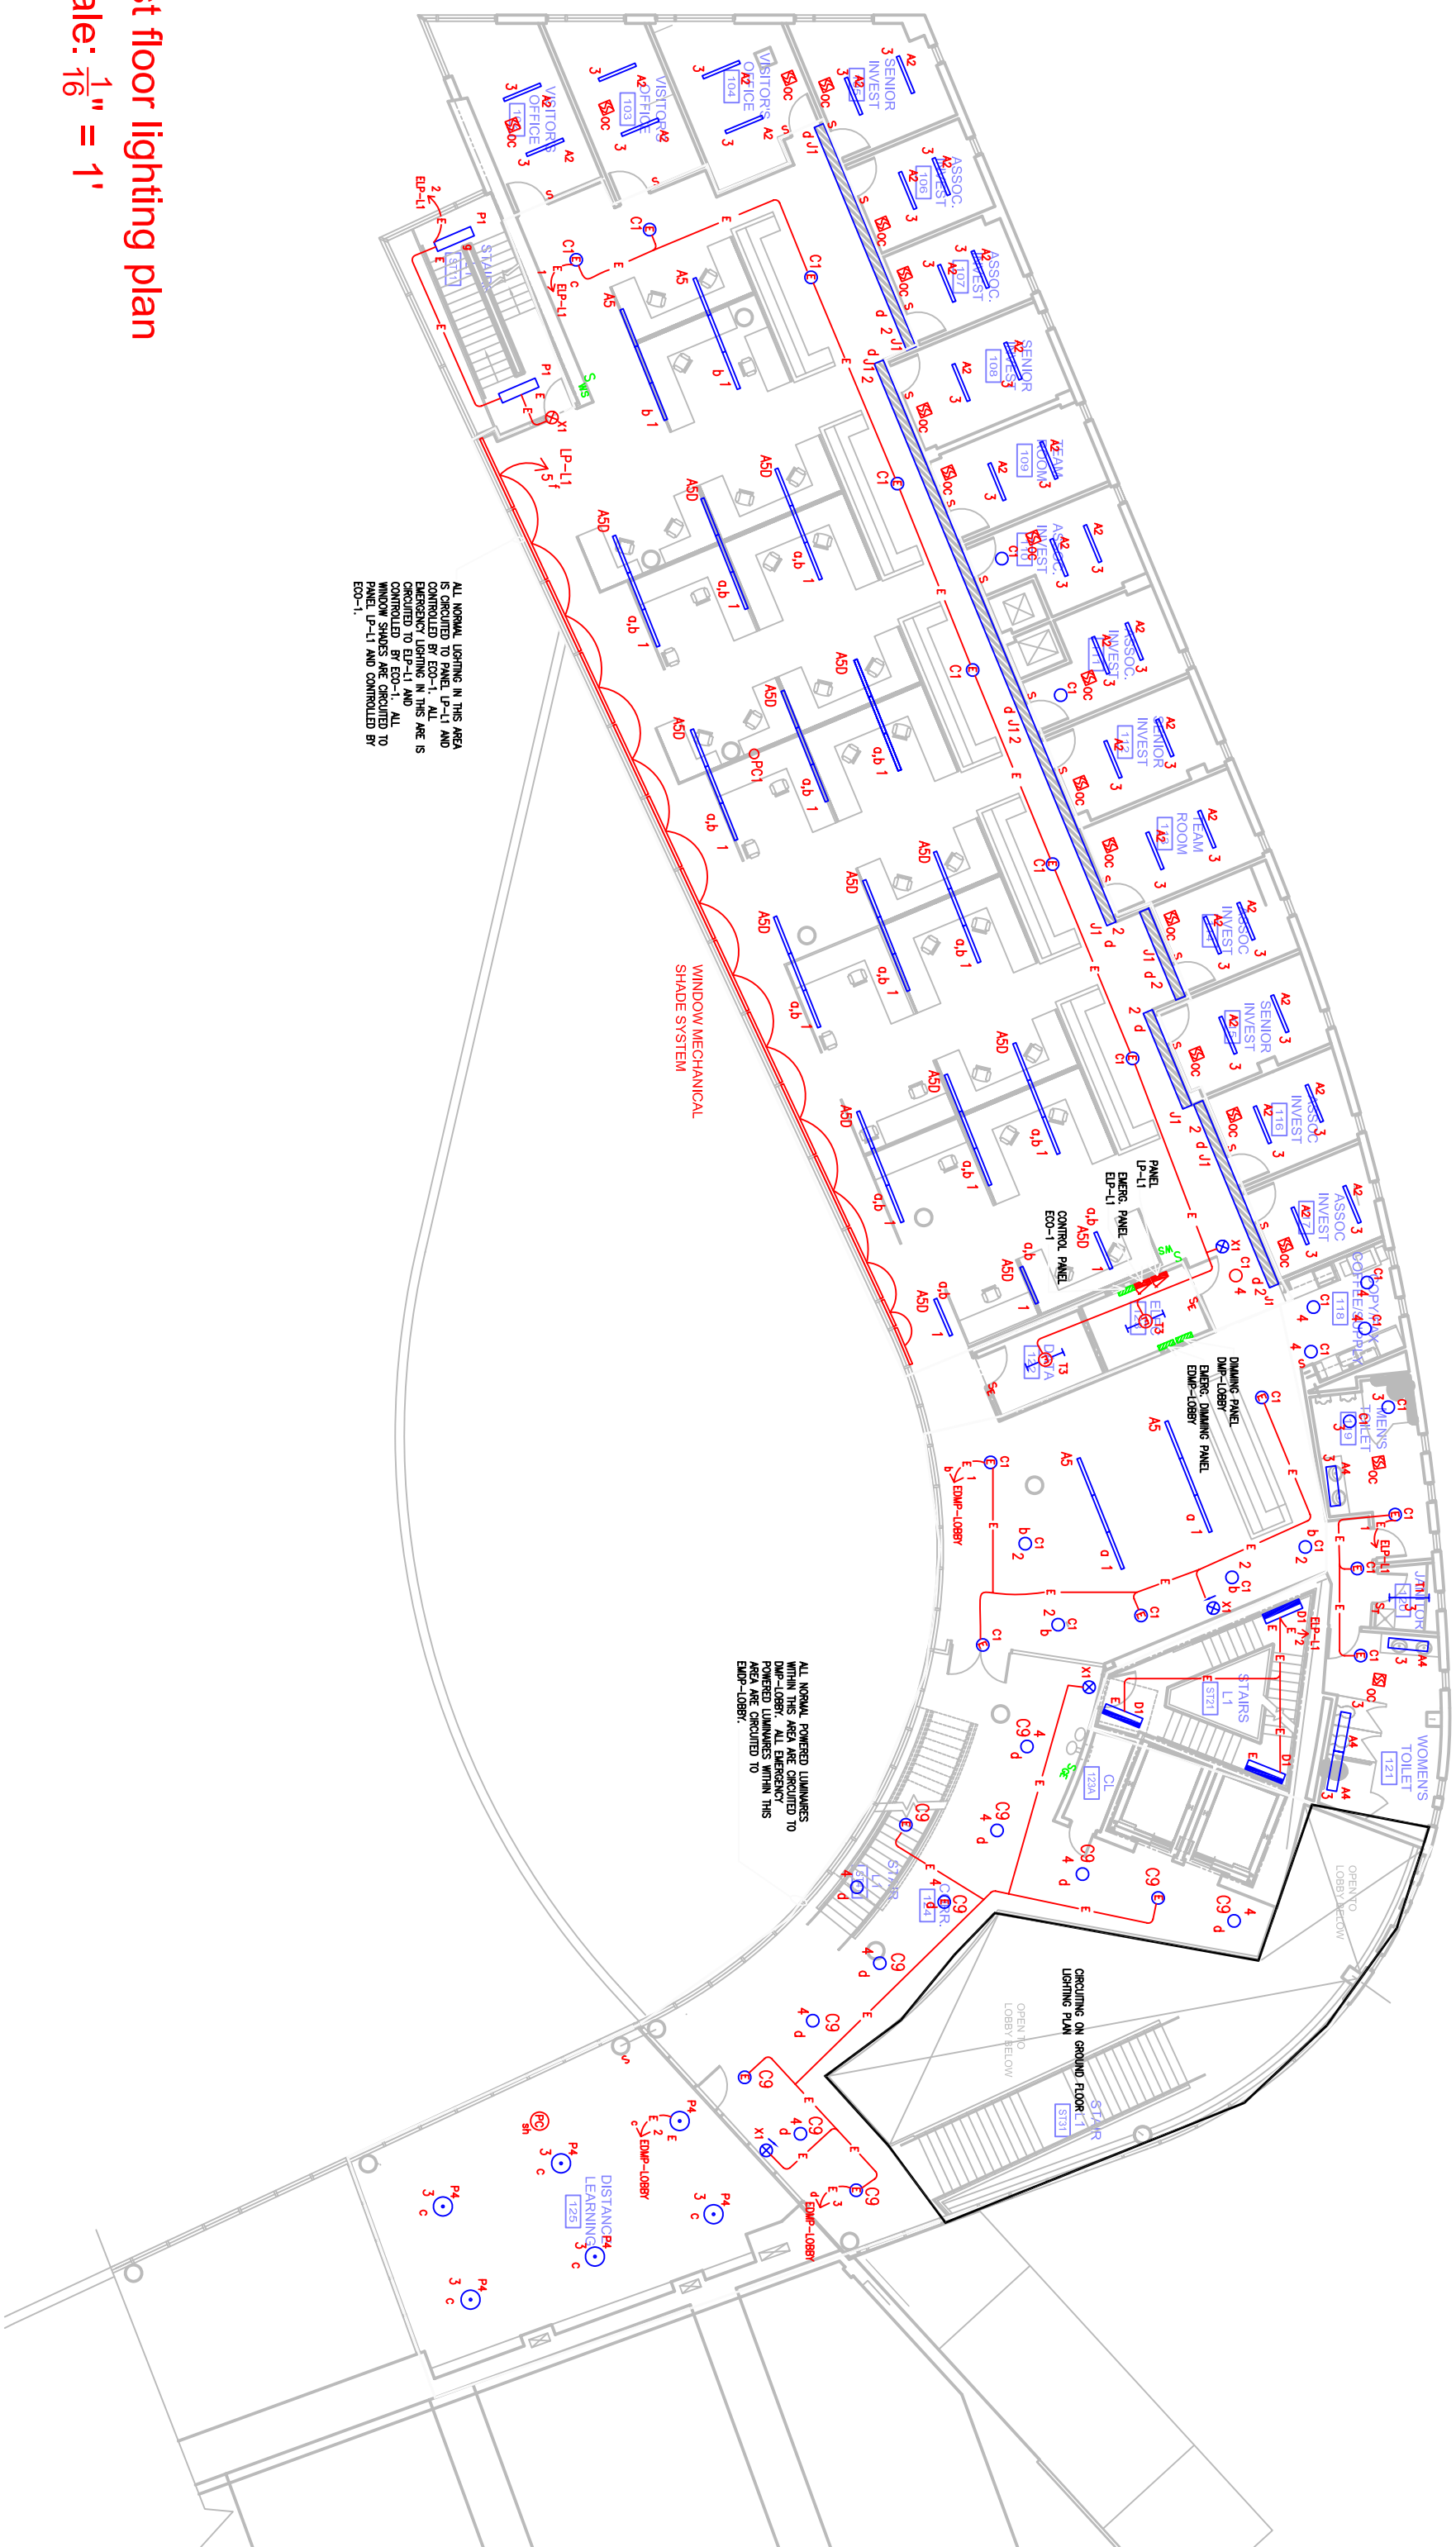


ALL NORMAL LIGHTING IN THIS AREA IS CIRCUITED TO PANEL UP-L1 AND EMERGENCY LIGHTING IN THIS AREA IS CIRCUITED TO EP-L1 AND ALL WINDOW SHADES ARE CIRCUITED TO PANEL UP-L1 AND CONTROLLED BY EOO-1.

ALL NORMAL POWERED LUMINAIRES WITHIN THIS AREA ARE CIRCUITED TO PANEL UP-L1 AND EMERGENCY POWERED LUMINAIRES WITHIN THIS AREA ARE CIRCUITED TO EP-L1.





CIRCUITING ON GROUND FLOOR LIGHTING PLAN  
 OPEN TO LOBBY BELOW

WINDOW MECHANICAL SHADE SYSTEM

**second floor lighting plan**  
**scale: 1/16" = 1'**

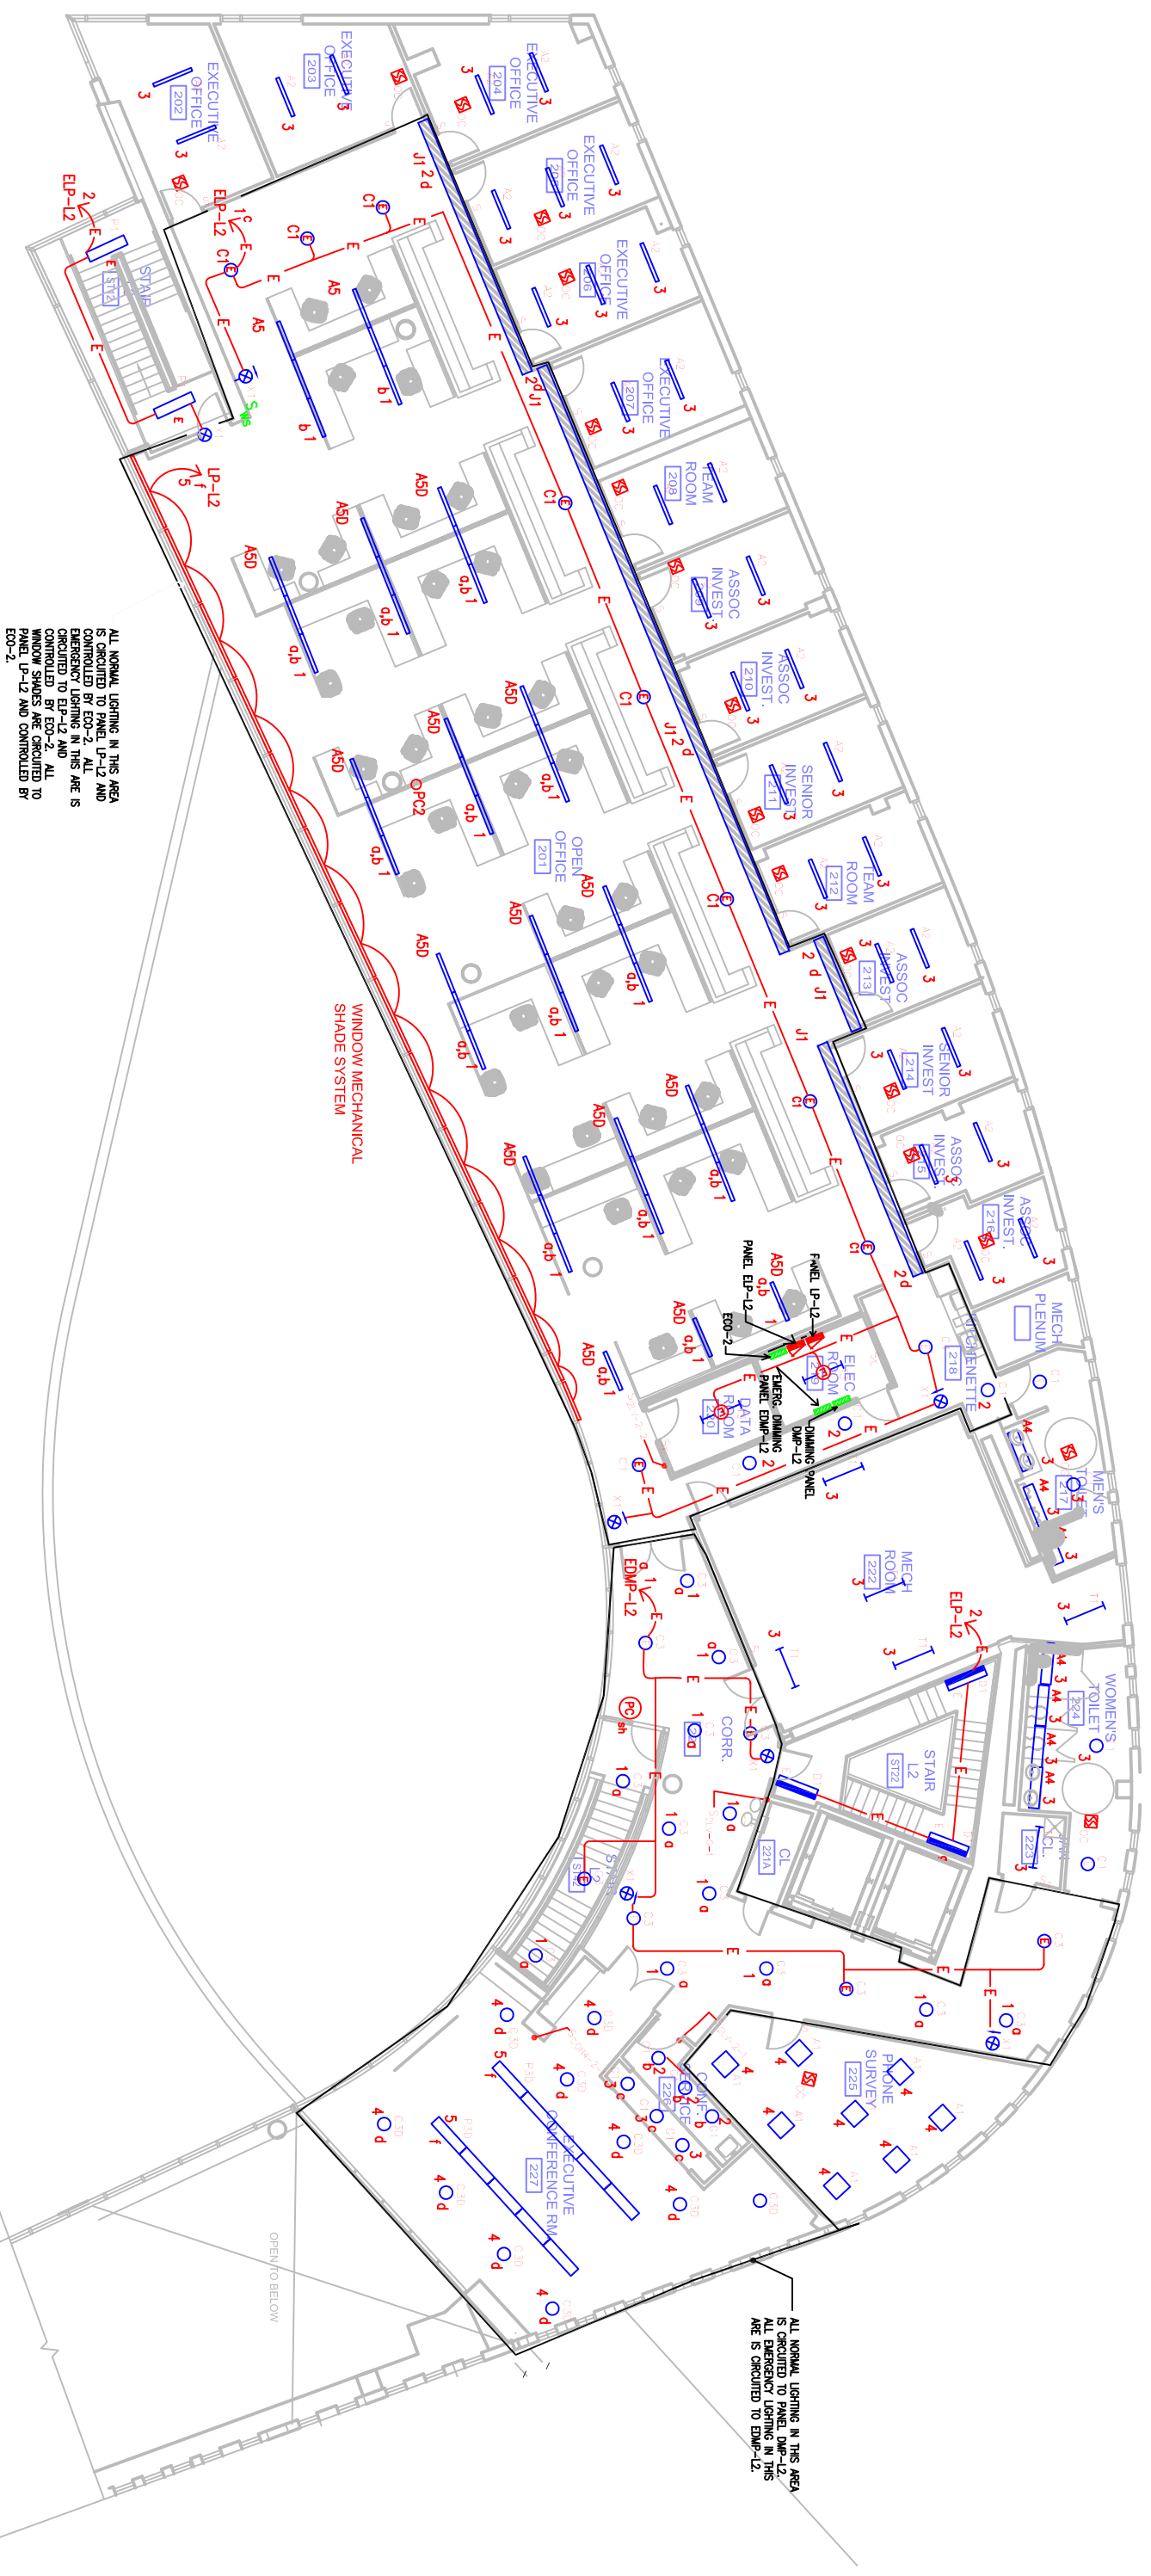



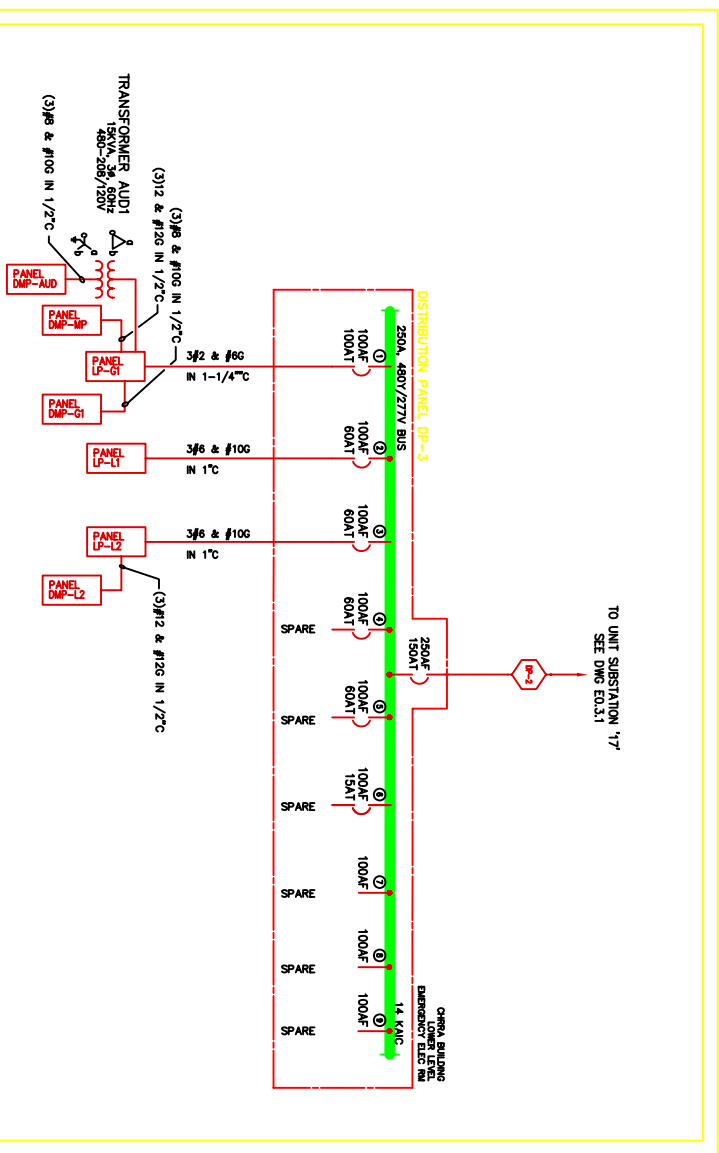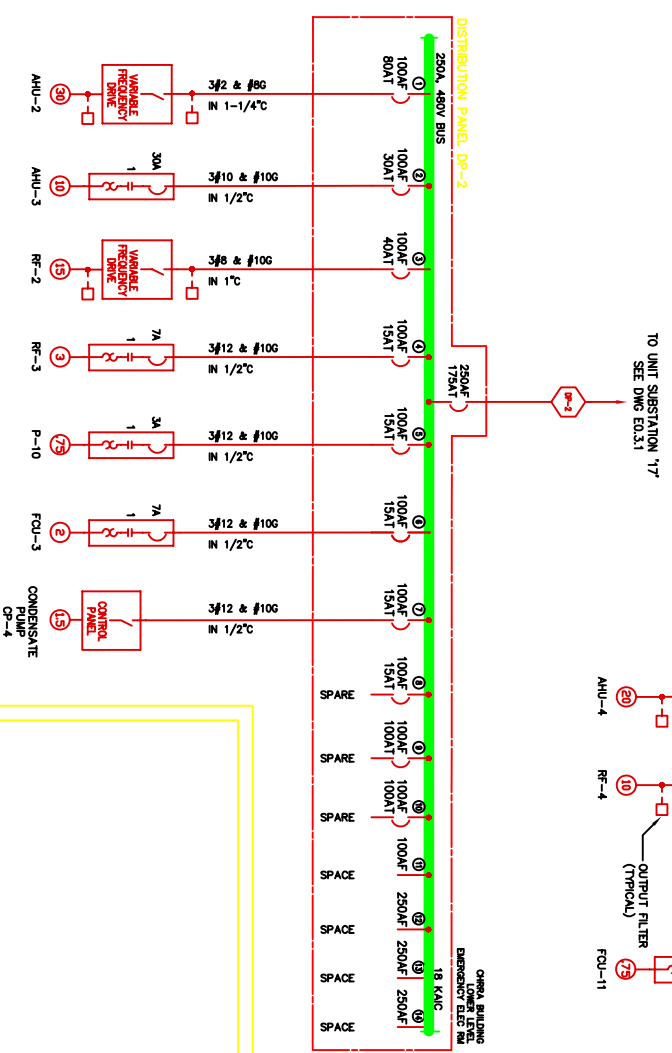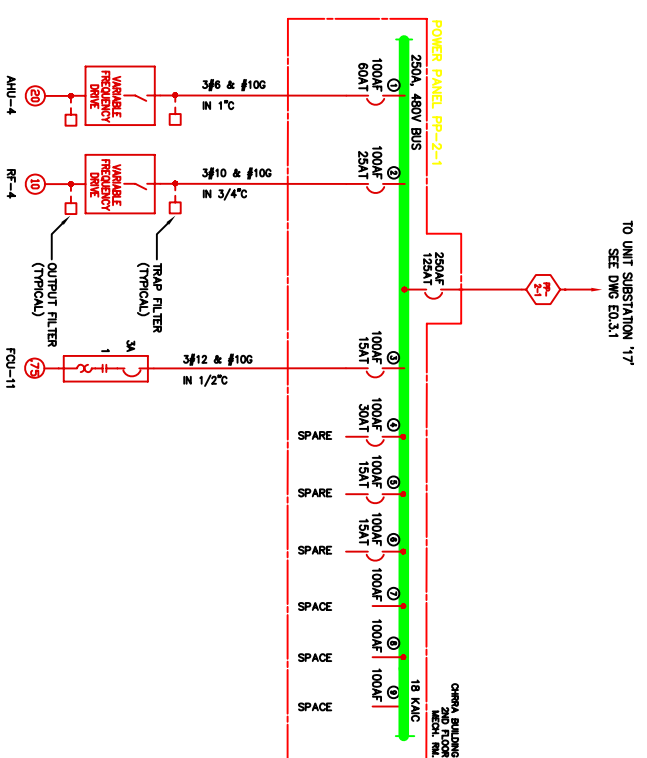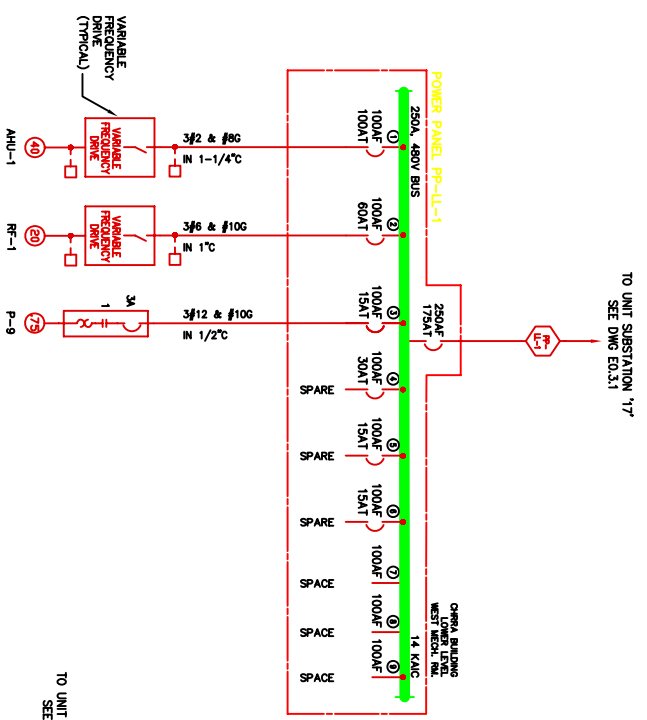

single line diagram

