

303 Third Street
Cambridge, Massachusetts



Brian Tufts

AE 481W – Thesis

Advisor: Dr. Ali Memari

Technical Assignment 1

October 5, 2007

TABLE OF CONTENTS

Executive Summary.....	3
Structural System.....	4
Codes.....	5
Loads.....	6
Analyses.....	7
Wind.....	7
Seismic.....	9
Spot Checks.....	11
Appendix.....	12

EXECUTIVE SUMMARY

The purpose of this paper is to research the existing conditions and structural design procedures for 303 Third Street in Cambridge, Massachusetts. The primary codes I used in my analysis of the systems were ASCE 7-05 and the International Building Code 2006. However, the primary code used in the structural design of the building was the Massachusetts State Building Code – 6th Edition.

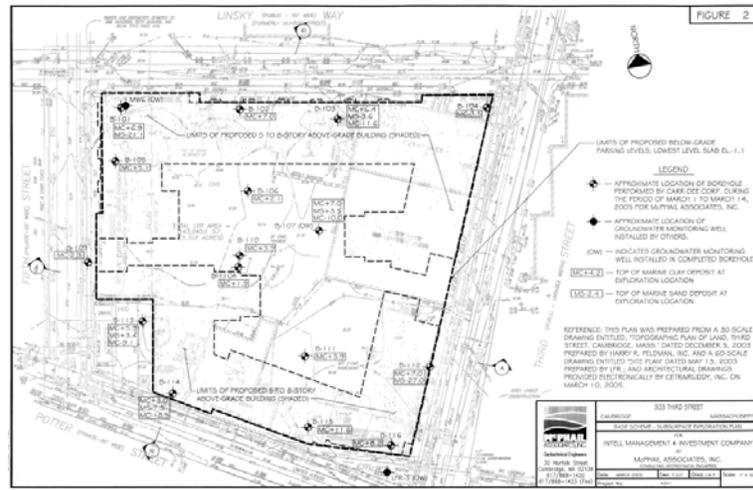


Figure 1: Site Plan

DESCRIPTION:

303 Third Street consists of a north and south building, ranging in story number from five to eight, which are joined below grade by two parking levels spanning nearly the entire area of the site. The building is a mixed use facility planned to offer 485,227 SF of rentable residential space and 7,500 SF of retail space. 303 Third Street is situated on a 3.3 acre site urban site a short distance from the Massachusetts subway system as well as the Massachusetts Institute of Technology.

303 Third Street is a steel frame building with composite floor slabs. Lateral load resistance is provided by both moment frames and concentrically braced frames. The braced frames add stiffness in the plane of the lateral load and transfer the load to the columns. The moment frames rely on the strength of the connection between the floor slab and the columns for translation of loads vertically.

The Massachusetts State Building Code – 6th Edition was used in the design of 303 Third Street. My analysis will primarily rely on the use of the International Building Code 2006 in conjunction with ASCE 7-05. Also, I used the Thirteenth Edition of the AISC Steel Construction Manual in performing my calculations. Small discrepancies between my own calculations and those of the engineers are expected due to the different standards used. In no way does this report make the claim that any of the designer’s approaches, assumptions, calculations or resulting designs are incorrect or unsuitable.

STRUCTURAL SYSTEM

FOUNDATION:

The slab on grade concrete is normal weight (145 pcf dry unit weight) and has a minimum 28-day strength of 3500 psi. The 5" slab on grade is reinforced with 6x6 W2.9xW2.9 welded wire fabric. Column loads are supported by square spread footings ($f'c = 4000$ psi) ranging from 5'-6" to 14'-0". The spread footing bear directly on the undisturbed, natural outwash sand, marine clay, or marine sand deposits proportioned utilizing a maximum bearing pressure of 2.5 tons per square-foot. The foundation also contains a few internal and external piers ($f'c = 4000$ psi) for supporting larger loads. The foundation bears on belled caissons with a typical depth of 20'. The caissons bear on 3 TSF bearing material. A groundwater cut-off at the perimeter is maintained as well as underdraining of the lowest level slab to avoid hydrostatic uplift forces acting on the lowest level slab. The continuous perimeter wall footings are founded at least 12 inches below the surface of the relatively impervious marine clay deposit to provide a groundwater cut-off. The surface of the bedrock deposit was observed to vary from 66.3 to 90 feet below the existing ground surface.

FLOOR SYSTEM:

The sublevel floor system P1 consists of a 4 1/2" normal weight concrete ($f'c = 5000$ psi) slab on a 3" deep 18 gage composite metal floor deck reinforced with #5 rebar at 12" parallel to the deck and #4 rebar at 12" temp for a total slab thickness of 7 1/2". The slab is supported by steel beams with typical sizes ranging from W12 to W18. Wide flange beams typically span 25' with 8' spacing. Composite action is created by 3/4" diameter shear studs with 5 1/2" length. Girders are also wide flanges sized up to W24 with cambers over 1". The typical floor system throughout the rest of the building is 3 1/4" light weight concrete slab on a 3" deep 16 gage composite metal floor deck reinforced with 6x6 W2.1xW2.1 welded wire fabric. This slab is supported by steel beams with typical sizes ranging from W12 to W14. Wide flange beams typically span 18-26' with 12'-6" spacing.

COLUMNS:

The columns are ASTM A992 Grade 50 wide flange steel shapes laid out in a mostly rectangular grid. The columns act as the primary gravity resistance members. The columns that are attached as braced and moment frames are also the main lateral resistant force members. The braces between columns are ASTM A 500 Grade B HSS shapes ranging in size from 7x5x1/2" to 9x7x5/8". The largest column is a W14x159 and the smallest is a W12x53 on the ground floor. The maximum unbraced length is 15' which is the floor to floor height of the ground floor. Column splices occur every 20' – 25' at 4'-0" above the floor.

LATERAL FRAMING:

There is a dual lateral system implemented consisting of concentrically braced steel frames in both the N-S and E-W directions and moment frames in the E-W direction. These frames consist of wide flange columns, wide flange beams at each story and two HSS (hollow structural section) diagonal braces between each story and may include moment connections depending on the frame type.

CODES

DESIGN CODES:

Building Code:

Massachusetts State Building Code – 6th Edition

Reinforced Concrete:

American Concrete Institute (ACI) 318 – 1995 Edition

Reinforced Masonry:

American Concrete Institute (ACI) 530 – 2005 Edition

Structural Steel:

American Institute of Steel Construction (AISC)
Load and Resistance Factor Design Specification for Structural
Steel Buildings – Latest Edition

Metal Decking:

American Iron and Steel Institute (AISI)
Specification for the Design of Cold Formed Structural Members

Building Design Loads:

Massachusetts State Building Code – 6th Edition

THEESIS SUBSTITUTED CODES:

American Society of Civil Engineering (ASCE)
Minimum Design Loads for Buildings and Other Structures – ASCE 7-05

American Institute of Steel Construction (AISC)
Steel Construction Manual – 13th Edition – 2005

The International Building Code – 2006

LOADS

DEAD LOADS:

Metal Deck + Light Weight Concrete Steel Beams	30 PSF Vulcraft Catalog AISC Values
---	--

Superimposed Dead Loads:

Mechanical, Electrical, Sprinkler	20 PSF
Ceiling Finishes	5 PSF
Floor Finishes	5 PSF

LIVE LOADS:	Design Value	ASCE 7 Ch 4
--------------------	---------------------	--------------------

Floor Live Loads:

Corridors above 1 st floor	80 PSF	100 PSF
First floor lobbies, public areas and corridors	100 PSF	100 PSF
Assembly rooms	100 PSF	100 PSF
Residential	40 PSF + Partition	40 PSF
Retail	100 PSF	100 PSF
Exercise room	100 PSF	100 PSF
Slab on grade	100 PSF	N/A
Storage (light)	125 PSF	125 PSF
Loading dock slab on deck	250 PSF	250 PSF
Framed exterior at ground	100 PSF + Soil	N/A
Fire pump room	150 PSF	N/A
Stairs	100 PSF	100 PSF
Mechanical areas	150 PSF	N/A
Elevator machine room	150 PSF	N/A
Transformer vault	250 PSF	N/A
Parking levels and ramps	50 PSF	40 PSF

Roof Live Loads:

Roof Live Loads		20 PSF min
Basic Uniform Snow Load (Pf)	30 PSF	

ANALYSES

LATERAL LOADS:

Wind per ASCE 7-05 Chapter 6

The following wind pressures are for a rigid building with an exposure category B.

North Building N-S Direction			
HT (ft)	P Windward	P Leeward	Total
15	14.76	-15.29	30.05
25	16.37	-15.29	31.66
35	18.16	-15.29	33.45
45	19.05	-15.29	34.34
55	19.77	-15.29	35.06
65	20.48	-15.29	35.78
75	21.20	-15.29	36.49
86.5	21.74	-15.29	37.03

Table 1: Wind Pressures

North Building E-W Direction			
HT (ft)	P Windward	P Leeward	Total
15	14.76	-10.95	25.71
25	16.37	-10.95	27.32
35	18.16	-10.95	29.11
45	19.05	-10.95	30.00
55	19.77	-10.95	30.72
65	20.48	-10.95	31.44
75	21.20	-10.95	32.15
86.5	21.74	-10.95	32.69

Table 2: Wind Pressures

South Building N-S Direction			
HT (ft)	P Windward	P Leeward	Total
15	14.76	-15.29	30.05
25	16.37	-15.29	31.66
35	18.16	-15.29	33.45
45	19.05	-15.29	34.34
55	19.77	-15.29	35.06
65	20.48	-15.29	35.78
75	21.20	-15.29	36.49
86.5	21.74	-15.29	37.03

Table 3: Wind Pressures

South Building E-W Direction			
HT (ft)	P Windward	P Leeward	Total
15	14.76	-10.89	25.64
25	16.37	-10.89	27.25
35	18.16	-10.89	29.04
45	19.05	-10.89	29.94
55	19.77	-10.89	30.66
65	20.48	-10.89	31.37
75	21.20	-10.89	32.09
86.5	21.74	-10.89	32.63

. Table 4: Wind Pressures

NORTH BUILDING SHEAR AND MOMENT:

N-S Direction

Total Base Shear: 1,116.71 Kips
 Total Overturning Moment: 54,264.77 FT-K

E-W Direction

Total Base Shear: 463.99 Kips
 Total Overturning Moment: 22,630.33 FT-K

SOUTH BUILDING SHEAR AND MOMENT:

N-S Direction

Total Base Shear: 1,116.71 Kips
 Total Overturning Moment: 54,264.77 FT-K

E-W Direction

Total Base Shear: 462.99 Kips
 Total Overturning Moment: 22,582.95 FT-K

Seismic per ASCE 7-05 Chapter 12

The following seismic analysis was performed for a site class E, which I assumed based on the geotechnical data gathered. It may qualify in reality as site class D, because the Massachusetts State Building Code uses different criteria than the IBC code to determine site classifications. According the Massachusetts State Building Code, the site class is S3. By analyzing the site for class E by IBC standards, I am remaining conservative with regard to the seismic analysis. I performed an Equivalent Lateral Force Analysis by ASCE 7-05 as well as an Index Force Analysis (see Appendix).

North Building					
Braced Frame - $k = 1.197$			v	1792.624	
Floor	wx	hx	$wx \cdot hx^{1.197}$	Cvx	Fx
Roof	3641.325	86.5	758346.56	0.23	311.64
8	3641.325	75	639304.52	0.20	262.72
7	3641.325	65	538662.49	0.17	221.36
6	3641.325	55	441035.53	0.14	181.24
5	3641.325	45	346860.48	0.11	142.54
4	3641.325	35	256749.08	0.08	105.51
3	3641.325	25	171630.17	0.05	70.53
2	3641.325	15	93119.51	0.03	38.27
Ground	3641.325	0	0	0	0
Sum			3245708.34		
Moment Frame - $k = 1.31$			v	1333.817	
Floor	wx	hx	$wx \cdot hx^{1.31}$	Cvx	Fx
Roof	3641.325	86.5	1255308.71	0.39	515.87
8	3641.325	75	1041333.16	0.32	427.93
7	3641.325	65	863328.23	0.27	354.78
6	3641.325	55	693640.70	0.21	285.05
5	3641.325	45	533295.40	0.16	219.16
4	3641.325	35	383697.16	0.12	157.68
3	3641.325	25	246922.61	0.08	101.47
2	3641.325	15	126455.87	0.04	51.97
Ground	3641.325	0	0	0	0
Sum			5143981.83		

Figure 5: Distribution of Seismic Forces for North Building

South Building					
Braced Frame - k = 1.197			v	1792.624	
Floor	wx	hx	wx*hx^1.197	Cvx	Fx
Roof	2887.541	86.5	601362.55	0.19	247.13
8	2887.541	75	506963.20	0.16	208.34
7	2887.541	65	427154.89	0.13	175.54
6	2887.541	55	349737.53	0.11	143.72
5	2887.541	45	275057.49	0.08	113.03
4	2887.541	35	203599.89	0.06	83.67
3	2887.541	25	136101.31	0.04	55.93
2	2887.541	15	73843.00	0.02	30.35
Ground	2887.541	0	0	0	0
Sum			2573819.86		
Moment Frame - k = 1.31			v	1333.817	
Floor	wx	hx	wx*hx^1.31	Cvx	Fx
Roof	2887.541	86.5	995449.43	0.31	409.08
8	2887.541	75	825768.58	0.25	339.35
7	2887.541	65	684612.14	0.21	281.34
6	2887.541	55	550051.33	0.17	226.04
5	2887.541	45	422898.84	0.13	173.79
4	2887.541	35	304268.67	0.09	125.04
3	2887.541	25	195807.58	0.06	80.47
2	2887.541	15	100278.46	0.03	41.21
Ground	2887.541	0	0	0	0
Sum			4079135.03		

Figure 6: Distribution of Seismic Forces for South Building

Moment Frame:

Base Shear $V = 1,792.62$ K
 Overturning Moment = 155,062 FT-K

Braced Frame:

Base Shear $V = 1,333.82$ K
 Overturning Moment = 115,375.2 FT-K

Base shear and overturning moment values differ for the two frames due to differing Cs values.

SPOT CHECKS

After running some spot checks, I discovered a few normal discrepancies between my hand calculations and that of the design engineer. I believe these discrepancies to be normal because any time a building is designed using one standard and then analyzed using a different code and with approximations, there are going to be some differences.

The result of my spot check of the typical gravity loaded bay was very similar to the member used by the design engineer. After calculating the expected load and dead load and crunching the numbers, I found the most economical beam for the bay was in fact the one selected, a W12x16. After verifying the beam selection, I am reasonably confident that the self weight of the structure is very close to the self weight used in the design, as the self weight is largely comprised of the same loads used in this calculation.

Throughout my analyses, I broke my building down into two individual buildings. While they are connected underground by the two sublevel parking levels, I felt for application of seismic and wind loads, treating the two sections as separate buildings would be conservative and eliminate some of the error in the L/B calculations. The underground connection of the two parts of the buildings should in fact add some lateral redundancy and stiffness to the two building segments.

Furthermore, in calculating seismic forces, I calculated two separate Cs values for each type of frame present in the building. The moment frames are most often situated in an E-W orientation of the building, usually on the exterior, while the concentrically braced frames are located on the interior and face N-S. Due to the orientation of the lateral frames, I assumed in my check that the concentrically braced frames were designed to take wind in the N-S direction. I further simplified my lateral analysis by simply applying the seismic load one half the distance between adjacent braced frames in the north building. This is simply an approximate method for determining lateral distribution of forces and I will have to analyze this distribution more thoroughly in future reports.

To check a lateral bracing element, I constructed a STAAD model of the braced frame and input the correct members and properties. After running an analysis to check for deflection, I determined that the frame was adequate for the worst case seismic load I had calculated earlier in this report. The deflections of the frame were on the order of 10^{-4} inches.

My column check proved that the columns were more than adequately designed to withstand the gravity load of the structure. This is the only check I performed that there was a good discrepancy between the engineer's design and my own hand calculation. Since the column is part of a moment frame, I may want to perform a STAAD or RAM analysis on the frame member in the future to determine why such a large column size was selected.



PENN STATE UNIVERSITY

CLASS: _____

DATE: _____


ASSIGNMENT: _____

PAGE: _____ of _____

WIND

NORTH BLDG: WIND N-S

UNITS IN PSF

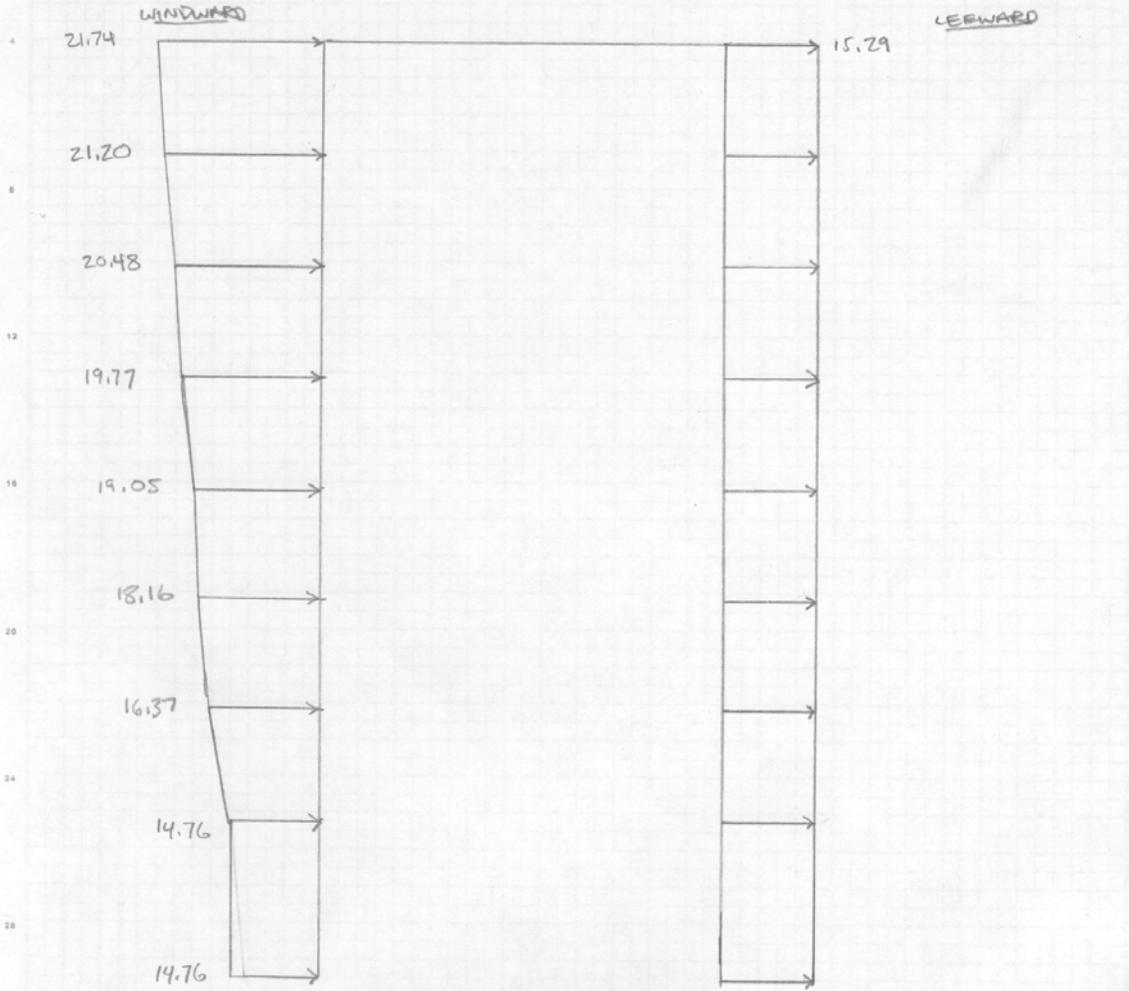



PENN STATE UNIVERSITY

CLASS: _____

DATE: _____

ASSIGNMENT: _____

PAGE: _____ of _____

WIND CALC

SINCE $T_n < 1$, $f > 1 \text{ Hz}$ \therefore RIGID

$I_w = 1.0$ FOR OCCUPANCY CAT 2

BASIC WIND SPEED: $V = 110 \text{ MPH}$

DIRECTIONALITY FACTOR: $K_d = 0.85$ - ONLY USED W/LOAD COMBINATIONS

EXPOSURE CATEGORY: B

VELOCITY PRESSURE EXPOSURE COEFFICIENT: CASE 2 SINCE $> 60'$ height

Floor	HT	K_z
1	15	0.57
2	25	0.66
3	35	0.76
4	45	0.81
5	55	0.85
6	65	0.89
7	75	0.93
8	86.5	0.96

$K_h =$

CONSERV

TOPOGRAPHIC FACTOR: $K_{zt} = 1.0$ ASSUMED

GUST FACTOR: $G = 0.85$ FOR RIGID STRUCTURE (CONSERVATIVE)

RESONANT RESPONSE FACTOR: 1.0 (CONSERVATIVE)

MEAN ROOF HT = 86.5'

ENCLOSURE CLASSIFICATION: FULLY ENCLOSED

VELOCITY PRESSURE: $q_z = 0.00256 K_z K_{zt} K_d V^2 I$

INTERNAL PRESSURE COEFFICIENTS: $+0.55, -0.55 = GC_{pi}$

REDUCTION FACTOR FOR LARGE VOLUME BLDGS: $R_i = 1.0$ @ 15, 11, 1, 1

EXTERNAL PRESSURE COEFFICIENTS p.48-49 OF ASCE

North Building: N-S Wind Direction								
Floor	Height	Trib Height	Windward	Leeward	Total	Story Force	Total Shear	Overturning Moment
Ground	0	0	0	0	0	0	1116.71	54264.77
2	15	12.5	16.37	-15.29	31.66	163.46	1116.71	2451.84
3	25	10	16.37	-15.29	31.66	130.75	953.25	3268.76
4	35	10	18.16	-15.29	33.45	138.14	822.50	4835.07
5	45	10	19.05	-15.29	34.34	141.84	684.36	6382.89
6	55	10	19.77	-15.29	35.06	144.80	542.51	7963.99
7	65	10	20.48	-15.29	35.78	147.76	397.71	9604.24
8	75	10.75	21.20	-15.29	36.49	162.02	249.96	12151.43
Roof	86.5	5.75	21.74	-15.29	37.03	87.94	87.94	7606.54

North Building: E-S Wind Direction								
Floor	Height	Trib Height	Windward	Leeward	Total	Story Force	Total Shear	Overturning Moment
Ground	0	0	0	0	0	0	463.99	22630.33
2	15	12.5	16.37	-10.95	27.32	67.12	463.99	1006.76
3	25	10	16.37	-10.95	27.32	53.69	396.87	1342.17
4	35	10	18.16	-10.95	29.11	57.21	343.19	2002.19
5	45	10	19.05	-10.95	30.00	58.96	285.98	2653.41
6	55	10	19.77	-10.95	30.72	60.37	227.02	3320.46
7	65	10	20.48	-10.95	31.44	61.78	166.64	4015.66
8	75	10.75	21.20	-10.95	32.15	67.93	104.87	5094.44
Roof	86.5	5.75	21.74	-10.95	32.69	36.94	36.94	3195.25

South Building: N-S Wind Direction								
Floor	Height	Trib Height	Windward	Leeward	Total	Story Force	Total Shear	Overturning Moment
Ground	0	0	0	0	0	0	1116.71	54264.77
2	15	12.5	16.37	-15.29	31.66	163.46	1116.71	2451.84
3	25	10	16.37	-15.29	31.66	130.75	953.25	3268.76
4	35	10	18.16	-15.29	33.45	138.14	822.50	4835.07
5	45	10	19.05	-15.29	34.34	141.84	684.36	6382.89
6	55	10	19.77	-15.29	35.06	144.80	542.51	7963.99
7	65	10	20.48	-15.29	35.78	147.76	397.71	9604.24
8	75	10.75	21.20	-15.29	36.49	162.02	249.96	12151.43
Roof	86.5	5.75	21.74	-15.29	37.03	87.94	87.94	7606.54

South Building: E-S Wind Direction								
Floor	Height	Trib Height	Windward	Leeward	Total	Story Force	Total Shear	Overturning Moment
Ground	0	0	0	0	0	0	462.99	22582.95
2	15	12.5	16.37	-10.89	27.26	66.96	462.99	1004.38
3	25	10	16.37	-10.89	27.25	53.56	396.03	1339.00
4	35	10	18.16	-10.89	29.04	57.08	342.47	1997.75
5	45	10	19.05	-10.89	29.94	58.84	285.39	2647.71
6	55	10	19.77	-10.89	30.66	60.25	226.55	3313.49
7	65	10	20.48	-10.89	31.37	61.65	166.31	4007.43
8	75	10.75	21.20	-10.89	32.09	67.79	104.66	5084.22
Roof	86.5	5.75	21.74	-10.89	32.63	36.87	36.87	3188.95

Floor	HT (ft)	Kz	qz
1	15	0.57	15.007872
2	25	0.66	17.377536
3	35	0.76	20.010496
4	45	0.81	21.326976
5	55	0.85	22.38016
6	65	0.89	23.433344
7	75	0.93	24.486528
8	86.5	0.96	25.276416

North Building

N-S Direction

L	195.625
B	413
h	86.5
Windward Cp	0.8
Leeward Cp	-0.5

South Building

N-S Direction

L	196.52
B	413
h	86.5
Windward Cp	0.8
Leeward Cp	-0.5

E-W Direction

L	413
B	195.625
h	86.5
Windward Cp	0.8
Leeward Cp	-0.298

E-W Direction

L	413
B	196.52
h	86.5
Windward Cp	0.8
Leeward Cp	-0.295

SEISMIC

Index Force Analysis

North Building

Floor	Area	Weight	Fx	Wall Area	Wall Wt	Wall Fx
Ground	45364	3629.12	36.2912	813.6667	12.205	0.12205
2	45364	3629.12	36.2912	813.6667	12.205	0.12205
3	45364	3629.12	36.2912	813.6667	12.205	0.12205
4	45364	3629.12	36.2912	813.6667	12.205	0.12205
5	45364	3629.12	36.2912	813.6667	12.205	0.12205
6	45364	3629.12	36.2912	813.6667	12.205	0.12205
7	45364	3629.12	36.2912	813.6667	12.205	0.12205
8	45364	3629.12	36.2912	813.6667	12.205	0.12205
Roof	45364	3629.12	36.2912	813.6667	12.205	0.12205
sum	408276	32662.08	326.6208	7323	109.845	1.09845

Total Base Shear 327.7193
 Overturning Moment 28347.72

South Building

Floor	Area	Weight	Fx	Wall Area	Wall Wt	Wall Fx
Ground	35940.07	2875.206	28.752056	822.3333	12.335	0.12335
2	35940.07	2875.206	28.752056	822.3333	12.335	0.12335
3	35940.07	2875.206	28.752056	822.3333	12.335	0.12335
4	35940.07	2875.206	28.752056	822.3333	12.335	0.12335
5	35940.07	2875.206	28.752056	822.3333	12.335	0.12335
6	35940.07	2875.206	28.752056	822.3333	12.335	0.12335
7	35940.07	2875.206	28.752056	822.3333	12.335	0.12335
8	35940.07	2875.206	28.752056	822.3333	12.335	0.12335
Roof	35940.07	2875.206	28.752056	822.3333	12.335	0.12335
sum	323460.6	25876.85	258.768504	7401	111.015	1.11015

Total Base Shear 259.8787
 Overturning Moment 22479.5

Equivalent Lateral Force Method

Braced Frame $C_u = 0.0547$

V 1792.624

Moment Frame $C_u = 0.0407$

V 1333.817

North Building					
Braced Frame - $k = 1.197$			v	1792.624	
Floor	wx	hx	$wx \cdot hx^{1.197}$	Cvx	Fx
Roof	3641.325	86.5	758346.56	0.23	311.64
8	3641.325	75	639304.52	0.20	262.72
7	3641.325	65	538662.49	0.17	221.36
6	3641.325	55	441035.53	0.14	181.24
5	3641.325	45	346860.48	0.11	142.54
4	3641.325	35	256749.08	0.08	105.51
3	3641.325	25	171630.17	0.05	70.53
2	3641.325	15	93119.51	0.03	38.27
Ground	3641.325	0	0	0	0
Sum			3245708.34		
Moment Frame - $k = 1.31$			v	1333.817	
Floor	wx	hx	$wx \cdot hx^{1.31}$	Cvx	Fx
Roof	3641.325	86.5	1255308.71	0.39	515.87
8	3641.325	75	1041333.16	0.32	427.93
7	3641.325	65	863328.23	0.27	354.78
6	3641.325	55	693640.70	0.21	285.05
5	3641.325	45	533295.40	0.16	219.16
4	3641.325	35	383697.16	0.12	157.68
3	3641.325	25	246922.61	0.08	101.47
2	3641.325	15	126455.87	0.04	51.97
Ground	3641.325	0	0	0	0
Sum			5143981.83		

South Building					
Braced Frame - k = 1.197			v	1792.624	
Floor	wx	hx	wx*hx ^{1.197}	Cvx	Fx
Roof	2887.541	86.5	601362.55	0.19	247.13
8	2887.541	75	506963.20	0.16	208.34
7	2887.541	65	427154.89	0.13	175.54
6	2887.541	55	349737.53	0.11	143.72
5	2887.541	45	275057.49	0.08	113.03
4	2887.541	35	203599.89	0.06	83.67
3	2887.541	25	136101.31	0.04	55.93
2	2887.541	15	73843.00	0.02	30.35
Ground	2887.541	0	0	0	0
Sum			2573819.86		
Moment Frame - k = 1.31			v	1333.817	
Floor	wx	hx	wx*hx ^{1.31}	Cvx	Fx
Roof	2887.541	86.5	995449.43	0.31	409.08
8	2887.541	75	825768.58	0.25	339.35
7	2887.541	65	684612.14	0.21	281.34
6	2887.541	55	550051.33	0.17	226.04
5	2887.541	45	422898.84	0.13	173.79
4	2887.541	35	304268.67	0.09	125.04
3	2887.541	25	195807.58	0.06	80.47
2	2887.541	15	100278.46	0.03	41.21
Ground	2887.541	0	0	0	0
Sum			4079135.03		



PENN STATE UNIVERSITY

CLASS: _____

DATE: _____

ASSIGNMENT: _____

PAGE: _____ of _____

SEISMIC WEIGHT

DEAD LOAD

- 30 PSF CONC SLAB (VULCRAFT CATALOG)
- 20 PSF MECH, ELEC, SPRINKLERS
- 10 PSF FLOOR + CEILING FINISHES
- 15 PSF STEEL MEMBERS + DECK - CONSERVATIVE
- 5 PSF MISC
- 80 PSF

STORAGE AREAS

0.75 x 125 = 31.25 PSF

PARTITION LOADS 20 PSF

ASSUME 80 PSF ROOF LOAD → CONSERVATIVE

AREAS:

NORTH BUILDING:

- 11064.5 SF (WEST END)
- 18897.62 SF (MIDDLE SECTION)
- 15401.92 SF (EAST END)
- 45364 SF TOTAL

SOUTH BUILDING:

- 10994.27 SF (WEST END)
- 12833.85 SF (MIDDLE SECTION)
- 12111.95 SF (EAST END)
- 35940.07 SF TOTAL

WALLS

WALLS ARE CURTAIN WALLS: 15 PSF

PERIMETER

NORTH BLDG:

- WEST = 154' + 49' + 69' = 272'
- SOUTH = 88' + 124' = 212'
- NORTH = 425' + 56.5' = 481.5'
- EAST = 180' + 50' + 18' + 7' = 255'
- 1220.5'

SOUTH BLDG:

- NORTH = 173' + 66' + 170' = 409'
- EAST = 57.5' + 25.5' + 190.5' = 273.5'
- WEST = 125' + 136' = 261'
- SOUTH = 290' = 290'
- 1233.5'



PENN STATE UNIVERSITY

CLASS: _____

DATE: _____

ASSIGNMENT: _____

PAGE: _____ of _____

SEISMIC DESIGN

OCCUPANCY CATEGORY: 2

IMPORTANCE FACTOR: 1.0

SITE CLASS: E ← ASSUMED S_3 UNDER MASS BUILDING CODE
ASSUMED E TO BE CONSERVATIVE

303 THIRD ST CAMBRIDGE, MA

LAT: 42.365° LONG: -71.083°

$$S_s = 0.28$$

$$F_a = 2.404$$

$$S_1 = 0.068$$

$$F_v = 3.5$$

$$S_{ms} = F_a S_s = 2.404(0.28) = 0.673$$

$$S_{m1} = F_v S_1 = 3.5(0.068) = 0.238$$

$$S_{D5} = \frac{2}{3} S_{ms} = \frac{2}{3}(0.673) = 0.449$$

$$S_{D1} = \frac{2}{3} S_{m1} = \frac{2}{3}(0.238) = 0.159$$

NOTE:

STRUCTURAL ENGINEER USES

MASS STATE BUILDING CODE

ENR 1 AM USING ASCE 7-05

AND IBC 2006 FOR ANALYSIS

RESPONSE MODIFICATION FACTORS

ORDINARY STEEL CONCENTRICALLY BRACED FRAME: $R = 3.25$

ORDINARY STEEL MOMENT FRAME: $R = 3.5$

DETERMINATION OF C_s FOR BRACED FRAME

$$h_n = 85.5'$$

$$S_{D1} = 0.159 > 0.15 \rightarrow C_u = 1.59 \text{ FROM INTERPOLATION}$$

$$C_s \leq C_u T_n = 1.59 (0.02 (85.5)^{0.75}) = 0.894 \text{ s}$$

$$C_s \leq \frac{S_{D1}}{(R/I) \cdot T} = \frac{0.159}{(3.25/1) \cdot 0.894} = 0.0547 \leftarrow \text{GOVERNS}$$

$$C_s \geq 0.044 S_{D5} I = 0.044 (0.449) (1) = 0.01976$$

$$\boxed{C_s = 0.0547}$$



PENN STATE UNIVERSITY

CLASS: _____

DATE: _____

ASSIGNMENT: _____

PAGE: _____ of _____

DETERMINE OF C_s FOR MOMENT FRAME

$$T_a = 0.702 \text{ s}$$

$$T = C_u T_a = 1.159 (0.02 (85.5)^{0.8}) = 1.117 \text{ s}$$

$$C_s \leq \frac{S_{D1}}{(\frac{R}{I})T} = \frac{0.159}{(3.5/1)1.117} = 0.0407 \leftarrow \text{GOVERNS}$$

$$C_s \geq 0.044 S_{DS} I = 0.01976$$

$$\boxed{C_s = 0.0407}$$

INTERPOLATION FOR K

MOMENT FRAME: $K = 1 + (1.117 - 0.5) \left(\frac{2-1}{2.5-0.5} \right) = 1.3085 \sim 1.31$

BRACED FRAME: $K = 1 + (0.894 - 0.5) \left(\frac{2-1}{2.5-0.5} \right) = 1.197$



PENN STATE UNIVERSITY


CLASS: _____

DATE: _____

ASSIGNMENT: _____

PAGE: _____ of _____

TYPICAL SLAB - 7TH FLOOR SOUTH BLDG

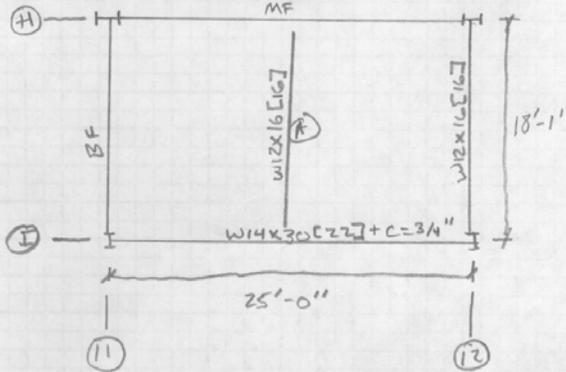

3 1/4" LT WT CONC
3" METAL DECK

LOAD FOR TYP FLOOR:

50 PSF SLAB
30 PSF SDL
100 PSF LIVE LOAD - CONS.
180 PSF

$$1.2D + 1.6L = 256 \text{ PSF (12.5')}$$

$$+ 1.2(16) \leftarrow \text{STEEL WT}$$


$$321.9; 2 \text{ PLF 5'}$$

BEAM A

$$\text{MAX SHEAR} = \frac{wL}{2} = \frac{3.22(18 + \frac{1}{2})}{2} = 29.1 \text{ K}$$

$$\text{MIDSPAN MOMENT} = \frac{wL^2}{8} = \frac{3.22(18 + \frac{1}{2})^2}{8} = 131.6 \text{ FT-K}$$

TRY LOCATION TFL WITH $y_2 = 2"$ ($\phi M_n = 141 \text{ FT-K}$, $\Sigma Q_n = 236 \text{ K}$)



$$F_y = A_s F_y = 4.71(50 \text{ KSI}) = 235.5 \text{ K}$$

$$\Sigma Q_n = 236 \text{ K}$$

$$C_c = 236 \text{ K} = 0.85 f_c' b_{eff} a$$

$$a = \frac{236}{0.85(4)(54.25)} = 1.28 \text{ ''}$$

$$b_{eff} \begin{cases} 1/4 \text{ SPAN} = \frac{1}{4}(18'-1'') = 54.25'' \\ \text{SPACING} = 150'' \end{cases}$$

$$y_2 = 6.25 - 1.28 = 4.97 \rightarrow \text{CLOSE TO } 5''$$

@ $y_2 = 5''$, TFL, $\phi M_n = 141 \text{ FT-K}$

$$141 \text{ FT-K} > 131.6 \text{ FT-K}$$

∴ COMPOSITE BEAM IS PROPERLY SIZED



PENN STATE UNIVERSITY

CLASS: _____

DATE: _____

ASSIGNMENT: _____

PAGE: _____ of _____

COLUMN 6-F-7TH FLOOR W14X68

LOADS:

DL: 50 PSF (SLAB) + 20 (MEP) + 5 (BEAMS) = 75 PSF

LL: 40 PSF (RESIDENTIAL) + 20 (PARTITIONS) = 60 PSF

EXTERIOR COLUMN
LL RED

$A_t = (9+12) \times \frac{(15'-11")}{2} = 167.125 \text{ SF}$ ONE STORY ABOVE
 $(2) = 334.25$

$L = 6 \left(0.25 + \frac{15}{\sqrt{K_L A_t}} \right) = 60 \left(0.25 + \frac{15}{\sqrt{2(334.25)}} \right) = 49.81 \text{ PSF}$

LOAD COMB

$1.2D + 1.6L = 1.2(75) + 1.6(60) = 186 \text{ PSF}$

$P_{FL} = 186(334.25) = 62170.5 = 62.2 \text{ K} = P_u$

KL = 10' FROM AISC TABLE 4-1

$\phi P_n \text{ FOR W14X68} = 755 \text{ K} \gg 62.2 \text{ K}$

THIS COLUMN MUST HAVE BEEN DESIGNED FOR FLEXURE OR AS A BRACING ELEMENT AS IT IS PART OF AN EXTERIOR MOMENT FRAME. THE MEMBER CAN CERTAINLY WITHSTAND THE GRAVITY LOAD OF THE STRUCTURE.



Software licensed to Student

Job No

Sheet No

1

Rev

Part

Job Title AE 481W Tech 1

Ref

By Tufts

Date 04-Oct-07

Chd

Client Ali Memari

File Thesis Lateral Frame TR\

Date/Time 04-Oct-2007 16:05

Job Information

	Engineer	Checked	Approved
Name:	Tufts		
Date:	04-Oct-07		

Structure Type PLANE FRAME

Number of Nodes	34	Highest Node	34
Number of Elements	35	Highest Beam	51

Number of Basic Load Cases	1
Number of Combination Load Cases	0

Included in this printout are data for:

All	The Whole Structure
-----	---------------------

Included in this printout are results for load cases:

Type	L/C	Name
Primary	1	LOAD CASE 1

Nodes

Node	X (ft)	Y (ft)	Z (ft)
1	0.000	0.000	0.000
2	0.000	15.000	0.000
3	0.000	25.000	0.000
4	0.000	35.000	0.000
5	0.000	45.000	0.000
6	0.000	55.000	0.000
7	0.000	65.000	0.000
8	0.000	75.000	0.000
9	0.000	86.500	0.000
10	18.083	0.000	0.000
11	18.083	15.000	0.000
12	18.083	25.000	0.000
13	18.083	35.000	0.000
14	18.083	45.000	0.000
15	18.083	55.000	0.000
16	18.083	65.000	0.000
17	18.083	75.000	0.000
18	18.083	86.500	0.000
19	9.042	86.500	0.000
20	9.042	75.000	0.000
21	9.042	65.000	0.000
22	9.042	55.000	0.000



Software licensed to Student

Job No	Sheet No 2	Rev
Part		
Ref		
By Tufts	Date 04-Oct-07	Chd
Client Ali Memari	File Thesis Lateral Frame TR\	Date/Time 04-Oct-2007 16:05

Nodes Cont...

Node	X (ft)	Y (ft)	Z (ft)
23	9.042	45.000	0.000
24	9.042	35.000	0.000
25	9.042	25.000	0.000
26	9.042	15.000	0.000
27	0.000	29.000	0.000
28	0.000	49.000	0.000
29	0.000	69.000	0.000
30	0.000	6.500	0.000
31	18.083	6.500	0.000
32	18.083	29.000	0.000
33	18.083	49.000	0.000
34	18.083	69.000	0.000

Beams

Beam	Node A	Node B	Length (ft)	Property	β (degrees)
17	1	10	18.083	1	0
18	9	18	18.083	1	0
19	2	11	18.083	1	0
20	3	12	18.083	1	0
21	4	13	18.083	1	0
22	5	14	18.083	1	0
23	6	15	18.083	1	0
24	7	16	18.083	1	0
25	8	17	18.083	1	0
26	8	19	14.629	6	0
27	17	19	14.628	6	0
28	1	26	17.514	2	0
29	10	26	17.514	2	0
30	2	25	13.482	2	0
31	11	25	13.481	2	0
32	3	24	13.482	2	0
33	12	24	13.481	2	0
34	4	23	13.482	3	0
35	13	23	13.481	3	0
36	14	22	13.481	4	0
37	5	22	13.482	4	0
38	6	21	13.482	4	0
39	15	21	13.481	4	0
40	7	20	13.482	5	0
41	16	20	13.481	5	0
42	1	30	6.500	12	0
43	27	28	20.000	9	0



Software licensed to Student

Job No	Sheet No 3	Rev
Part		
Ref		
By Tufts	Date 04-Oct-07	Chd
Client Ali Memari	File Thesis Lateral Frame TR\	Date/Time 04-Oct-2007 16:05

Beams Cont...

Beam	Node A	Node B	Length (ft)	Property	β (degrees)
44	28	29	20.000	8	0
45	29	9	17.500	7	0
46	10	31	6.500	11	0
47	31	32	22.500	11	0
48	32	33	20.000	9	0
49	33	34	20.000	8	0
50	34	18	17.500	7	0
51	30	27	22.500	10	0

Section Properties

Prop	Section	Area (in ²)	I _{yy} (mil ⁴)	I _{zz} (mil ⁴)	J (mil ⁴)	Material
1	W12X30	8.790	20.3E12	238E12	437E 9	STEEL
2	HSST9X5X0.5	11.600	45.2E12	115E12	107E12	STEEL
3	HSST7X5X0.625	11.700	40.6E12	69.4E12	86.3E12	STEEL
4	HSST7X5X0.5	9.740	35.6E12	60.6E12	73.8E12	STEEL
5	HSST6X4X0.5	7.880	17.8E12	34E12	39.3E12	STEEL
6	HSST6X4X0.375	6.180	14.9E12	28.3E12	31.9E12	STEEL
7	W14X61	17.900	107E12	640E12	2.01E12	STEEL
8	W14X68	20.000	121E12	723E12	2.8E12	STEEL
9	W14X90	26.500	362E12	999E12	3.82E12	STEEL
10	W14X120	35.300	495E12	1.38E15	8.99E12	STEEL
11	W14X132	38.800	548E12	1.53E15	11.9E12	STEEL
12	W14X145	42.700	677E12	1.71E15	14.7E12	STEEL

Supports

Node	X (kip/in)	Y (kip/in)	Z (kip/in)	rX (kip*ft/deg)	rY (kip*ft/deg)	rZ (kip*ft/deg)
1	Fixed	Fixed	Fixed	Fixed	Fixed	Fixed
10	Fixed	Fixed	Fixed	Fixed	Fixed	Fixed

Basic Load Cases

Number	Name
1	LOAD CASE 1



Software licensed to Student

Job No	Sheet No 4	Rev
Part		
Ref		
By Tufts	Date 04-Oct-07	Chd
Client Ali Memari	File Thesis Lateral Frame TR\	Date/Time 04-Oct-2007 16:05

Node Displacements

Node	L/C	X (in)	Y (in)	Z (in)	Resultant (in)	rX (rad)	rY (rad)	rZ (rad)
1	1:LOAD CASE	0.000	0.000	0.000	0.000	0.000	0.000	0.000
2	1:LOAD CASE	-34E 6	30.4E 6	0.000	45.7E 6	0.000	0.000	-282E 3
3	1:LOAD CASE	-62.7E 6	56.2E 6	0.000	84.2E 6	0.000	0.000	-519E 3
4	1:LOAD CASE	-154E 6	139E 6	0.000	208E 6	0.000	0.000	-1.28E 6
5	1:LOAD CASE	-239E 6	215E 6	0.000	322E 6	0.000	0.000	-1.98E 6
6	1:LOAD CASE	-304E 6	274E 6	0.000	409E 6	0.000	0.000	-2.52E 6
7	1:LOAD CASE	-659E 6	594E 6	0.000	887E 6	0.000	0.000	-5.48E 6
8	1:LOAD CASE	-1.35E 9	1.06E 9	0.000	1.71E 9	0.000	0.000	-9.74E 6
9	1:LOAD CASE	-637.328	-0.802	0.000	637.328	0.000	0.000	0.320
10	1:LOAD CASE	0.000	0.000	0.000	0.000	0.000	0.000	0.000
11	1:LOAD CASE	-34E 6	-30.7E 6	0.000	45.8E 6	0.000	0.000	-282E 3
12	1:LOAD CASE	-62.7E 6	-56.5E 6	0.000	84.4E 6	0.000	0.000	-519E 3
13	1:LOAD CASE	-154E 6	-139E 6	0.000	208E 6	0.000	0.000	-1.28E 6
14	1:LOAD CASE	-239E 6	-215E 6	0.000	322E 6	0.000	0.000	-1.98E 6
15	1:LOAD CASE	-304E 6	-274E 6	0.000	409E 6	0.000	0.000	-2.52E 6
16	1:LOAD CASE	-659E 6	-594E 6	0.000	888E 6	0.000	0.000	-5.48E 6
17	1:LOAD CASE	-1.35E 9	-1.06E 9	0.000	1.71E 9	0.000	0.000	-9.74E 6
18	1:LOAD CASE	-637.460	0.745	0.000	637.460	0.000	0.000	0.331
19	1:LOAD CASE	-3.36E 6	-258E 3	0.000	3.37E 6	0.000	0.000	-9.74E 6
20	1:LOAD CASE	-1.74E 6	-209E 3	0.000	1.75E 6	0.000	0.000	-5.48E 6
21	1:LOAD CASE	-1.15E 6	-169E 3	0.000	1.16E 6	0.000	0.000	-2.52E 6
22	1:LOAD CASE	-904E 3	-169E 3	0.000	920E 3	0.000	0.000	-1.98E 6
23	1:LOAD CASE	-557E 3	-141E 3	0.000	575E 3	0.000	0.000	-1.28E 6
24	1:LOAD CASE	-375E 3	-142E 3	0.000	401E 3	0.000	0.000	-519E 3
25	1:LOAD CASE	-203E 3	-142E 3	0.000	248E 3	0.000	0.000	-282E 3
26	1:LOAD CASE	0.000	0.000	0.000	0.000	0.000	0.000	0.000
27	1:LOAD CASE	-117.679	-0.180	0.000	117.679	0.000	0.000	0.623
28	1:LOAD CASE	-304.067	-0.352	0.000	304.068	0.000	0.000	0.874
29	1:LOAD CASE	-513.331	-0.580	0.000	513.331	0.000	0.000	0.794
30	1:LOAD CASE	-6.171	-0.035	0.000	6.171	0.000	0.000	0.152
31	1:LOAD CASE	-7.015	0.036	0.000	7.015	0.000	0.000	0.173
32	1:LOAD CASE	-118.632	0.159	0.000	118.633	0.000	0.000	0.608
33	1:LOAD CASE	-302.519	0.323	0.000	302.519	0.000	0.000	0.868
34	1:LOAD CASE	-511.733	0.537	0.000	511.733	0.000	0.000	0.799



Software licensed to Student

Job No	Sheet No 5	Rev
Part		
Ref		
By Tufts	Date 04-Oct-07	Chd
Client Ali Memari	File Thesis Lateral Frame TR\	Date/Time 04-Oct-2007 16:05

Node Displacement Summary

	Node	L/C	X (in)	Y (in)	Z (in)	Resultant (in)	rX (rad)	rY (rad)	rZ (rad)
Max X	1	1:LOAD CASE	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Min X	8	1:LOAD CASE	-1.35E 9	1.06E 9	0.000	1.71E 9	0.000	0.000	-9.74E 6
Max Y	8	1:LOAD CASE	-1.35E 9	1.06E 9	0.000	1.71E 9	0.000	0.000	-9.74E 6
Min Y	17	1:LOAD CASE	-1.35E 9	-1.06E 9	0.000	1.71E 9	0.000	0.000	-9.74E 6
Max Z	1	1:LOAD CASE	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Min Z	1	1:LOAD CASE	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Max rX	1	1:LOAD CASE	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Min rX	1	1:LOAD CASE	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Max rY	1	1:LOAD CASE	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Min rY	1	1:LOAD CASE	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Max rZ	28	1:LOAD CASE	-304.067	-0.352	0.000	304.068	0.000	0.000	0.874
Min rZ	8	1:LOAD CASE	-1.35E 9	1.06E 9	0.000	1.71E 9	0.000	0.000	-9.74E 6
Max Rst	17	1:LOAD CASE	-1.35E 9	-1.06E 9	0.000	1.71E 9	0.000	0.000	-9.74E 6

Beam Displacement Detail Summary

Displacements shown in *italic* indicate the presence of an offset

	Beam	L/C	d (ft)	X (in)	Y (in)	Z (in)	Resultant (in)
Max X	17	1:LOAD CASE	12.658	0.000	-0.085	0.000	0.085
Min X	25	1:LOAD CASE	0.000	-1.35E 9	1.06E 9	0.000	1.71E 9
Max Y	25	1:LOAD CASE	0.000	-1.35E 9	1.06E 9	0.000	1.71E 9
Min Y	25	1:LOAD CASE	18.083	-1.35E 9	-1.06E 9	0.000	1.71E 9
Max Z	17	1:LOAD CASE	0.000	0.000	0.000	0.000	0.000
Min Z	17	1:LOAD CASE	0.000	0.000	0.000	0.000	0.000
Max Rst	25	1:LOAD CASE	18.083	-1.35E 9	-1.06E 9	0.000	1.71E 9

Reaction Summary

	Node	L/C	Horizontal	Vertical	Horizontal	Moment		
			FX (kip)	FY (kip)	FZ (kip)	MX (kip*ft)	MY (kip*ft)	MZ (kip*ft)
Max FX	10	1:LOAD CASE	156.484	-501.605	0.000	0.000	0.000	-8.77E 3
Min FX	1	1:LOAD CASE	155.156	566.704	0.000	0.000	0.000	-8.52E 3
Max FY	1	1:LOAD CASE	155.156	566.704	0.000	0.000	0.000	-8.52E 3
Min FY	10	1:LOAD CASE	156.484	-501.605	0.000	0.000	0.000	-8.77E 3
Max FZ	1	1:LOAD CASE	155.156	566.704	0.000	0.000	0.000	-8.52E 3
Min FZ	1	1:LOAD CASE	155.156	566.704	0.000	0.000	0.000	-8.52E 3
Max MX	1	1:LOAD CASE	155.156	566.704	0.000	0.000	0.000	-8.52E 3
Min MX	1	1:LOAD CASE	155.156	566.704	0.000	0.000	0.000	-8.52E 3
Max MY	1	1:LOAD CASE	155.156	566.704	0.000	0.000	0.000	-8.52E 3
Min MY	1	1:LOAD CASE	155.156	566.704	0.000	0.000	0.000	-8.52E 3
Max MZ	1	1:LOAD CASE	155.156	566.704	0.000	0.000	0.000	-8.52E 3
Min MZ	10	1:LOAD CASE	156.484	-501.605	0.000	0.000	0.000	-8.77E 3



Software licensed to Student

Job No	Sheet No 6	Rev
Part		
Ref		
By Tufts	Date 04-Oct-07	Chd
Client Ali Memari	File Thesis Lateral Frame TR\	Date/Time 04-Oct-2007 16:05

Beam Maximum Moments

Distances to maxima are given from beam end A.

Beam	Node A	Length (ft)	L/C		d (ft)	Max My (kip ft)	d (ft)	Max Mz (kip ft)
17	1	18.083	1:LOAD CASE	Max -ve	0.000	0.000	0.000	49.051
				Max +ve	0.000	0.000	9.042	-24.525
18	9	18.083	1:LOAD CASE	Max -ve	0.000	0.000	0.000	4.85E 3
				Max +ve	0.000	0.000	18.083	-4.81E 3
19	2	18.083	1:LOAD CASE	Max -ve	0.000	0.000	18.083	26.453
				Max +ve	0.000	0.000	7.535	-62.417
20	3	18.083	1:LOAD CASE	Max -ve	0.000	0.000	18.083	135.658
				Max +ve	0.000	0.000	4.521	-37.541
21	4	18.083	1:LOAD CASE	Max -ve	0.000	0.000	18.083	10.163
				Max +ve	0.000	0.000	6.028	-117.740
22	5	18.083	1:LOAD CASE	Max -ve	0.000	0.000	18.083	281.373
				Max +ve	0.000	0.000	0.000	-82.379
23	6	18.083	1:LOAD CASE	Max -ve	0.000	0.000	18.083	48.206
				Max +ve	0.000	0.000	4.521	-124.047
24	7	18.083	1:LOAD CASE	Max -ve	0.000	0.000	18.083	42.928
				Max +ve	0.000	0.000	3.014	-171.444
25	8	18.083	1:LOAD CASE	Max -ve	0.000	0.000	18.083	1.1E 3
				Max +ve	0.000	0.000	0.000	-464.903
26	8	14.629	1:LOAD CASE	Max -ve	0.000	0.000	0.000	464.903
				Max +ve	0.000	0.000	14.629	-1.16E 3
27	17	14.628	1:LOAD CASE	Max -ve	0.000	0.000	14.628	1.87E 3
				Max +ve	0.000	0.000	0.000	-1.1E 3
28	1	17.514	1:LOAD CASE	Max -ve	0.000	0.000	0.000	0.000
				Max +ve	0.000	0.000	0.000	0.000
29	10	17.514	1:LOAD CASE	Max -ve	0.000	0.000	0.000	0.000
				Max +ve	0.000	0.000	0.000	0.000
30	2	13.482	1:LOAD CASE	Max -ve	0.000	0.000	0.000	3.272
				Max +ve	0.000	0.000	13.482	-204.025
31	11	13.481	1:LOAD CASE	Max -ve	0.000	0.000	13.481	178.659
				Max +ve	0.000	0.000	0.000	-26.453
32	3	13.482	1:LOAD CASE	Max -ve	0.000	0.000	0.000	21.697
				Max +ve	0.000	0.000	13.482	-290.520
33	12	13.481	1:LOAD CASE	Max -ve	0.000	0.000	13.481	414.769
				Max +ve	0.000	0.000	0.000	-135.658
34	4	13.482	1:LOAD CASE	Max -ve	0.000	0.000	0.000	83.593
				Max +ve	0.000	0.000	13.482	-597.789
35	13	13.481	1:LOAD CASE	Max -ve	0.000	0.000	13.481	457.295
				Max +ve	0.000	0.000	0.000	-10.163
36	14	13.481	1:LOAD CASE	Max -ve	0.000	0.000	13.481	829.429
				Max +ve	0.000	0.000	0.000	-281.373
37	5	13.482	1:LOAD CASE	Max -ve	0.000	0.000	0.000	82.379
				Max +ve	0.000	0.000	13.482	-595.958
38	6	13.482	1:LOAD CASE	Max -ve	0.000	0.000	0.000	107.891
				Max +ve	0.000	0.000	13.482	-962.977



Software licensed to Student

Job No	Sheet No 7	Rev
Part		
Ref		
By Tufts	Date 04-Oct-07	Chd
Client Ali Memari	File Thesis Lateral Frame TR\	Date/Time 04-Oct-2007 16:05

Beam Maximum Moments Cont...

Beam	Node A	Length (ft)	L/C		d (ft)	Max My (kip-ft)	d (ft)	Max Mz (kip-ft)
39	15	13.481	1:LOAD CASE	Max -ve	0.000	0.000	13.481	849.418
				Max +ve	0.000	0.000	0.000	-48.206
40	7	13.482	1:LOAD CASE	Max -ve	0.000	0.000	0.000	165.269
				Max +ve	0.000	0.000	13.482	-1.19E 3
41	16	13.481	1:LOAD CASE	Max -ve	0.000	0.000	13.481	1.02E 3
				Max +ve	0.000	0.000	0.000	-42.928
42	1	6.500	1:LOAD CASE	Max -ve	0.000	0.000		
				Max +ve	0.000	0.000	0.000	-8.57E 3
43	27	20.000	1:LOAD CASE	Max -ve	0.000	0.000		
				Max +ve	0.000	0.000	0.000	-4.07E 3
44	28	20.000	1:LOAD CASE	Max -ve	0.000	0.000	20.000	2.13E 3
				Max +ve	0.000	0.000	0.000	-969.753
45	29	17.500	1:LOAD CASE	Max -ve	0.000	0.000	17.500	4.85E 3
				Max +ve	0.000	0.000		
46	10	6.500	1:LOAD CASE	Max -ve	0.000	0.000		
				Max +ve	0.000	0.000	0.000	-8.73E 3
47	31	22.500	1:LOAD CASE	Max -ve	0.000	0.000		
				Max +ve	0.000	0.000	0.000	-7.71E 3
48	32	20.000	1:LOAD CASE	Max -ve	0.000	0.000		
				Max +ve	0.000	0.000	0.000	-4.19E 3
49	33	20.000	1:LOAD CASE	Max -ve	0.000	0.000	20.000	2.07E 3
				Max +ve	0.000	0.000	0.000	-1.06E 3
50	34	17.500	1:LOAD CASE	Max -ve	0.000	0.000	17.500	4.81E 3
				Max +ve	0.000	0.000		
51	30	22.500	1:LOAD CASE	Max -ve	0.000	0.000		
				Max +ve	0.000	0.000	0.000	-7.56E 3