



# A REEVALUATION OF MONTGOMERY COUNTY'S JUDICIAL CENTER ANNEX

THE PENNSYLVANIA STATE UNIVERSITY  
SCHREYER HONORS COLLEGE

Department of Architectural Engineering

Jacob Wiest  
Spring 2012

A thesis submitted in  
partial requirement for degree in Architectural Engineering  
with honors in Architectural Engineering

Review and approved by the following:

Andres Lepage  
Assistant Professor  
Thesis Supervisor

Richard Mistrick  
Associate Professor  
Honors Advisor

Signatures on file with the honors college\*

## Abstract

The Judicial Center Annex is a 210,000 square foot addition to Montgomery County's Judicial Center located in Rockville, MD. The \$67 million dollar project is currently under construction and slated to finish in April of 2013.

The structural system, as designed is a post tensioned slab supported by reinforced concrete columns. The lateral force resisting system is reinforced concrete shear walls and the foundations are core drilled piers.

This report is the result of a semester of research upon the existing structural design. Based upon the findings a proposal was created for a system redesign. Due to the fact that the building lacked a height restriction it was determined to explore a steel alternative to the concrete construction. Also, as seismic design was an interest, the building was "moved" to San Francisco where the greater seismic forces would need to be dealt with.

The redesign in Maryland necessitated a cost and schedule comparison to determine the viability of the change in systems, so this was chosen as one breadth for further exploration. The other breadth was inspired by the sustainable features found upon the roof. The JCA has both green roof and photovoltaic panels. It was determined to investigate if changing the green roof portions to PV panels would be more beneficial for the owner by comparing the life cycle cost, carbon emissions, and LEED impacts of the two systems. The LEED checklist would also be further explored looking for opportunities to improve upon the Gold rated building.

The steel structure was able to be implemented effectively, using braced frames in lieu of the shear walls and maintaining the current grid to avoid impacting the layout. The large floor to floor heights and generous plenum spaces made a height adjustment largely unnecessary, with the total height only increasing by a 1.5'. It was estimated that the system could save in the order of \$700k in cost and a month in schedule.

The steel move to California necessitated changing the ordinary concentrically braced frames to special concentrically braced frames in order to deal with the increased forces. This required special detailing and turned out to be slightly uneconomical due to the one chevron configuration. Changing this to an eccentrically braced frame saved in the order of \$200k and 70 tons of steel. Adding additional frames also took advantage of certain code provisions and helped mitigate torsion problems.

The sustainability study showed that the green roof was the better option, as it had a lower initial investment which it paid back quicker. It also had other benefits in the form of net negative carbon emissions, storm water runoff control, urban heat island reduction, as well as impacting a possible 7 LEED points.

## Table of Contents

<b>Chapter 1: Existing Building</b> .....	<b>1</b>
<b>1.1: Structural Overview</b> .....	<b>2</b>
<b>1.2: Gravity Loads</b> .....	<b>8</b>
<b>1.3: Lateral Loads</b> .....	<b>10</b>
<b>1.4: Proposal/Problem Statement</b> .....	<b>12</b>
<b>Chapter 2: Structural Depth</b> .....	<b>14</b>
<b>2.1: MD Gravity Design</b> .....	<b>14</b>
<b>2.2: MD Lateral System &amp; Foundation Design</b> .....	<b>16</b>
<b>2.3: CA Lateral Design, Layout 1</b> .....	<b>27</b>
<b>2.4: CA Lateral Design, Layout 2</b> .....	<b>34</b>
<b>2.5: CA Lateral Design, Layout 3</b> .....	<b>36</b>
<b>2.6: MAE Requirements</b> .....	<b>39</b>
<b>2.7: Summary</b> .....	<b>39</b>
<b>Chapter 3: Construction Management Breadth</b> .....	<b>40</b>
<b>3.1: Cost</b> .....	<b>40</b>
<b>3.2: Schedule</b> .....	<b>41</b>
<b>3.3: Summary</b> .....	<b>42</b>
<b>Chapter 4: Sustainability Breadth</b> .....	<b>44</b>
<b>4.1: Green Roof</b> .....	<b>44</b>
<b>4.2: PV Panels</b> .....	<b>48</b>
<b>4.3: LEED Investigation</b> .....	<b>50</b>
<b>4.4: Summary</b> .....	<b>51</b>
<b>Chapter 5: Conclusion</b> .....	<b>52</b>
<b>References</b> .....	<b>53</b>
<b>Appendix A: Typical Plans</b> .....	<b>54</b>
<b>Appendix B: Wind Calculations</b> .....	<b>56</b>

<b>Appendix C: Seismic Calculations .....</b>	<b>57</b>
<b>Appendix D: Steel Framing Calculations.....</b>	<b>58</b>
<b>Appendix E: RAM Gravity System.....</b>	<b>62</b>
<b>Appendix F: MD Design Lateral Sizing .....</b>	<b>63</b>
<b>Appendix G: MD Story Drifts.....</b>	<b>65</b>
<b>Appendix H: Foundation Sizing.....</b>	<b>66</b>
<b>Appendix I: SCBF Design.....</b>	<b>68</b>
<b>Appendix J: MRSA .....</b>	<b>73</b>
<b>Appendix K: CA Layout 1 Preliminary Sizes .....</b>	<b>74</b>
<b>Appendix L: CA Layout 1 Story Drifts.....</b>	<b>76</b>
<b>Appendix M: CA Layout 2 Preliminary Sizing .....</b>	<b>77</b>
<b>Appendix N: Brace Removal Study .....</b>	<b>80</b>
<b>Appendix O: CA Layout 2 Story Drifts and Torsional Irregularity .....</b>	<b>87</b>
<b>Appendix P: CA Layout 2 Brace Configuration .....</b>	<b>88</b>
<b>Appendix Q: Eccentric Braced Frame Design .....</b>	<b>89</b>
<b>Appendix R: Detailed Cost Breakdown.....</b>	<b>94</b>
<b>Appendix S: Original Schedule.....</b>	<b>99</b>
<b>Appendix T: Vasari Energy Model.....</b>	<b>101</b>
<b>Appendix U: Sunpower T5 Roof Tiles .....</b>	<b>102</b>
<b>Appendix V: SAM Cash Flow .....</b>	<b>103</b>



## List of Figures

Figure 1-1: Site Location, Bing.com .....	1
Figure 1-2: West Elevation .....	1
Figure 1.1-1: Foundation Layout .....	3
Figure 1.1-2: Lantern Framing Plan .....	4
Figure 1.1-3: Lateral Elements .....	5
Figure 1.2-4: Roof Snow Diagram .....	9
Figure 2.1-1: Steel Gravity System Layout .....	15
Figure 2.2-1: Concentrically Braced Frame Configurations .....	20
Figure 2.2-2: BF Layout .....	21
Figure 2.2-3: Core Drilled Pier Sizes and Locations .....	24
Figure 2.2-4: BF 1 .....	25
Figure 2.2-5: BF 2 .....	25
Figure 2.2-6: BF 3 .....	25
Figure 2.2-7: BF 4&5 .....	26
Figure 2.3-1: Design Response Spectrum .....	28
Figure 2.3-2: Chevron Brace to Beam Connection .....	31
Figure 2.3-3: CA BF 1 .....	33
Figure 2.3-4: CA BF 2 .....	33
Figure 2.3-5: CA BF 3 .....	33
Figure 2.3-6: CA BF 4&5 .....	33
Figure 2.4-1: BF Layout .....	34
Figure 2.4-2: ETABS Model, CA Layout 2 .....	35
Figure 2.5-1: Eccentric Braced Frame Beam Design .....	37
Figure 2.5-2: CA 2 BF 1&6 .....	38
Figure 2.5-3: CA 2 BF 2 .....	38
Figure 2.5-4: CA 2 BF 3 .....	38
Figure 2.5-5: CA 2 BF 4&5 .....	38
Figure 2.5-6: CA 2 BF 7 .....	38
Figure 2.5-7: CA 2 BF 8 .....	38
Figure 3.2-1: Redesign Schedule .....	42
Figure 4-1: Sustainable Roof Features .....	44
Figure 4.1-1 Extensive Green Roof Photo .....	45
Figure 4.1-2: Autodesk Vasari Model .....	45
Figure 4.2-1: Sunpower T5 Solar Roof Tiles .....	48
Figure 4.2-2: Schematic Wiring Diagram .....	49
Figure 4.2-3: Solar Study .....	49
Figure 4.4-1: Sustainability Summary .....	51

## List of Tables

Table 1.1-1: Materials Used.....	7
Table 1.2-1: Dead Loads.....	8
Table 1.2-2: Live Loads.....	8
Table 1.2-3: Flat Roof Snow Load.....	9
Table 1.2-4: Snow Drift Calculations.....	9
Table 1.3-1: Wind Force NS.....	10
Table 1.3-2: Wind Force EW.....	10
Table 1.3-3: Seismic Forces NS.....	11
Table 1.3-4: Seismic Forces EW.....	11
Table 1.3-5: Modal Information, JCA Concrete.....	11
Table 2.2-1: Seismic Design Parameters.....	16
Table 2.2-2: Seismic Forces, Both Directions.....	17
Table 2.2-3: Wind Load Criteria.....	17
Table 2.2-4: Kz and qz Values.....	17
Table 2.2-5: Wind Pressure NS.....	18
Table 2.2-6: Wind Pressure EW.....	18
Table 2.2-7: Wind Forces and Shears NS.....	19
Table 2.2-8: Wind Forces and Shears EW.....	19
Table 2.2-9: Brace Configuration Comparison.....	20
Table 2.2-10: MD Modes and Participating Mass.....	21
Table 2.2-11: Seismic X Direction Deflection.....	22
Table 2.2-12: Seismic Y Direction Deflection.....	22
Table 2.2-13: Wind X Direction Deflection.....	23
Table 2.2-14: Wind Y Direction Deflection.....	23
Table 2.2-12: Seismic Y Direction Deflection.....	22
Table 2.3-1: CA Seismic Design Parameters.....	27
Table 2.3-2: CA Seismic Forces.....	28
Table 2.3-3: CA Wind Forces EW.....	29
Table 2.3-4: CA SWind Forces NS.....	29
Table 2.3-5: Torsional Irregularity X Direction.....	31
Table 2.3-6: Torsional Irregularity Y Direction.....	32
Table 2.3-7: Modal Information, CA Layout 1.....	32
Table 2.4-1: Brace Strength Summary.....	35
Table 2.4-2: Modal Information, CA Layout 2.....	36
Table 2.5-1: Modal Information, CA Layout 3.....	37
Table 2.7-1: Steel Design Summary.....	39
Table 3.1-1: Cost Comparison.....	40
Table 3.1-2: Cost Breakdown.....	41
Table 3.3-1: Cost/Schedule Sumamry.....	42
Table 3.3-2: AECOM System Comparison.....	43

Table 4.1-1: Green Roof Life Cycle Cost..... 46  
Table 4.1-2: Green Roof Stats ..... 47  
Table 4.2-1: SAM Study ..... 49

## Acknowledgements

I owe a debt of gratitude to the AECOM for providing me with the opportunity to work on this project and to Montgomery County for giving me the necessary permissions. In particular I'd like to thank the following individuals who provided me with prompt responses and valuable information.

Phil Antis

Jeannie Gasper

Lee Ressler

Carl Hubben

I would also like to thank the entire AE faculty for their tireless dedication to our education, without which this thesis would have been insurmountable. I am especially grateful to the structural faculty who have provided me with a great foundation upon which to enter the field. Special thanks go to the following:

Andres Lepage, my thesis advisor whose insights proved invaluable

Kevin Parfitt and Robert Holland, who patiently dealt with us throughout this process

Truly though none of this would have been possible without my fellow students, who helped me get through thesis with a smile on my face. A special shout out to the following:

Daniel Zartman

Alex Ward

Nathan McGraw

Britt Kern

TJ Kleinosky

Chris Dunlay

Raffi Kayat

David Tran

Finally I'd like to thank my friends and family who have provided me with support throughout this whole process, and never lost faith that I would get it accomplished, even when I did.

## Chapter 1 -Building Introduction

The Judicial Center Annex (JCA) is a modern addition to the existing Montgomery County Judicial Center. Located on the corners of Maryland Avenue and East Jefferson Street in downtown Rockville, MD, the JCA is set to provide a bold statement through both its architecture and engineering. Construction on the addition began this past April and is projected to take two years to complete.

The JCA will stand 114' tall at the crest of each of the four lanterns located on top of the building, so tall that limitations on local building codes needed to be waived for overall building height. Six stories rise above the ground, with garage and terrace levels located below grade, adding approximately 210,000 sq ft to the Judicial Center which includes 10 more courtrooms and several administrative spaces.

The project team, led by AECOM who provided both architectural and the majority of building engineering services, was able to achieve a unique look through both form and material. The East and West Elevations (Figure 1-2) are dominated by glazing, with the curtain wall that covers the East wrapping around the South corner. This curtain wall system is unique in that it uses glass stabilizing fins instead of traditional aluminum mullions, which enables an all glass look that when combined with the way the slab cantilevers out from the structure gives the illusion of the floors floating without structure. On the North the addition abuts against the original Judicial Center. The elements of the façade not

covered in glass are sheathed in either a powder coated aluminum that has a reddish hue or architectural pre-cast panels that are more reminiscent of the exterior of the original building.

From the roof projects four lanterns which have a translucent linear glazing system allowing them to light up the night sky in a truly dramatic manner. The roof is also the site of two of the JCA's sustainable features that enabled it to achieve a LEED Gold Rating. The tops of each of the four lanterns are covered in photovoltaic panels, while green roofs cover much of the remaining roof.

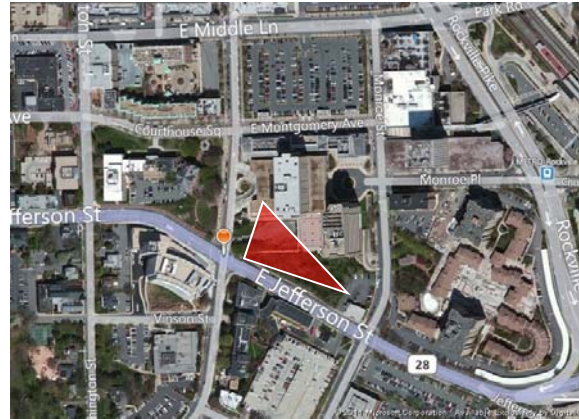


Figure 1-1: Site Location, Source: Bing.com



Figure 1-2: West Elevation

## 1.1 - Structural Overview

The JCA sits atop core-drilled concrete piers due to the rather poor soil conditions, all columns coming to bear atop a pier. The floor systems are post-tensioned slabs, with wide-shallow beams running one-way on the typical levels framing into cast-in-place concrete columns. The lateral system consists of five concrete shear walls, which rise continuously to the penthouse level, with some continuing to support the roof.

This building was designed as Occupancy III according to Sheet 1.S001 due to the detaining cells contained.

### Floor Systems

As mentioned previously, the floor systems for the JCA utilize post-tensioning. The economy is achieved by greater span lengths being possible, with thinner slab depths. The typical floor system, which begins on the terrace level and extends to the 5th floor, has both 8" and 9" slab depths, with wide-shallow beams running in the plan NS direction. The beams extend 8" below the slab and are not centered on the column lines, instead offset in plan to allow for the provisions of ACI 318-08 Section 13.2.5 for a drop panel. The bays are essentially uniform in parts of the building, with an alternating long/short/long span pattern. A small portion of the slab on the second level connecting to the existing building is lightweight concrete on metal deck on steel framing.

The penthouse slab is 11" thick due to the larger loads present on this floor. There is an unreducible 150 psf mechanical live load present, as well as a 55 psf green roof dead load in several areas. The mechanical floor also features a 'floating' four inch light weight concrete on metal deck isolation slab, to prevent mechanical equipment vibrations from affecting other parts of the building. The roof slab is 10" and features several large voids. This slab has post tensioned beams 36" x 24" typical for additional span stiffness in lieu of the wide-shallow beams.

## Foundations

Schnabel Engineering performed the geotechnical services on the JCA project. Reports indicated that for the purposes of shallow continuous wall footings the soil has a bearing capacity of 2 ksf, with any unsuitable conditions requiring excavation and replacement with lean concrete. Core-drilled piers ranging in diameter from 2.5' to 7' are located beneath every column and support much of the shallow wall footings. The soil report from Schnabel Engineering indicates that the core drilled piers have an end-bearing capacity of 80 ksf and a skin friction capacity of 800 psf. The slab on grade is 5" thick and reinforced with WWF.

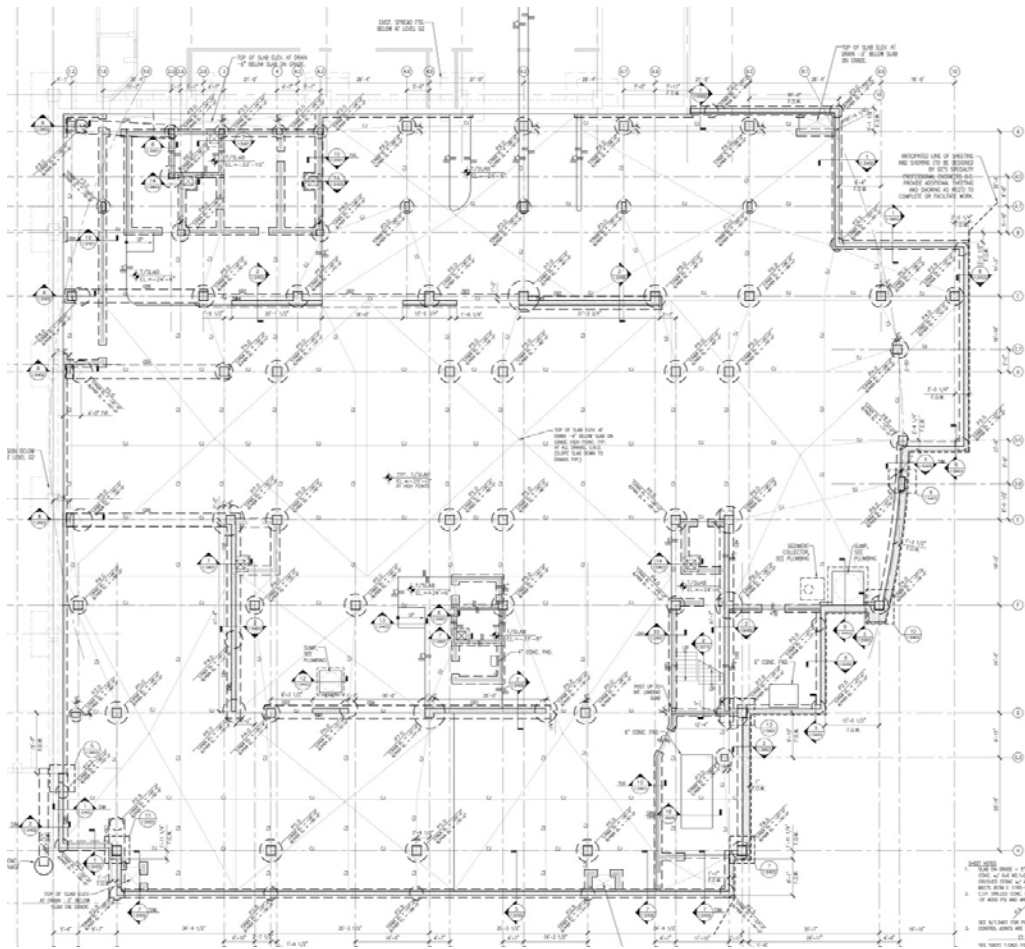


Figure 1.1-1 Foundation Layout



### Framing Systems

Cast-in-place columns rise from the garage level to the roof, with the four lanterns extending the extra fourteen feet with steel framing. The column concrete has a compressive strength of 7000 psi at the base, which is reduced to 5000 psi at level 2. Typical column sizes are 24"x24"

Each lantern has a flat roof framed in structural steel with a slight slope on the edges. HSS tubes make up the columns, with the majority of the framing being small steel shapes with spans in the range of 5' and typical sizes of L3x3x1/4, HSS4x4x1/4, and C6x13. In the center of the roof are several W12x40 girders with a maximum span of 33' that are framed into by smaller wide flange shapes. These heavier shapes are intended to carry the photovoltaic panels mounted on top of the lanterns. Several HSS braced frames provide lateral stability to the lanterns. The lanterns were given a 30 psf dead load in the shaded region to account for the photovoltaic panels.

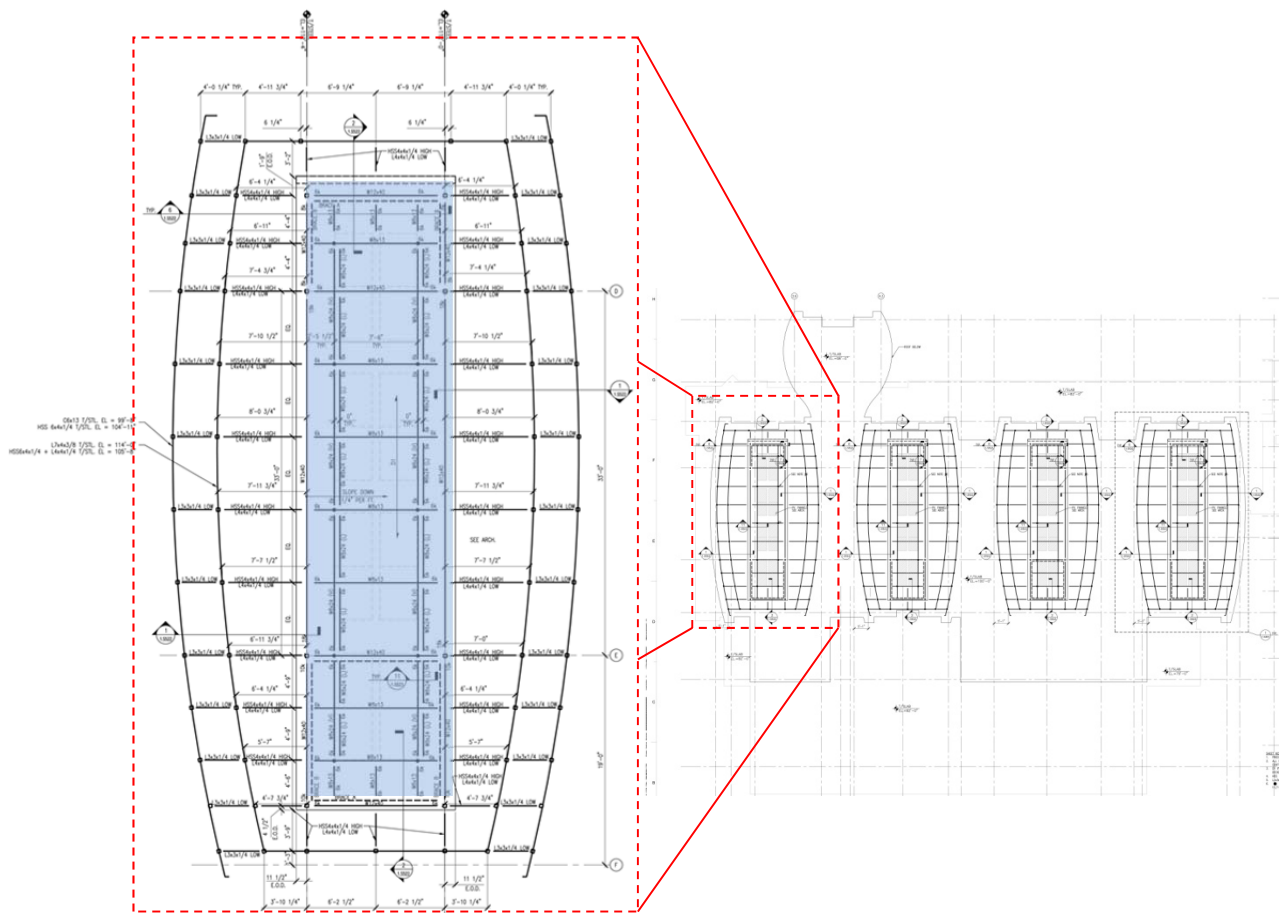


Figure 1.1-2 Lantern Framing Plan

### Lateral System

The main lateral resisting elements of the JCA are the five cast-in-place reinforced concrete shear walls that rise continuously through the building. Analysis performed in Technical Report 3 showed that the concrete frames also had a significant contribution to resisting lateral loads on certain levels, particularly the frames running in the North/South direction and formed by the wide/shallow beams.

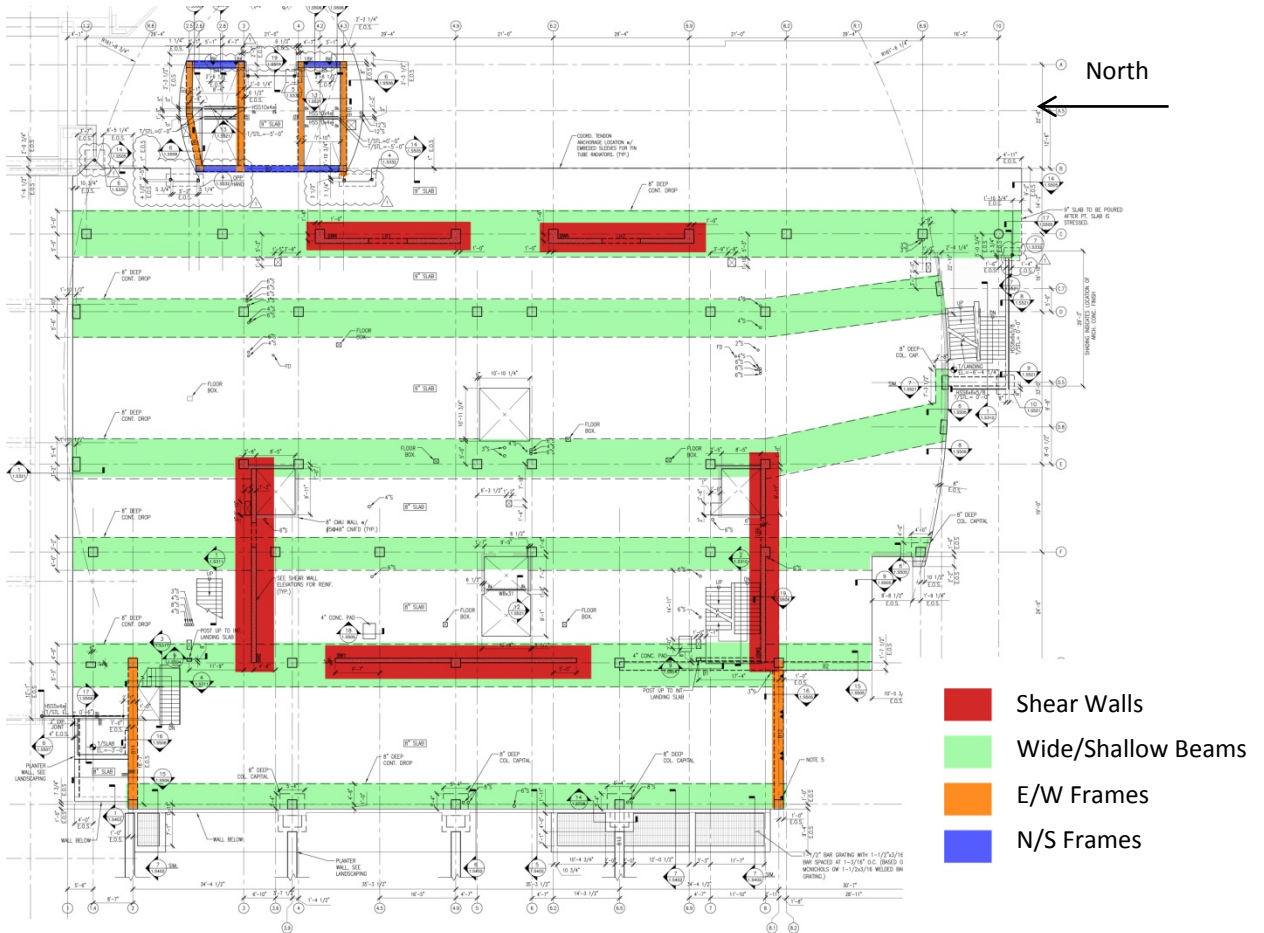


Figure 1.1-3: Lateral Elements

## Roof Systems

The roof varies in height in several locations with the floor slabs described earlier in *Floor Systems*. The varying heights made snow drift a concern, and the large loads associated with the penthouse floor, which is the heaviest floor on the building, add a significant contribution to both seismic base shear and overturning. The green roof and pavers on the penthouse and upper roof levels lay overtop a hot applied fluid membrane.

## Design Codes

The list of Major Codes and Standards on Sheet 1.S001 is as follows:

- 2009 International Building Code
- ACI 318-08
- AISC LRFD, 13<sup>th</sup> Edition, 2005
- AWS D1.1, D1.3, D1.4, Current Edition
- ASTM, Current Edition
- Steel Deck Institute Design Manual for Composite Deck, Form Decks and Roof Decks., 2007
- ASCE 7-05 Minimum Design Loads

## Materials Used

Sheet 1.S001 was used as the reference for materials used in the construction of this project and summarized in Tables 1.1-1.

Concrete		
Usage	Weight	f'c (psi)
Column (Levels 2-Rf)	Normal	5000
Column (Levels G1-1)	Normal	7000
Floor Slab	Normal	5000
Wall Footings	Normal	3000
Beams	Normal	5000
Slab on Grade	Normal	4500
Walls, Piers, & Pilasters	Normal	5000
Drilled Piers	Normal	4000
LW Concrete Fill on Deck	Light	4000
Isolation Slab @ Penthouse	Light	4000
Steel		
Type	TM Standard	Grade
W Shapes	A992	
Plates, Angles, Channels	A36	
High-Strength Bolts	325 or A490	
Anchor Rods	F1554	36
Tubes	A500	B
Pipes	A53 E or S	B
Reinforcing Steel	A615	60
Reinforcing Steel, Welded	A706	60
Roof Deck	A653	A - F
Floor Deck	A653	C, D, or E
Post-Tensioned Reinforcement	A416-96	
Masonry		
Type	TM Standard	F'm (psi)
CMU	C90	1500
Masonry Mortar	C270	
Grout	C476	
Aggregate	C404	

Table 1.1-1 Materials Used

## 1.2 - Gravity Loads

This section will describe how dead, live, and snow loads were calculated and compared to loadings given on the structural drawings. Three gravity checks were performed once the loadings were determined for an interior column, the typical long span for the post tensioned slab, and a doubly reinforced beam with full hand calculations available in Appendix A.

### Dead and Live Loads

The dead loads listed on 1.S001 shown in Figure 7 were used for the purposes of analyses. The non-load-bearing CMU walls were assumed to be fully grouted for the purposes of worst-case load calculations. The weight of the building was calculated neglecting voids in slabs and with an assumption of 10 psf for the steel lantern framing, which would not have much effect on the building weight were it too small an assumption. The total building weight which was used for the seismic calculations was in the order of 28000 kips.

Dead Loads		
	Design	Student
Vegetated Roof	55	55
MEP/Celing	15	15
CMU Partitions	Actual Weight	91 pcf (Fully Grouted Assumption)

Table 1.2-1 Summary of Dead Loads

Based upon ASCE 7-05 the 100 psf typical live load was found to be correct, possibly for different reasons than the designer decided for, and the 40 psf holding cell load was neglected in favor of using the 100 psf live load in all locations except for the mechanical penthouse and the roof loading.

Live Loads		
	Design	ASCE 7-05
Typical	100	80 (Corridor Above First Floor) + 20 (Partition) = 100
Holding Cells	40	-
Mechanical Penthouse	150	150
Roof	-	20

Table 1.2-2 Summary of Live Loads

### Snow Loads

The flat roof snow load was calculated via the method outlined in Chapter 7 of ASCE 7-05. A discrepancy arose as the importance factor, I, listed on the drawings had a value of 1.0, whereas the appropriate importance factor for an Occupancy III building is 1.1. This led to flat roof snow load value of 22 psf which differs from the calculated value of 23.1 psf. Curiously the design load is higher despite the lower importance factor which may be a result of a higher design ground snow load, though this isn't available on the drawings.

Flat Roof Snow Load		
pf = .7 CeCtIpg > 20*I		
Ce	1	ASCE 7-05 Tab. 7-2
Ct	1	ASCE 7-05 Tab. 7-3
pg	25	ASCE 7-05 Fig. 7-1
I	1.1	ASCE 7-05 Tab. 7-4
pf =	0	
20*I =	500	
pf =	22	

The varying roof levels led to eight different drift calculations. Figure 1.2-1 and Table 1.2-4 summarize the snow drift calculations performed.

Table 1.2-3 Snow Load Parameters and Flat Roof Calculation

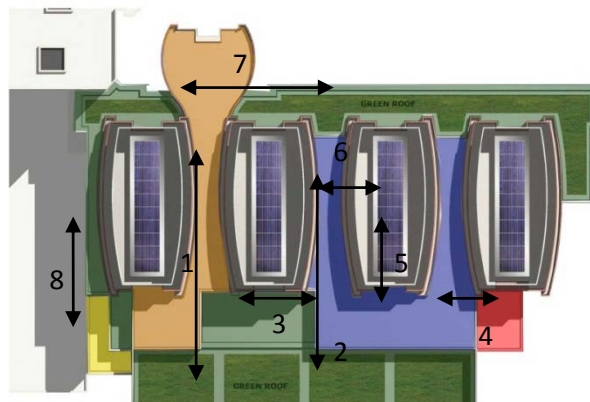


Figure 1.2-1 Roof Snow Drift Diagram

Snow Drift		γ= 17.25								
	Lu	Ll	hc	hd Lee	hd Wind		hd (ft)	w (ft)	Max psf	
Drift 1	130	50	16	3.8	1.8		3.8	3.8	15.2	65.5
Drift 2	93	30.33	18	3.2	1.3		3.2	3.2	13.0	55.9
Drift 3	70	50	18	2.8	1.8		2.8	2.8	11.2	48.5
Drift 4	70	20	21	2.8	1.0		2.8	2.8	11.2	48.5
Drift 5	70	20	14	2.8	1.0		2.8	2.8	11.2	48.5
Drift 6	38	12	14	2.0	0.7		2.0	2.0	8.1	34.8
Drift 7	21	147	16	1.4	3.0		3.0	3.0	12.1	52.0
Drift 8	83	24	52	3.1	1.1		3.1	3.1	12.2	52.8

Table 1.2-4 Snow Drift Calculations

### 1.3 – Lateral Loads

Lateral loads were calculated for the JCA in its existing location Rockville, MD. Wind loads were calculated according to ASCE 7-05 Chapter 6 and seismic forces were calculated according to the provisions in Chapters 11 and 12. The building was modeled in ETABS, a finite element program which provided mode shapes and periods of vibration, which influenced the seismic loading.

Wind Force (NS)								
	Height	Trib Below		Trib Above		Story Force	Story Shear	Overturning Moment
		Ht	Area	Ht	Area			
1st	15	7.5	1125	7	1050.00	36.10	319.31	541.46
2nd	14	7	1050	7.75	1162.50	40.44	283.22	1172.76
3rd	15.5	7.75	1162.5	8.25	1237.50	46.88	242.78	2086.05
4th	16.5	8.25	1237.5	8.25	1237.50	50.83	195.90	3126.21
5th	16.5	8.25	1237.5	8.25	1237.50	53.15	145.07	4172.46
Penthouse	16.5	8.25	1237.5	9.5	1425.00	59.31	91.91	5663.87
Roof	19	9.5	1425	0	0.00	32.61	32.61	3733.42
Base Shear (k)								319.31
Total Overturning Moment (k-ft)								20496.21

Table 1.3-1 Wind Force NS Direction

Wind Force (EW)								
	Height	Trib Below		Trib Above		Story Force	Story Shear	Overturning Moment
		Ht	Area	Ht	Area			
1st	15	7.5	1350	7	1260.00	41.73	371.62	625.92
2nd	14	7	1260	7.75	1395.00	46.91	329.89	1360.46
3rd	15.5	7.75	1395	8.25	1485.00	54.50	282.98	2425.26
4th	16.5	8.25	1485	8.25	1485.00	59.19	228.48	3610.69
5th	16.5	8.25	1485	8.25	1485.00	61.98	169.29	4803.09
Penthouse	16.5	8.25	1485	9.5	1710.00	69.22	107.31	6507.11
Roof	19	9.5	1710	0	0.00	38.09	38.09	4379.98
Base Shear (k)								371.62
Total Overturning Moment (k-ft)								24084.13

Table 1.3-2 Wind Force EW Direction



Seismic Forces N/S (X) Direction						
Level	Story Ht (ft)	Story Weight (k)	Cvx	Story Force (k)	Shear Shear (k)	Overturing Moment (k-ft)
1	15	4421.1	0.031	23.4	755.2	350.6
2	29	4868.4	0.067	50.2	731.8	1457.2
3	44.5	4954.1	0.104	78.6	681.6	3497.7
4	61	4977.9	0.143	108.3	603.0	6607.2
5	77.5	4967.1	0.182	137.3	494.7	10639.3
PentHouse	94	6902.0	0.317	239.1	357.4	22476.6
Roof	113	3078.7	0.157	118.3	118.3	13364.6
Base Shear (k)						755.2
Total Overturing Moment (k-ft)						58393.3

Table 1.3-3 Seismic Forces NS Direction

Seismic Forces E/W (Y) Direction						
Level	Story Ht (ft)	Story Weight (k)	Cvx	Story Force (k)	Shear Shear (k)	Overturing Moment (k-ft)
1	15	4421.1	0.031	18.3	591.5	274.6
2	29	4868.4	0.067	39.4	573.2	1141.4
3	44.5	4954.1	0.104	61.6	533.9	2739.7
4	61	4977.9	0.143	84.8	472.3	5175.2
5	77.5	4967.1	0.182	107.5	387.5	8333.5
PentHouse	94	6902.0	0.317	187.3	279.9	17605.3
Roof	113	3078.7	0.157	92.6	92.6	10468.2
Base Shear (k)						591.5
Total Overturing Moment (k-ft)						45738.0

Table 1.3-4 Seismic Forces EW Direction

Modal Information, JCA Concrete		
Mode	Period	
1	1.24	Y Translational
2	1.20	Z Rotational
3	0.92	X Translational

Table 1.3-5 Modal Information JCA As Designed

## 1.4 –Proposal/Problem Statement

### Structural Depth

The current reinforced concrete building, with post-tensioned floor slabs and cast-in-place shear walls was analyzed in three previous technical reports and found to be adequate in all respects. It is hypothesized however, that with no height restrictions, converting the building to steel would be a competitive solution.

The conversion to steel will mean changing the floor system to concrete on metal deck, employing either the composite metal deck construction with light weight concrete that was explored in Technical Report 2 or a more cost effective deck should one be found. The gravity system will be designed based upon the loading outlined in Technical Report 1, with the initial framing based upon existing locations of columns, though this may need to be adjusted as the design is further developed. Composite steel beams and girders will be used to take advantage of the slab strength so that smaller member sizes can be employed.

After the initial framing has been completed lateral loads will be recalculated using ASCE 7-05 prescribed procedures. Braced frames are proposed to replace the existing reinforced concrete shear walls, acting in their stead as the lateral system of the JCA. As with the columns, the initial trials will use the locations of the shear walls to place the braced frames, to minimize architectural impacts and due to the symmetrical layout that did not have torsion issues as reported in Technical Report 3.

Once both gravity loads and lateral loads have been recalculated the existing foundation system will be investigated to see if it can be reduced to a more efficient solution.

As seismic design is of particular interest to part 2 of the proposal will involve moving the building to San Francisco where it will be in Seismic Design Category D. The system will be kept as steel braced frames and the lateral system will be redesigned for the larger seismic loading.

### **Breadth Study One: Cost and Schedule Analysis**

Breadth One will explore a common question in today's industry, "Concrete or Steel?", by evaluating the impacts that changing the system will have on the overall cost and schedule of building. Often designers will push one concrete and one steel solution deep into the design phase before one ends up being chosen, a scenario being emulated by the Structural Depth. The object here is to see if the redesign will lead to a cheaper, faster to construct building that performs on par with the concrete design, and determine if steel was truly a feasible solution for this project. This depth requires that a schedule be established for both the existing construction and the redesign and that both options be priced based upon their materials, associated construction costs, and schedules; the better option will therefore be based upon which structure is completed quicker and for less cost. The critical path of the building will be reevaluated and the cost impact of schedule days included in the evaluation of both systems.

### **Breadth Study Two: Sustainability**

The JCA has achieved a LEED Gold rating which was in part made possible by the sustainable rooftop features. There is approximately 6000 sq ft of green roof as well as photovoltaic panels on the various levels of the roof. It was thought that perhaps utilizing the entire space for PV panels could prove more beneficial. Therefore a life cycle analysis would be performed on both systems, taking into account payback period, carbon output and other factors.

Additionally a comparison of their LEED impacts would be evaluated as well. Areas of possible improvement in LEED rating not related to the green roof and PV panels would also be explored. A summary of the findings will be provided.

## Chapter 2 – Structural Depth

The Judicial Center Annex is a reinforced concrete structure located in Rockville, MD. As the building is owned by Montgomery County normal height restrictions have been waived and the building features larger than typical floor to floor heights. A typical advantage of concrete construction is the thinner structural framing which allows either for additional floors in a given height or a height reduction for a given number of floors, allowing for more profitable space or less building envelope for the owner of the building.

For this reason it is thought that, despite being an area typically dominated by concrete construction, a design in steel would be a competitive solution. The proposal is therefore to perform a system redesign of the JCA using steel framing. The floor slab will be converted from post-tensioned to a composite slab on metal deck. Gravity members will be designed as composite in an effort to keep the framing shallow. The lateral system which was made of shear walls will be converted to braced frames.

The new structural system is anticipated to be much lighter than the existing system. This makes it likely that wind will control the design which was previously dominated by seismic. As seismic design is of particular interest to the author a further step was proposed for the structural design. The building will be ‘moved’ to San Francisco, CA. The west coast is well known for its greater seismicity, so making this move will result in an exploration into seismic design.

### 2.1 – MD Gravity Design

For this redesign it was attempted to leave the architecture and layout of spaces as unchanged as possible. The structural grid was therefore kept largely unchanged, choosing to keep column locations intact and to work around the existing building. Figure 2.1-1 shows the finalized structural grid with the girders running in the North/South direction. The original thought was that economy could be achieved as the smaller bays on either side of the typical design bay shown in the figure would not require an infill beam and therefore there was the potential for fewer beams. Also of note is that one column was moved and one column was added to the layout as highlighted in Figure 2.1-1. In both cases the architectural plans were checked to ensure that it was possible to do so with little or no impact.

RAM Structural was the primary software used for the design of the gravity system, and with the ability to easily change the framing and determine if the earlier hypothesis was in fact more economical two RAM models were created with girders running in either direction. As hypothesized the N/S girder design was more economical in terms of steel tonnage, though it turns out less pieces were used framing it in the E/W direction. In order to accommodate the 12’ bays with no infill beams the deck selected was 2VLI18 to allow for un-shored construction which would have the potential for cost savings. This was increased to a 3VLI16 for the penthouse level. The gravity design was compared to the typical bay designed by hand as well as a gravity check in ETABS. The numbers were all found to be satisfactorily close. Appendix D contains the hand check.

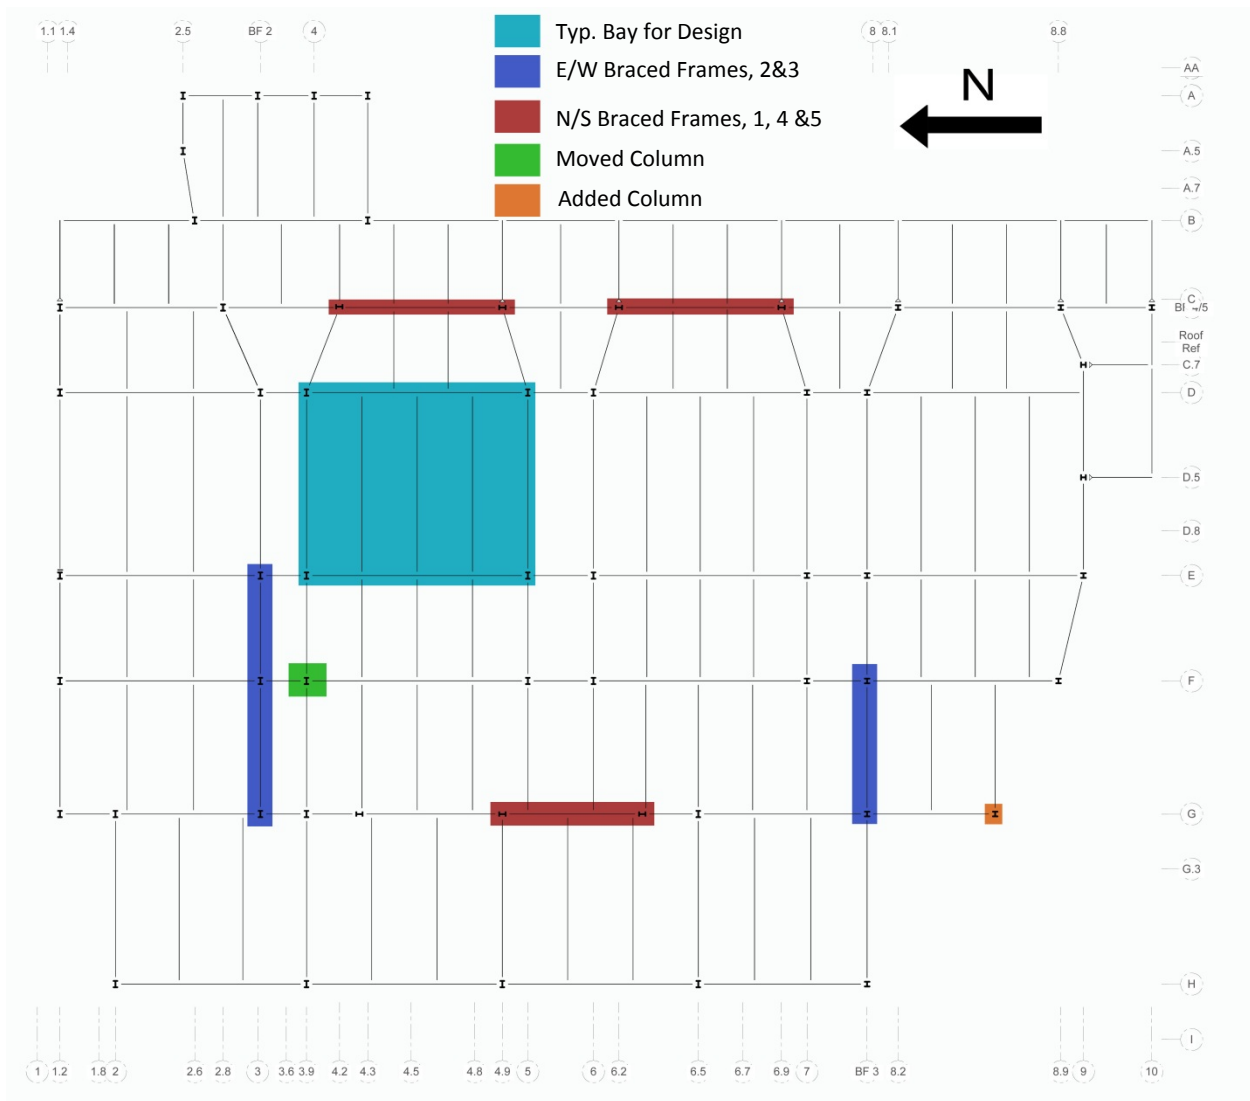


Figure 2.1-1 Steel Gravity System Layout

Typically steel results in larger floor-to-floor heights than concrete due to deeper gravity framing. The steel as designed resulted in some girders and cantilevered beams being as deep as 30" for a typical floor, which combined with the slab led to nearly a 1.5' increase from the concrete framing. Therefore it was important to investigate to the plenum space to determine if a height increase was required. Additionally this is an addition onto an existing building which required the Terrace, 1st, and 2nd levels to remain at the same level. The mechanical and architectural plans were investigated, looking for typical ceiling heights and the largest ductwork. Sections revealed that the deepest ducts rarely surpassed 20" which could be accommodated by the general 4.5' existing plenum even with the increase in member depth. Large duct runs also ran parallel to the girders meaning that the worst case ductwork ran under shallower beams. To ensure that this would not be a problem and to provide more clearance at the garage level beams were limited to W24's. The courtroom spaces on the 3rd through

5th levels, while not featuring large ductwork, were of concern so these levels were increased by 6" each resulting in an overall building height increase of 1.5'.

## 2.2 – MD Lateral System & Foundation Design

The first step of the lateral system redesign was recalculating the lateral wind and seismic loading. As the building system had changed markedly the weight of the structure needed recalculating to determine the new seismic loads. The wind load was also recalculated, though the 1.5' increase in height did not make a large difference. The terrace level was used as the seismic base.

### Seismic

The weight of the building was recalculated to approximately 15500 kips. This meant that the building mass affecting the seismic forces had changed from approximately 160 psf to 80 psf. The Equivalent Lateral Force Procedure as detailed in ASCE7-05 section 12.8 was used to calculate story forces that would represent the inertial response of the building due to seismic loading. The seismic parameters are shown in Table 2.2-1 and the story forces and shears are shown in Table 2.2-2.

Seismic Design Parameters		
I	1.25	
R	3	
SDs	0.1664	
SD1	0.0816	
Ct	0.02	
x	0.75	
hn	114	
Ta	0.707	
Cu	1.7	
T	1.202	
	SDS/(R/I)	SD1/(T(R/I))
Cs	0.069	0.028
W (kips)	15448	
V (kips)	437	

Table 2.2-1 Seismic Design Parameters

Seismic Forces, Both Directions						
Level	Story Ht (ft)	Story Weight (k)	Cvx	Story Force (k)	Shear Shear (k)	Overturning Moment (k-ft)
1	15	2133.8	0.033	14.5	441.3	218.1
2	29	2130.8	0.064	28.1	426.8	813.7
3	44.5	2177.3	0.100	44.1	398.7	1962.1
4	61.5	2207.1	0.140	61.9	354.6	3804.1
5	78.5	2207.1	0.179	79.0	292.8	6197.9
PentHouse	95.5	3207.8	0.328	144.9	213.8	13839.7
Roof	114.5	1383.7	0.156	68.9	68.9	7889.9
					Base Shear (k)	441.3
					Total Overturning Moment (k-ft)	34725.6

Table 2.2-2 Seismic Story Forces and Story Shears

**Wind**

Method 2 of the Main Wind Force Resisting System (MWRFS) procedure detailed in ASCE7-05 chapter 6 was used to calculate the wind forces the building would see. The building was idealized as a rectangle for simplicity and the lanterns were excluded from the calculation as they represent a relatively small area compared to the rest of the building. Tables 2.2-3 through 2.2-8 summarize the wind calculations.

Wind Load Criteria		
Gcpi	0.18	ASCE 7-05 Fig. 6-5
Exposure	B	ASCE 7-05 6.5.6.3
V	90 mph	ASCE 7-05 Fig. 6-1C
I	1.15	ASCE 7-05 Tab 6-1
Kzt	1	ASCE 7-05 6.5.7.1
Kd	0.85	ASCE 7-05 Fig. 6-4

Table 2.2-3 Wind Load Criteria

Velocity Pressure Coefficients (Kz) and Velocity Pressures (qz)			
	Height	Kz	qz
1st	15	0.570	11.55
2nd	29	0.692	14.03
3rd	44.5	0.783	15.87
4th	61.5	0.856	17.35
5th	78.5	0.924	18.73
Penthouse	95.5	0.982	19.90
Roof	114.5	1.026	20.80

Table 2.2-4 Kz and qz Values



Design Wind Pressure N/S							
	Distance	Wind Pressure	Internal Pressure		Net Pressure		
			(+) Gcpi	(-) Gcpi	(+) Gcpi	(-) Gcpi	
Windward	1st	15	7.86	3.74	-3.74	4.11	11.60
	2nd	29	9.54	3.74	-3.74	5.79	13.28
	3rd	44.5	10.79	3.74	-3.74	7.05	14.54
	4th	61.5	11.80	3.74	-3.74	8.06	15.54
	5th	78.5	12.74	3.74	-3.74	8.99	16.48
	Penthouse	95.5	13.54	3.74	-3.74	9.79	17.28
	Roof	114.5	14.14	3.74	-3.74	10.40	17.88
Leeward	All	-	-8.74	3.74	-3.74	-12.48	-5.00
Side Walls	All	-	-12.24	3.74	-3.74	-15.98	-8.50
Roof		0 - 50	-18.19	3.74	-3.74	-21.93	-14.45
		> 50	-14.55	3.74	-3.74	-18.29	-10.81

Table 2.2-5 Design Wind Pressure in the North/South Direction

Design Wind Pressure E/W							
	Distance	Wind Pressure	Internal Pressure		Net Pressure		
			(+) Gcpi	(-) Gcpi	(+) Gcpi	(-) Gcpi	
Windward	1st	15	7.86	3.74	-3.74	4.11	11.60
	2nd	29	9.54	3.74	-3.74	5.79	13.28
	3rd	44.5	10.79	3.74	-3.74	7.05	14.54
	4th	61	11.80	3.74	-3.74	8.06	15.54
	5th	77.5	12.74	3.74	-3.74	8.99	16.48
	Penthouse	94	13.54	3.74	-3.74	9.79	17.28
	Roof	115	14.14	3.74	-3.74	10.40	17.88
Leeward	All	-	-8.13	3.74	-3.74	-11.87	-4.39
Side Walls	All	-	-12.37	3.74	-3.74	-16.12	-8.63
Roof		0 - 50	-16.76	3.74	-3.74	-20.50	-13.01
		> 50	-15.49	3.74	-3.74	-19.23	-11.74

Table 2.2-6 Design Wind Pressure in the North/South Direction

Wind Force (NS)								
	Height	Trib Below		Trib Above		Story Force	Story Shear	Overturning Moment
		Ht	Area	Ht	Area			
1st	15	7.5	1125	7	1050.00	36.10	324.03	541.46
2nd	14	7	1050	7.75	1162.50	40.44	287.94	1172.76
3rd	15.5	7.75	1162.5	8.5	1275.00	47.61	247.50	2118.64
4th	17	8.5	1275	8.5	1275.00	52.37	199.89	3220.94
5th	17	8.5	1275	8.5	1275.00	54.76	147.51	4298.90
Penthouse	17	8.5	1275	9.5	1425.00	60.14	92.75	5743.64
Roof	19	9.5	1425	0	0.00	32.61	32.61	3733.42
							Base Shear (k)	324.03
							Total Overturning Moment (k-ft)	20829.75

Table 2.2-7 Wind Story Forces and Story Shears in the North/South Direction

Wind Force (EW)								
	Height	Trib Below		Trib Above		Story Force	Story Shear	Overturning Moment
		Ht	Area	Ht	Area			
1st	15	7.5	1350	7	1260.00	41.73	377.12	625.92
2nd	14	7	1260	7.75	1395.00	46.91	335.39	1360.46
3rd	15.5	7.75	1395	8.5	1530.00	55.35	288.48	2463.15
4th	17	8.5	1530	8.5	1530.00	60.99	233.13	3720.11
5th	17	8.5	1530	8.5	1530.00	63.85	172.14	4948.63
Penthouse	17	8.5	1530	9.5	1710.00	70.20	108.29	6598.76
Roof	19	9.5	1710	0	0.00	38.09	38.09	4379.98
							Base Shear (k)	377.12
							Total Overturning Moment (k-ft)	24474.13

Table 2.2-8 Wind Story Forces and Story Shears in the East/West Direction

The seismic forces were still found to generate a higher un-factored base shear. It can be seen though that the strength design of the structure will in general be controlled by the wind forces. Seismic will likely control drift as it will be modified by  $C_d/I$  and drift due to wind can be reduced by a factor of 0.7 according to ASCE7-05 load combination CC-3.

### Braced Frame Design

As shear walls were previously used these same spaces would easily be able to accommodate a concentrically braced frame. A concentrically braced frame is a system in which the members resist lateral loads in the elastic range primarily through axial forces in the members. The members are connected with little or no eccentricity which creates a very stiff and efficient system. As the JCA was located in Seismic Design Category B the frames were designed as Ordinary Concentrically Braced Frames (OCBF) with an  $R = 3$  to avoid special detailing requirements.

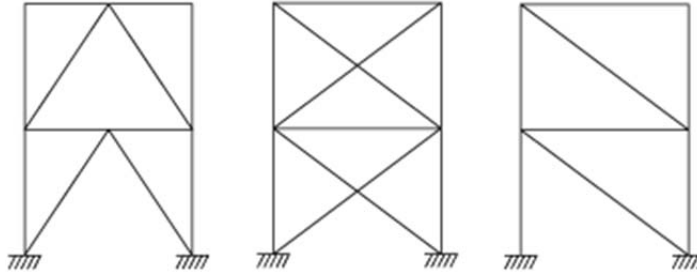


Figure 2.2-1 Concentrically Braced Frame Configurations, Source: structuremag.org

Before modeling the building in ETABS, preliminary layouts and sizes were determined. Sizes were found assuming a percentage of the base shear that frame would see and assuming the brace would take all of the force. Braced frames 4 and 5 had a central doorway on almost every level which necessitated the usage of an inverted V, or Chevron, configuration to accommodate this. The chevron configuration was explored for the other braced frames as well. The initial thought was the shorter unbraced length of the column would prove beneficial in increasing  $F_{cr}$  and the capacity of the bracing members. However, the larger angle caused the axial component of the shear that the brace would experience to be much larger in the chevron configuration which negated this previous advantage. The chevron would also mean an additional piece which would require connections for both ends which would drive the cost up. Table 2.2-9 shows a frame that is representative of previously described comparison. Braced members were chosen to be square HSS tubes whenever possible. Their shape makes them efficient in compression because they have no weak axis and are easy to connect.

Brace Configuration Comparison						
	Member	Wt	L	Connections	Pieces	Equivalent Wt.
Chevron	HSS7x7x3/8	32.6	42.8	4	2	2195
Diagonal	HSS8x8x1/2	48.8	31.1	2	1	1918

Table 2.2-9 BF 1, Story 5 Brace Economy Comparison  
 \*Note: Connection assumed equivalent to 200lbs of steel

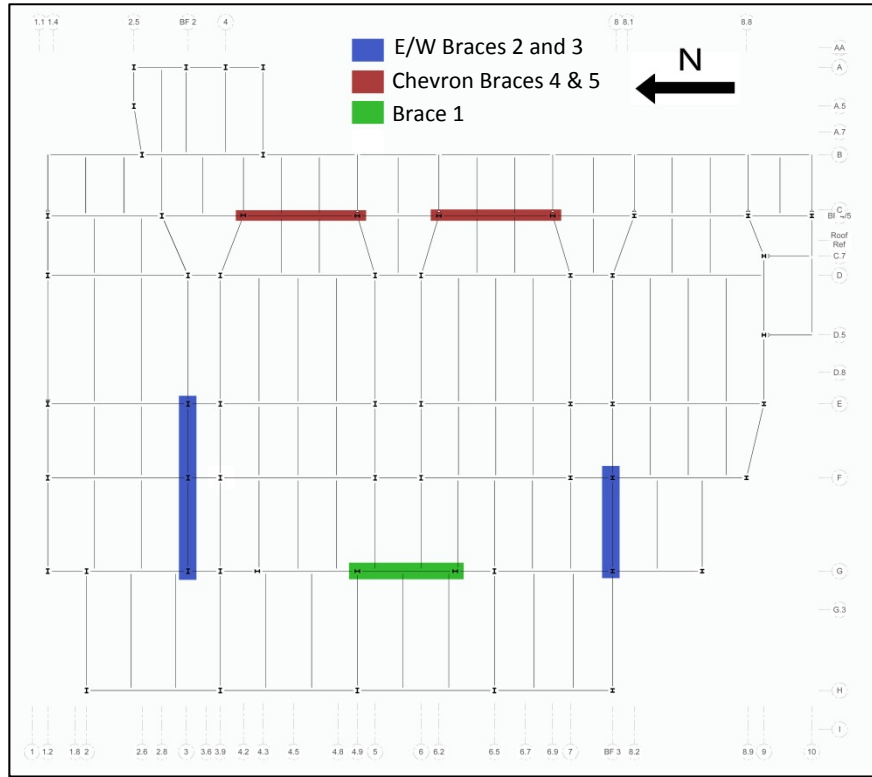


Figure 2.2-2 BF Layout

ETABS, a finite element program, was used to model the structural system. Only the lateral system was modeled, which is an acceptable simplification. Centerline modeling was used and since connections were modeled as pinned (no moment frames) Panel Zones were not explicitly modeled and a rigid end offset factor was kept as 0. The diaphragms were modeled as rigid and the mass of each story was assumed lumped at the respective diaphragm. The X-direction in the model corresponds to the N/S direction in plan.

MD Modes and Participating Mass				
Mode	Period	UX	UY	
1	2.61	3.67	59.94	Y-Translational
2	2.45	35.82	8.69	Z-Rotational
3	2.02	32.10	0.23	X-Translational

Table 2.2-10 Mode Shapes and Participating Mass

Table 2.2-10 shows the building period for the first three modes. The number seems unusually high which may be a result of a very flexible system. As the periods for the motion in both the X and Y directions were found to be greater than  $C_u \cdot T_a$  the seismic forces required no adjustment.

The initial sizes were downsized as much as the strength design would allow, but drifts still easily passed the requirements. Tables 2.2-11 through 14 show the worst case seismic and wind drift for both directions.

QCXE								
Story	Height	$\delta_{xe}$	$\delta_{ye}$	Amplified by Cd/I		$\Delta x$	$\Delta y$	$\Delta a = .015sx$
				$\delta_x$	$\delta_y$			
Roof	19.50	2.56	-	6.66	-	1.38	-	3.51
Penthouse	18.50	2.03	-	5.28	-	1.07	-	3.33
Level 5	18.00	1.62	-	4.21	-	1.07	-	3.24
Level 4	18.00	1.21	-	3.15	-	1.07	-	3.24
Level 3	17.00	0.80	-	2.08	-	0.88	-	3.06
Level 2	15.50	0.46	-	1.20	-	0.73	-	2.79
Level 1	16.60	0.18	-	0.47	-	0.42	-	2.99
Terrace	11.50	0.02	-	0.05	-	0.05	-	2.07

Table 2.2-11 Deflection and Story Drift Due to Seismic Forces Applied in the N/S + Eccentricity

QCY								
Story	Height	$\delta_{xe}$	$\delta_{ye}$	Amplified by Cd/I		$\Delta x$	$\Delta y$	$\Delta a = .015sx$
				$\delta_x$	$\delta_y$			
Roof	19.50	-	2.70	-	7.02	-	1.22	3.51
Penthouse	18.50	-	2.23	-	5.80	-	1.27	3.33
Level 5	18.00	-	1.74	-	4.52	-	1.30	3.24
Level 4	18.00	-	1.24	-	3.22	-	1.17	3.24
Level 3	17.00	-	0.79	-	2.05	-	1.01	3.06
Level 2	15.50	-	0.40	-	1.04	-	0.73	2.79
Level 1	16.60	-	0.12	-	0.31	-	0.26	2.99
Terrace	11.50	-	0.02	-	0.05	-	0.05	2.07

Table 2.2-12 Deflection and Story Drift Due to Seismic Forces Applied Directly in the E/W Direction

WC2XEA						
Story	Height	$\delta_{xw}$	$\delta_{yw}$	$\Delta x$	$\Delta y$	$\Delta a = H/400$
Roof	19.50	1.88	-	0.38	-	
Penthouse	18.50	1.5	-	0.28	-	0.56
Level 5	18.00	1.22	-	0.29	-	0.54
Level 4	18.00	0.93	-	0.29	-	0.54
Level 3	17.00	0.64	-	0.27	-	0.51
Level 2	15.50	0.37	-	0.21	-	0.47
Level 1	16.60	0.16	-	0.15	-	0.50
Terrace	11.50	0.01	-	0.01	-	0.35

Table 2.2-13 Deflection and Story Drift Due to Wind Forces: Wind Case 2 N/S Direction, Positive Eccentricity

WC2YEB						
Story	Height	$\delta_{xw}$	$\delta_{yw}$	$\Delta x$	$\Delta y$	$\Delta a = H/400$
Roof	19.50	-	2.49	-	0.43	
Penthouse	18.50	-	2.06	-	0.44	0.56
Level 5	18.00	-	1.62	-	0.42	0.54
Level 4	18.00	-	1.20	-	0.41	0.54
Level 3	17.00	-	0.79	-	0.38	0.51
Level 2	15.50	-	0.41	-	0.28	0.47
Level 1	16.60	-	0.13	-	0.12	0.50
Terrace	11.50	-	0.01	-	0.01	0.35

Table 2.2-14 Deflection and Story Drift Due to Wind Forces: Wind Case 2 E/W Direction, Negative Eccentricity

### Foundations

Because the system was significantly lighter a foundation redesign was considered. The Geotech report provided by Schnabel Engineering, Inc. gave an end-bearing value of 80 ksf for the core drilled piers, as well as a skin friction value of 800 psf. These allowances were assumed to already account for a Factor of Safety. The gravity column loading from RAM and the lateral loads on the columns integrated into the braced frames were then used to re-size the core drilled piers, with a minimum diameter of 2.5' per Schnabel's recommendation. The pier sizing is shown in Appendix H.

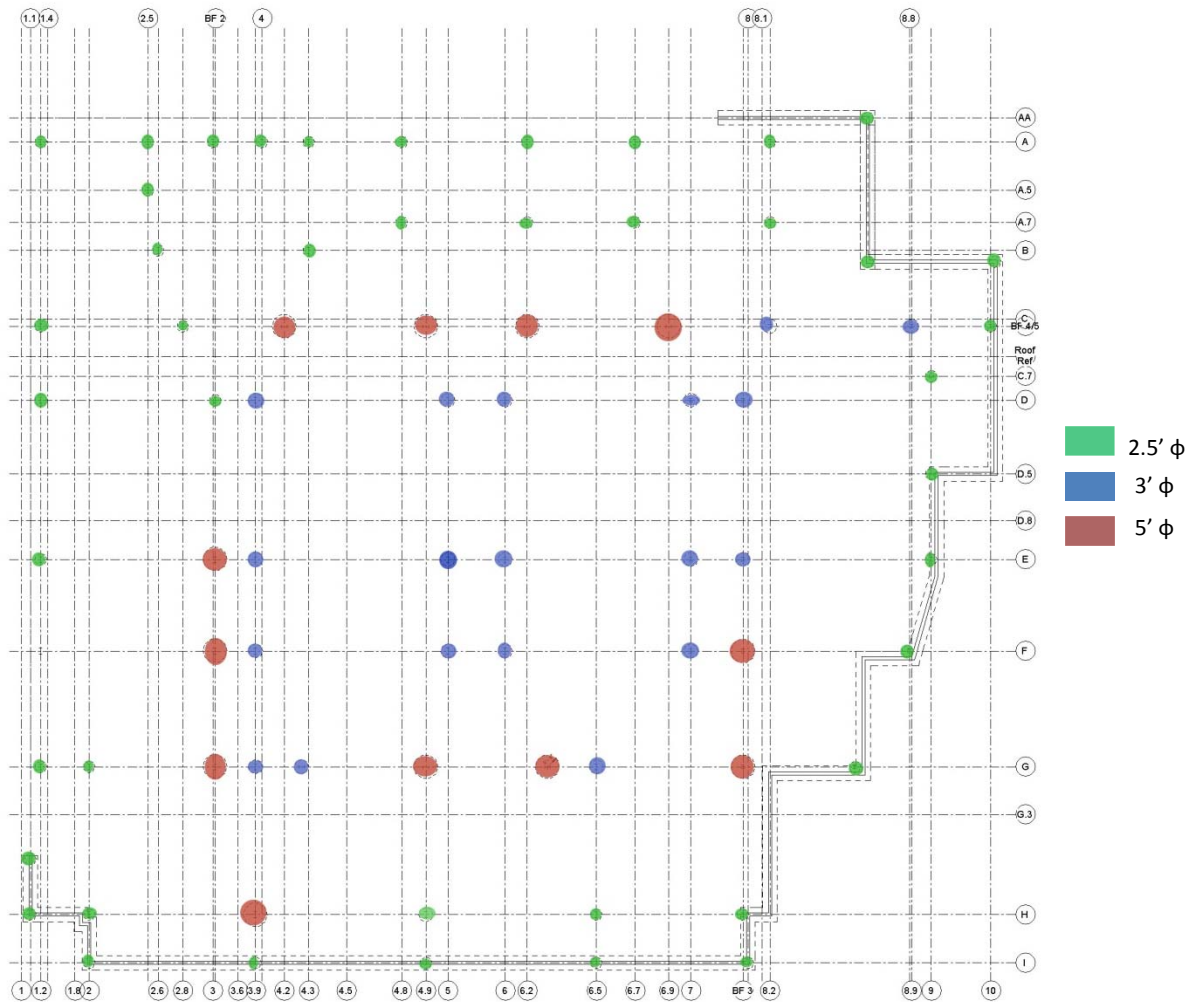


Figure 2.2-3 Core Drilled Pier Sizes and Locations



**Summary**

The braced frames were able to adequately replace the former shear wall system. Torsional irregularities were not considered in the scope of the first part of this depth as it is not required in SDC B. The weight in steel of the redesign came in at 9.9 lbs/sq ft, with 15% of that accounted for by the lateral system. Figures 2.2-5 through 2.2-8 show the elevations of the braced frames with the sections.

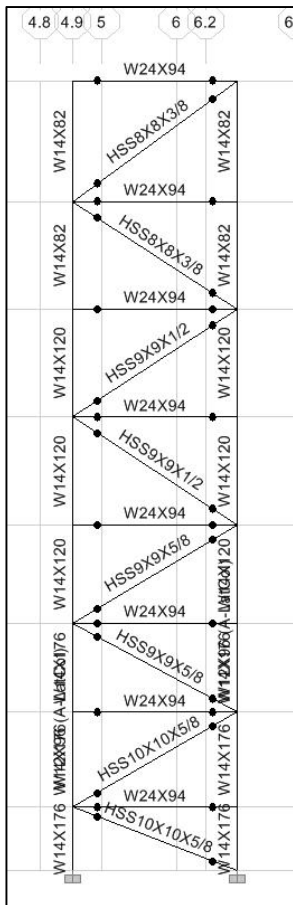


Figure 2.2-4 BF 1

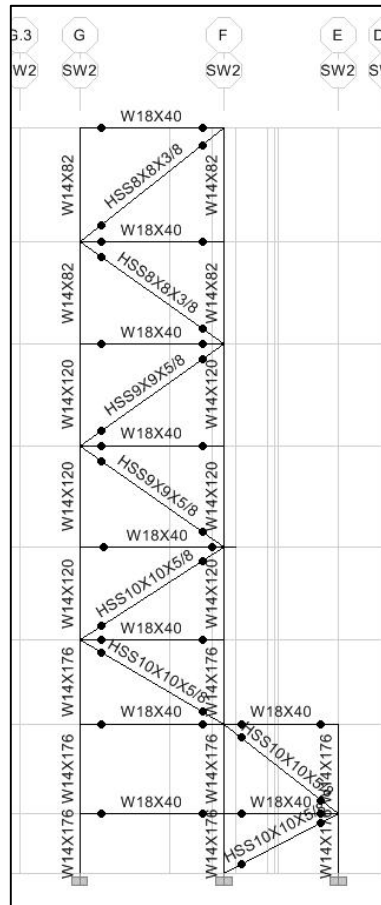


Figure 2.2-5 BF 2

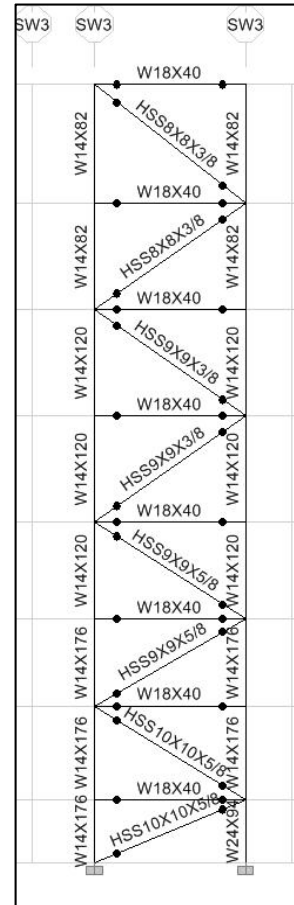


Figure 2.2-6 BF 3

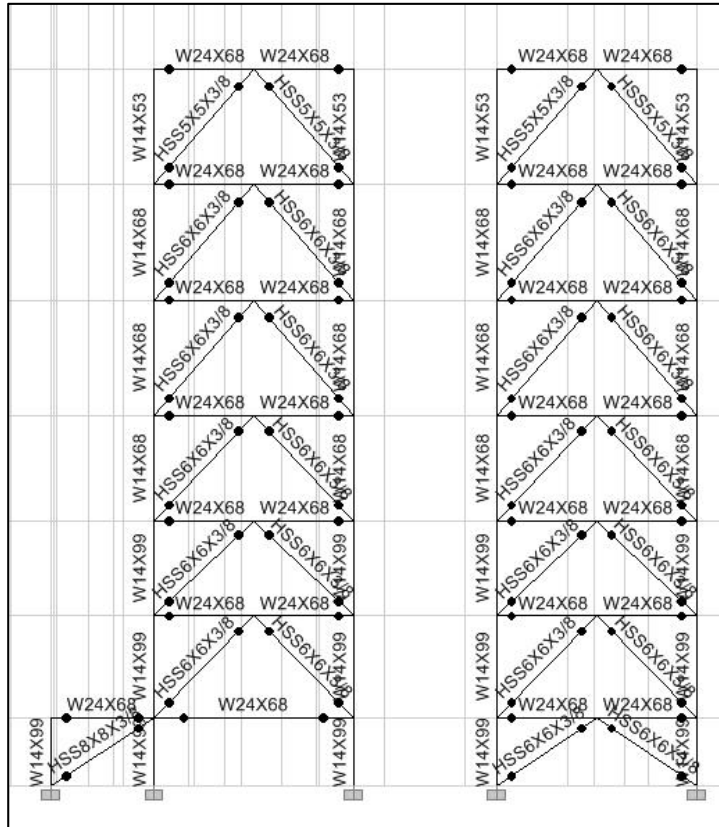


Figure 2.2-8 BF 4 & 5

## 2.3 – CA Lateral Design, Layout 1

The second phase to be investigated for the structural depth is the move to a region of greater seismicity, which in this case was arbitrarily chosen as San Francisco. Assuming Site Class D the Seismic Design Category increased from B to D. The change in SDC results in a host of provisions from ASCE7-05 needing accounted for that did not previously apply.

One such factor is  $\rho$ , the redundancy factor, which drove the seismic exploration. ASCE7-05 section 12.3.4.2 requires that the horizontal and vertical seismic load effects be multiplied by 1.3 unless stories which resist more than 35% of the base shear do not face a 33% strength reduction by the removal of an individual brace or develop an extreme torsion irregularity due to this removal. The current layout would not have a chance of earning this as in the East/West direction there are two frames, so removing one brace would drop the strength by 50%. To remedy this frames would be added in an effort to keep  $\rho = 1$ , but for comparison purposes the braces would be sized using the layout from Rockville initially.

### Seismic

The move to SDC D resulted in a large markup in seismic forces as seen in Table 2.3-1. This also meant that the OCBF could not be utilized and the system would need to be changed to a Special Concentrically Braced Frame, SCBF, which results in an  $R=6$ . The cost of the increased ductility comes in the form of special detailing requirements and seismic provisions that will be discussed more during the frame design section.

Seismic Design Parameters		
I	1.25	
R	6	
SDs	1	
SD1	0.6	
Ct	0.02	
x	0.75	
hn	114	
Ta	0.70	
Cu	1.7	
T	1.19	
	SDS/(R/I)	SD1/(T(R/I))
Cs	0.208	0.105
W (kips)	15448	
V (kips)	1623	

Table 2.3-1 Seismic Parameters

Due to the large loading it was thought prudent to invoke ASCE7-05 section 12.9 and perform a Modal Response Spectrum Analysis. The number of modes used was dictated by having over 90% modal mass participation in both directions. Section 11.4.5 was used to determine the design spectrum as shown in Figure 2.3-1, and the response parameters were combined using square root of the sum squares method, which is included in Appendix J. The resultant base shear in both directions was limited to a reduction of 85% of the base shear calculated using the Equivalent Lateral Force Procedure. Table 2.3-2 shows the revised lateral forces the building experiences do to seismic response.

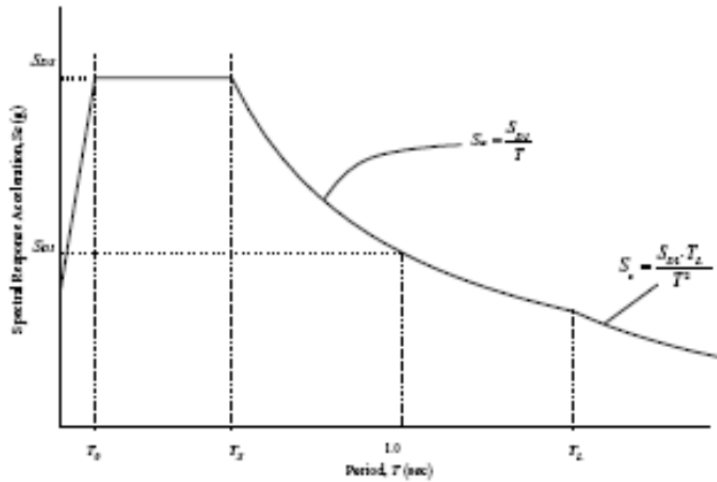


Figure 2.3-1 Design Response Spectrum, ASCE7-05

Seismic Forces, Both Directions						
Level	Story Ht (ft)	Story Weight (k)	Cvx	Story Force (k)	Shear Shear (k)	Overtuning Moment (k-ft)
1	15	2133.8	0.033	45.6	1383.7	683.7
2	29	2130.8	0.064	88.0	1338.1	2551.3
3	44.5	2177.3	0.100	138.2	1250.1	6151.7
4	61.5	2207.1	0.140	193.9	1111.9	11927.0
5	78.5	2207.1	0.179	247.5	917.9	19432.1
PentHouse	95.5	3207.8	0.328	454.4	670.4	43391.3
Roof	114.5	1383.7	0.156	216.0	216.0	24737.0
Base Shear (k)						1383.7
Total Overtuning Moment (k-ft)						108874.1

Table 2.3-2 Seismic Parameters

## Wind

The design wind velocity for California is reduced from 90 mph to 85 mph. As the geometry of the building is assumed unaffected by the move this resulted in seismic controlling both strength and drift design by a large margin. The design wind forces can be seen in Tables 2.3-3 and 2.3-4.

Wind Force (EW)								
	Height	Trib Below		Trib Above		Story Force	Story Shear	Overturning Moment
		Ht	Area	Ht	Area			
1st	15	7.5	1350	7	1260.00	37.22	336.38	558.31
2nd	14	7	1260	7.75	1395.00	41.84	299.16	1213.49
3rd	15.5	7.75	1395	8.5	1530.00	49.37	257.31	2197.07
4th	17	8.5	1530	8.5	1530.00	54.40	207.94	3318.24
5th	17	8.5	1530	8.5	1530.00	56.96	153.54	4414.06
Penthouse	17	8.5	1530	9.5	1710.00	62.62	96.59	5885.93
Roof	19	9.5	1710	0	0.00	33.97	33.97	3906.84
Base Shear (k)								336.38
Total Overturning Moment (k-ft)								21830.32

Table 2.3-3 Wind Forces, EW Direction

Wind Force (NS)								
	Height	Trib Below		Trib Above		Story Force	Story Shear	Overturning Moment
		Ht	Area	Ht	Area			
1st	15	7.5	1125	7	1050.00	34.25	304.18	513.77
2nd	14	7	1050	7.75	1162.50	38.16	269.93	1106.65
3rd	15.5	7.75	1162.5	8.5	1275.00	44.77	231.77	1992.18
4th	17	8.5	1275	8.5	1275.00	49.12	187.00	3021.06
5th	17	8.5	1275	8.5	1275.00	51.25	137.88	4023.50
Penthouse	17	8.5	1275	9.5	1425.00	56.20	86.62	5366.63
Roof	19	9.5	1425	0	0.00	30.43	30.43	3484.16
Base Shear (k)								304.18
Total Overturning Moment (k-ft)								19507.97

Table 2.3-4 Wind Forces, NS Direction

## Braced Frame Design

As before preliminary sizes were chosen on assuming a frame stiffness and sizing the braces for the entire story shear that brace would potentially see. As braced frames are now SCBF other provisions applied per AISC 341-05: Seismic Provisions for Structural Steel Buildings. Several provisions in particular are of note.

- 13.2a Slenderness – Bracing members shall have  $Kl/r \leq 4\sqrt{E/F_y}$ 
  - This meant that the largest HSS shape possible was a 12x12x5/8 and that W Shapes would need employed
- 13.3 Required Strength of Bracing Connections

$$Tensile Str = R_y F_y A_g \quad Compr Str = 1.1 R_y P_n \quad Flexural Str = 1.1 R_y M_p$$

- In a SCBF system the energy dissipation is assumed to occur through tensile yielding and buckling of the bracing members, whilst the rest of the system remains elastic. To achieve this connections must be designed to withstand larger forces than in an OCBF
- 13.4a Inverted V-Type Bracing – For loading acting on the member

$$Brace Tensile Str = R_y F_y A_g, Compr Str = 0.3 P_n$$

- Inverted V-Type connections are typically avoided in seismic regions due to the unbalanced compression and tensile forces that are developed in the braces. This causes potentially damage due to large midspan deflections unless properly accounted for. As a result the beam must be oversized to deal with this unbalanced load and can become extremely large, negatively affecting the building in terms of framing depth and cost of steel.

Unlike Maryland, the chevron configuration is extremely undesirable in this higher SDC. Due to the geometry however, the chevrons were kept in braced frames 4 & 5. The beam was sized and the brace to beam connection designed based upon the above factors to satisfy MAE requirements. Figure 2.3-2 shows the connection details.

Strength design drove the member sizes initially as the redundancy factor led the braces to see 30% more force. Once strength design was found adequate the building was checked for torsional irregularities. Table 12.3-2 of ASCE7-05 defines a torsional irregularity as when the maximum story drift of a level exceeds 1.2 times the average. Initial findings denoted that the design was irregular. This invoked section 12.12.1 which stated that the story drift now had to be taken as the largest different between the edges at the top and bottom of the story under consideration rather than the center of the diaphragm. Drift levels failed considerably at this point, and an effort was made to control the torsion such that the center of the diaphragm displacements could be considered for story drift. The end story drifts are summarized in Table 2.3-5 and 2.3-6.

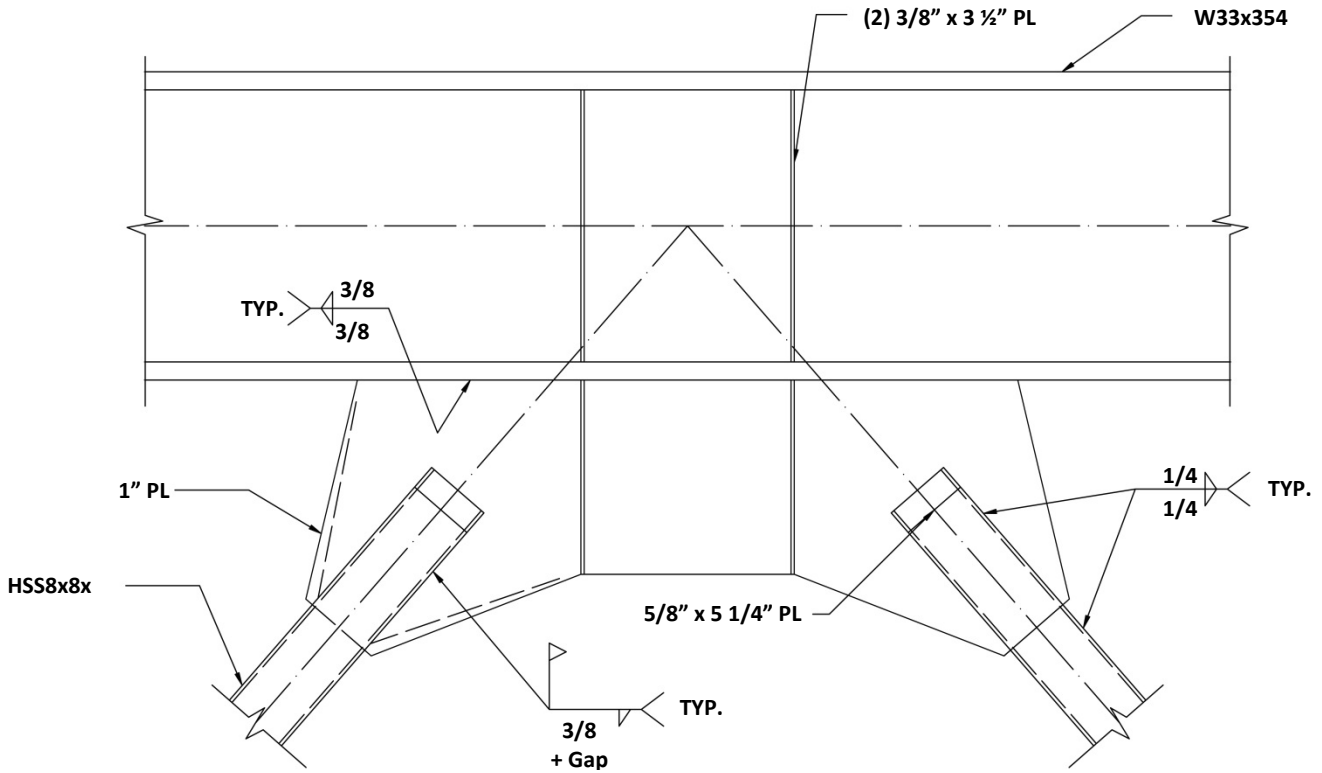


Figure 2.3-2 Designed Chevron SCBF Brace to Beam Connection

Torsional Irregularity X Direction									
Story	$\delta_{max}$	$\delta_{min}$	$\delta_{avg}$	$\delta_{max}/\delta_{avg}$	$\Delta_1$	$\Delta_2$	$\Delta_{avg}$	$\Delta_{max}/\Delta_{avg}$	$A_x$
Roof	4.53	3.13	3.83	1.18	0.84	0.69	0.77	1.1	0.97
Penthouse	3.69	2.44	3.065	1.20	0.79	0.50	0.65	1.2	1.01
Level 5	2.9	1.94	2.42	1.20	0.78	0.51	0.65	1.2	1.00
Level 4	2.12	1.43	1.775	1.19	0.74	0.50	0.62	1.2	0.99
Level 3	1.38	0.93	1.155	1.19	0.58	0.39	0.49	1.2	0.99
Level 2	0.8	0.54	0.67	1.19	0.45	0.31	0.38	1.2	0.99
Level 1	0.35	0.23	0.29	1.21	0.35	0.23	0.29	1.2	1.01

Table 2.3-5 Torsional Irregularity Check X Direction

Torsional Irregularity Y Direction									
Story	$\delta_{max}$	$\delta_{min}$	$\delta_{avg}$	$\delta_{max}/\delta_{avg}$	$\Delta 1$	$\Delta 2$	$\Delta_{avg}$	$\Delta_{max}/\Delta_{avg}$	
Roof	5.31	4.38	4.845	1.10	0.97	0.85	0.91	1.1	0.83
Penthouse	4.34	3.53	3.935	1.10	0.95	0.82	0.89	1.1	0.84
Level 5	3.39	2.71	3.05	1.11	0.95	0.82	0.89	1.1	0.86
Level 4	2.44	1.89	2.165	1.13	0.85	0.75	0.80	1.1	0.88
Level 3	1.59	1.14	1.365	1.16	0.69	0.59	0.64	1.1	0.94
Level 2	0.9	0.55	0.725	1.24	0.51	0.25	0.38	1.1	1.07
Level 1	0.39	0.3	0.345	1.13	0.39	0.30	0.35	1.1	0.89

Table 2.3-6 Torsional Irregularity Check Y Direction

### Summary

Difficulties controlling story drift resulted in very large members. The virtual work feature embedded within ETABS indicated that the lower story columns contributed the most and therefore these were typically targeted rather than upsizing the braces adequate for strength conditions. To accommodate the new seismic forces the weight of steel in the lateral system increased by a factor of 2.2, bringing the weight of steel per square foot in the building to 11.7 lbs.

Modal Information, CA Layout 1				
Mode	Period	UX	UY	
1	1.75	0.10	68.14	Y Translational
2	1.55	34.61	0.35	Z Rotational
3	1.39	37.30	0.02	X Translational

Table 2.3-7 Modal Information



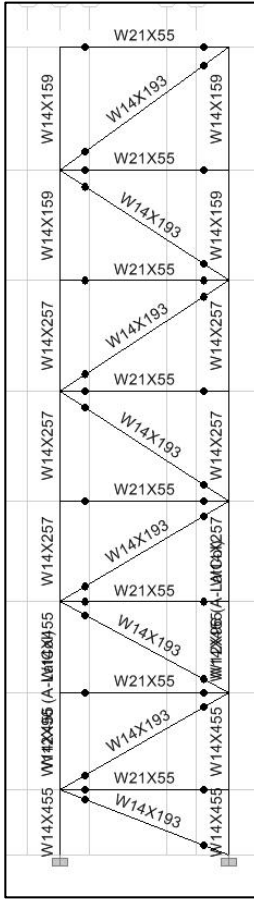


Figure 2.3-3 BF 1

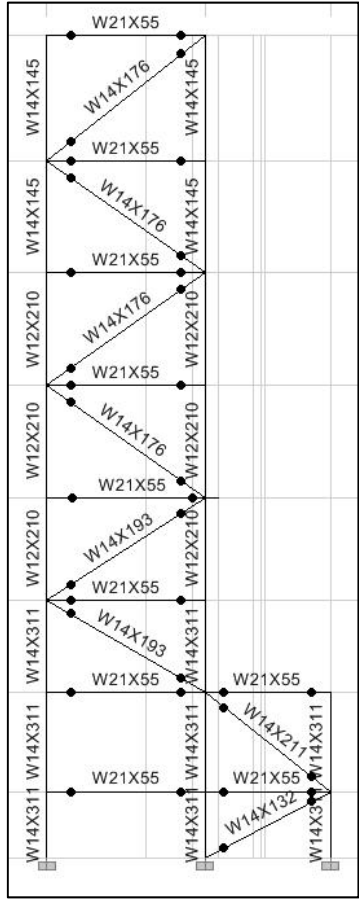


Figure 2.3-4 BF 2

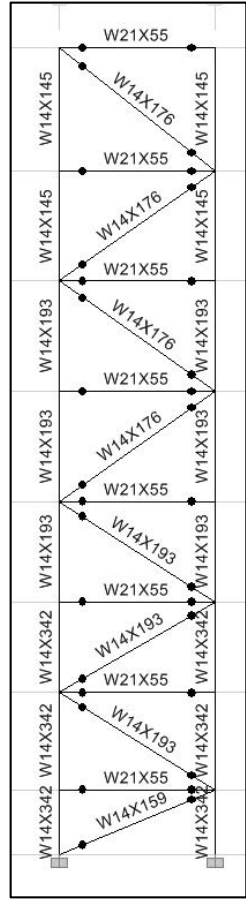


Figure 2.3-5 BF 3

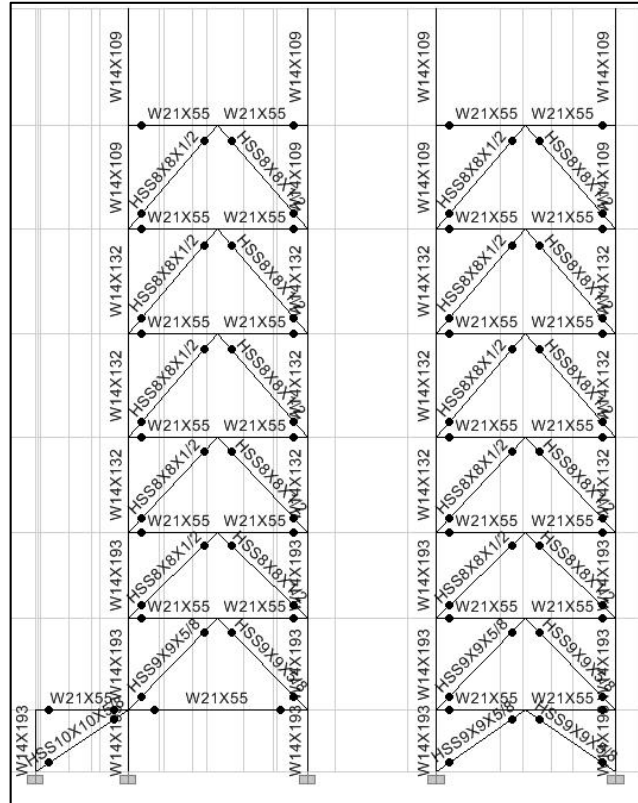


Figure 2.3-6 BF 4 & 5

## 2.4 – CA Lateral Design, Layout 2

The first lateral design seemed rather inefficient due to the low number of braces. It was hypothesized that a more efficient design could be achieved (less steel tonnage) by adding frames, which would also allow a  $\rho = 1$ , creating less strength demand on the structure. Three areas were highlighted for addition, two in the EW direction and one in the NS direction. The addition would remove 4 parking spaces of the available 60 which was deemed an acceptable impact. An additional column was added as well, to avoid a beam cantilevering from the weak axis of a column involved in Brace Frame 8.

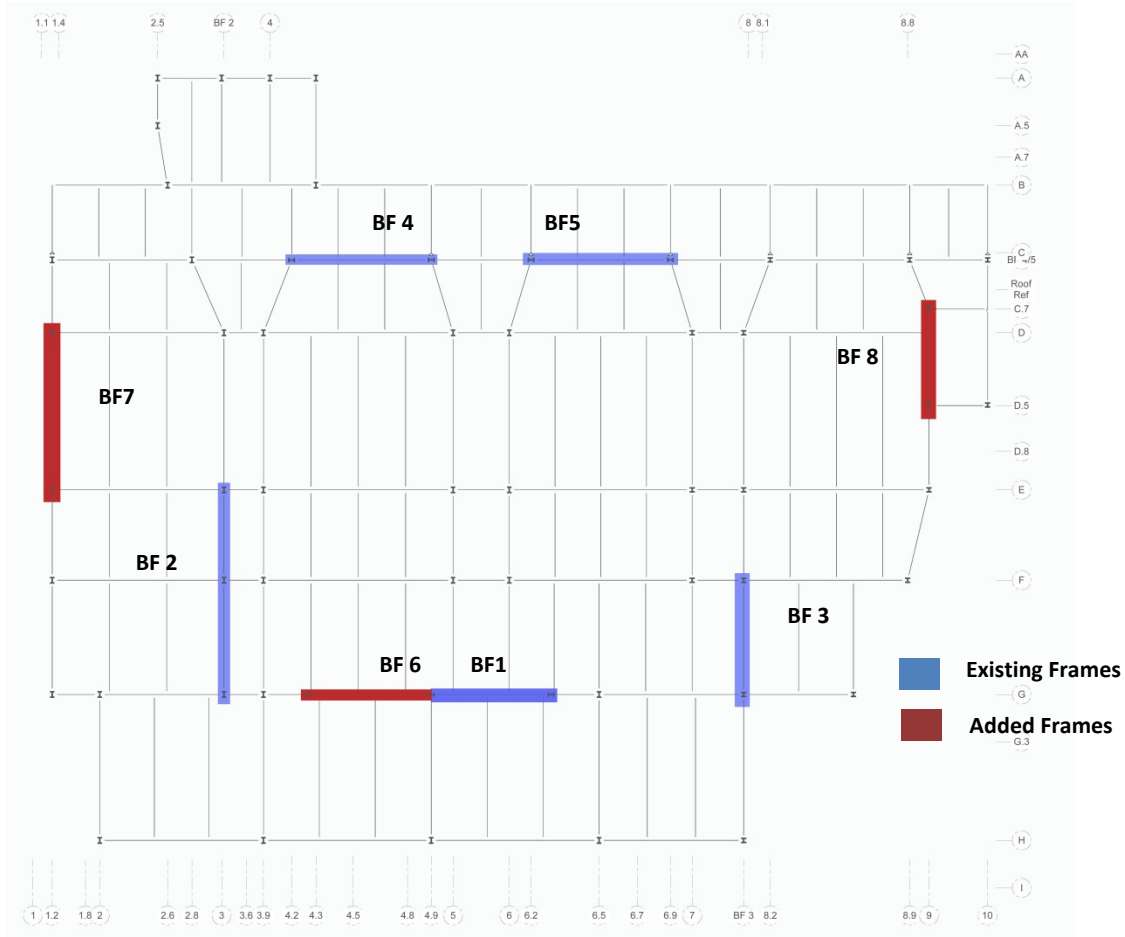


Figure 2.4-1 BF Layout

In order to use  $\rho = 1$  two requirements needed to be met. The first was the confirmation that losing a brace would not cause the story to lose more than 33% of its strength. Table 2.4-1 shows the brace strengths and percentages per floor for the two orthogonal directions. Additionally it needed proved that extreme torsional irregularity was not encountered when a brace was removed on a given level. To accomplish this each brace was deleted one by one, the model run, and the results viewed. This data is included in Appendix N. Both conditions were satisfied.

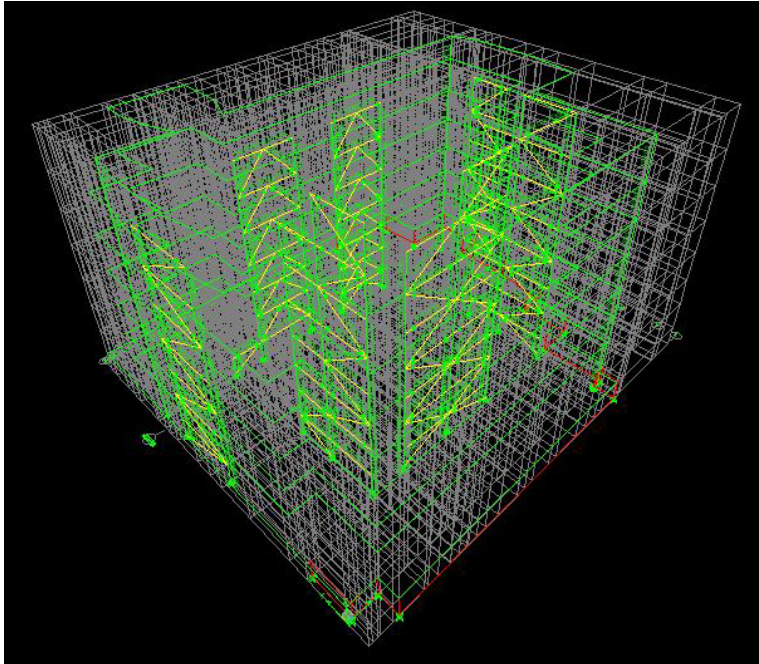


Figure 2.4-2 ETABS Model of CA Layout 2

Strength Summary				
EW Direction				
	BF 2	BF 3	BF 7	BF 8
Pent	28%	28%	22%	21%
5th	28%	28%	22%	21%
4th	28%	28%	22%	21%
3rd	28%	28%	22%	21%
2nd	28%	28%	22%	21%
1st	31%	28%	21%	21%
Terrace	30%	27%	21%	21%
NS Direction				
	BF 4	BF 5	BF 1	BF 6
Pent	21%	21%	28%	30%
5th	21%	21%	28%	30%
4th	21%	21%	28%	30%
3rd	21%	21%	28%	30%
2nd	21%	21%	28%	30%
1st	21%	21%	28%	30%
Terrace	21%	26%	26%	26%

Table 2.4-1 Brace Strength Summary

## Summary

Similarly to Layout 1, drift caused members to be upsized from the preliminary sizing. Minimal steel tonnage was saved, which may be offset by the cost of the additional connections for the bracing members and shipping related to the increased number of pieces involved. Layout 2 had a steel weight of 11.6 psf, but dealt markedly better with torsional issues. Appendix P contains the braced frame elevations for this layout.

Modal Information, CA Layout 2				
Mode	Period	UX	UY	
1	1.60	0.00	70.84	Y Translational
2	1.48	73.12	0.00	X Translational
3	1.15	0.04	1.41	Z Rotational

Table 2.4-2 Modal Information CA Layout 2

## 2.5 CA Lateral Design, Layout 3

Earlier it was noted how chevron frames are typically avoided in seismic applications do to the large beams necessary for the system to perform properly. It was seen that of the 331 tons of steel used for Layout 2's lateral system over 25% of this could be attributed to the beams in the chevrons of frame 4 and 5. Therefore it was decided to investigate an Eccentrically Braced Frame, EBF. Eccentrically braced frames resist lateral forces through shear, flexure and axial forces in members, and are a hybrid of braced frame and moment frames, approaching the stiffness and ductility of each system respectively. In an eccentrically braced frame the brace intersects the beam/column or beam/brace centerlines on one end with the other end intersecting a distance, the eccentricity, away from the centerline. The "link" section of the beam helps the system dissipate energy through shear and is typically the focus of the design. Because EBF's offer greater ductility they have a higher R value, however the SCBF R value would still control. For this study the braced frames were chosen to have non-moment resisting (shear) connections at columns away from links.

The design provisions of particular interest from AISC 341-05 are as follows:

- 15.2a Limitations – Web of a link shall be a single thickness
  - The design of the beam will rely on balancing the shear strength vs. shear demand of the link versus the moment demand on the exterior beam. This provision states that doubler plates are not permitted to increase the shear strength of the link as this is the portion of the system intended to experience inelastic behavior.
- 15.2c Link Rotation Angle – The link rotation shall not exceed 0.08 radians for links of length  $1.6M_p/V_p$  or less
  - Links less than this length are dominated by shear yielding, which is an effective means for energy dissipation. The link rotation angle is the angle between the link beam and beam outside the link at the design story drift.

The eccentric braced frame designed resulted in a W18x86 shape being used as opposed to the W33x354 that was used for the SCBF. Figure 2.5-1 shows the beam design including detailing. Connections are purely schematic, but they adhere to the provision which prevents the any part of the connection from entering the link portion of the beam.

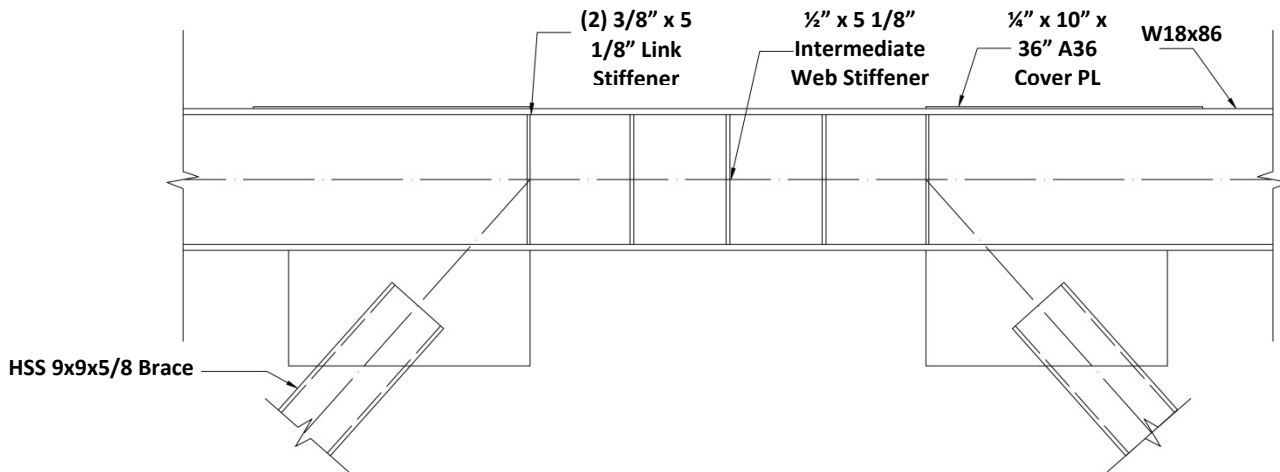


Figure 2.5-1 Eccentric Braced Frame Beam Design

**Summary**

The replacement of the chevron SCBF’s with EBF’s proved very beneficial. The frames were more flexible, but despite increasing the bracing to HSS9x9x5/8 from HSS8x8x1/2 the new layout saved approximately 70 tons of steel, resulting in a total steel weight of 10.9psf for the building.

Modal Information, CA Layout 3					
Mode	Period	UX	UY		
1	1.60	12.26	58.04	Y Translational	
2	1.57	61.07	12.86	X Translational	
3	1.16	1.10	1.81	Z Rotational	

Table 2.5-1 Modal Information CA Layout 3

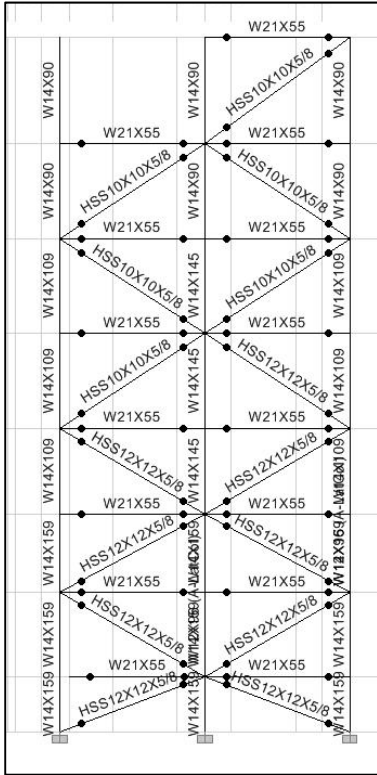


Figure 2.5-2 BF 1 & 6

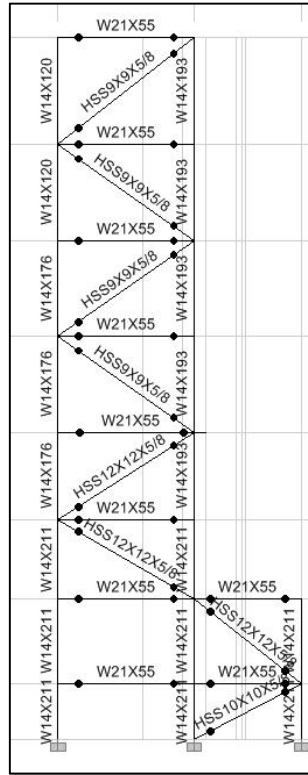


Figure 2.5-3 BF 2

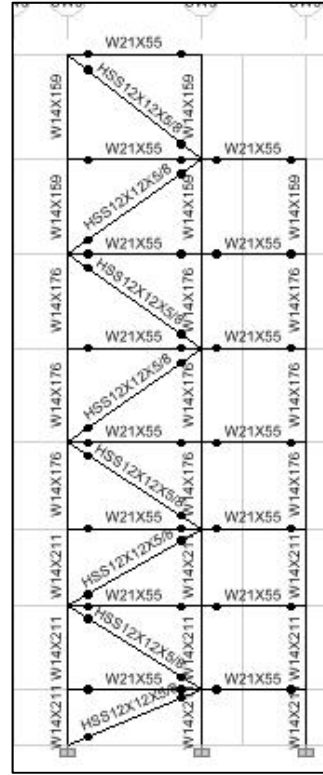


Figure 2.5-4 BF 3

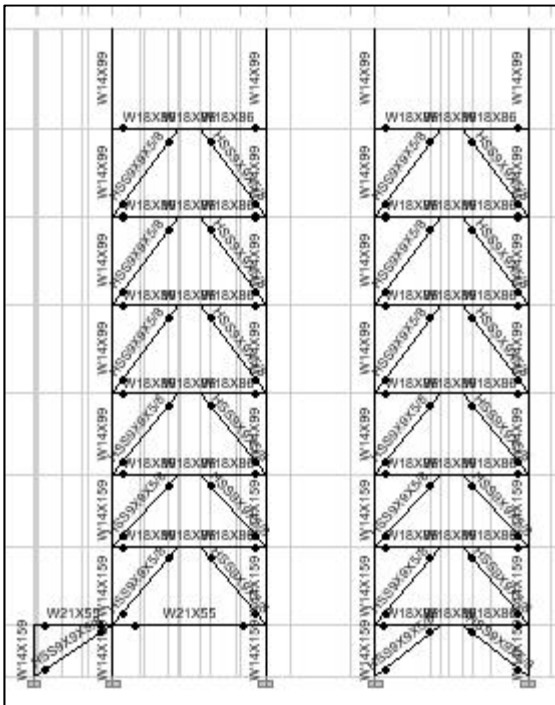


Figure 2.5-5 BF 4 & 5

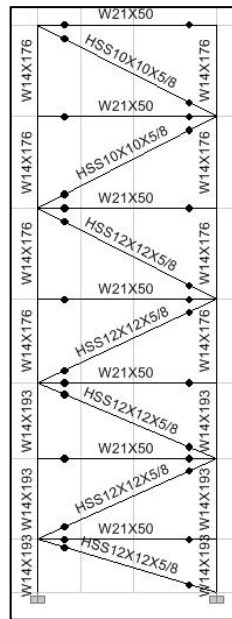


Figure 2.5-6 BF 7

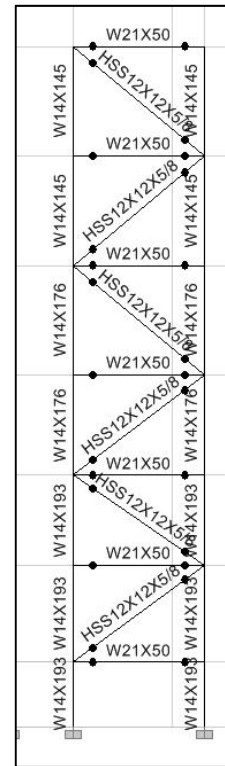


Figure 2.5-7 BF 8



## 2.6 - MAE Requirements

Throughout the structural redesign graduate level coursework was applied. *AE 597A – Computer Modeling* was relied upon extensively. The complexity of designing a building is drastically reduced by the ability to create finite element models of the structure of concern. This is not to say that the program does all of the work, because to get accurate results one must accurately model and understand the proper assumptions to make. This course provided background knowledge relied upon heavily to create the four different iterations, as well as the original concrete structure.

*AE 538-Earthquake Engineering* provided many general concepts and design tips for the structure when it was moved to the region of high seismicity. Prior knowledge of code provisions and experience with seismic design were of paramount importance.

The SBCF and EBF details were done by hand using concepts introduced in *AE 534 – Steel Connections*. The brace to beam connection in particular was of difficult geometry that needed careful thought to complete.

## 2.7 - Summary

In conclusion it was found that the steel redesign in Rockville could be accommodated with minimal impact to the height and layout of the building. The building also remains almost completely architecturally unaffected as well, accept for the addition of beams to the Eastern elevation which features a 14' cantilever.

The move to a higher seismic region proved to be more challenging to make the system work. The addition of braces reduced steel tonnage, though it would not necessarily have reduced the cost due to the additional shipping and connections required. A factor not directly evaluated, the foundations, may make Layout 2 more economically viable over Layout 3 as  $\rho$  would be applied to the foundation design. Layout 2 also had less torsional problems, and would be preferred due to the redundancy in the system.

What proved to be the most beneficial was the conversion of the chevron SCBF to EBF which dropped the steel tonnage by 21%. A summary of the system weights and estimated costs are shown in Table 2.6-1. Factors not considered would be the design of diaphragm collector elements to channel the load into the braced frames, which would likely increase the cost of the system as a whole and change certain gravity elements.

Steel Designs				
	MD	CA 1	CA 2	CA 3
Steel Tonnage	154	339	331	261
Est. Cost	\$ 511,808.30	\$ 1,085,139.94	\$ 1,072,457.85	\$ 851,582.56

Figure 2.7-1 Steel Design Summary

## Chapter 3 – Construction Management Breadth: Cost and Schedule Comparison

Due to the changes made in the substructure and superstructure of the building it was of interest to determine impacts made to both the cost and the schedule of work. The changing height of the building was taken into account by increasing the cost of the building skin proportionally to the height adjustment. While finished floor to ceiling heights were maintained, meaning a possible zero impact to interior finishes and partitions, the CMU and gypsum assemblies were similarly adjusted.

As the original concrete structure would likely require adjustments to meet the demands of a higher seismic design category, and this redesign was not considered in the depth, it was only pertinent to compare cost and schedule of the original structure in Rockville, MD to the redesign that was performed in this location.

Original costs and schedules were provided courtesy of AECOM and Tompkins Builders, Inc.

### 3.1 – Cost

As the buildings substructure was changed from concrete to steel construction the new prices for the materials had to be tallied and compared. The lighter system also warranted a foundation redesign driven by the smaller column loads present upon the drilled piers. The slab on grade and basement walls was left unchanged. Table 3.1-1 below displays the original estimate as compared to the costs compiled through using RS Means 2011 data for the newly designed system. A detailed cost estimate and the original cost estimate are provided in Appendix R.

Cost Comparison			
	As Designed		ReDesign
Super Structure	Value		Value Adj for O&P
Cast-In-Place Concrete	\$ 6,281,783.00		\$ 1,839,890.40
Structural Steel	\$ 1,784,892.00		\$ 5,726,574.58
<b>Substructure</b>			
Drilled Piers	\$ 953,320.00		\$ 510,787.59
<b>Exterior Enclosure</b>			
Arch. Precast	\$ 598,000.00		\$ 609,960.00
Metal Wall Panels	\$ 2,125,533.00		\$ 2,168,043.66
Curtain Wall	\$ 6,456,000.00		\$ 6,585,120.00
Interior Glass (CW)	\$ 683,223.00		\$ 696,887.46
Louvers & Vents	\$ 38,167.00		\$ 38,930.34
<b>Interior</b>			
Masonry	\$ 1,801,768.00		\$ 1,837,803.36
Gypsum Board	\$ 3,559,255.00		\$ 3,630,440.10
<b>Comparison</b>	\$ 24,281,941.00		\$ 23,644,437.49
		<b>Savings</b>	\$ 637,503.51

Table 3.1-1 Cost of Old System Compared to Redesign



The estimated savings on the structural system were approximately \$0.64million, offset to the number shown in the table by the cost increase of the shell and certain interior elements. This number seems high considering Rockville is in an area typically dominated by concrete, but several factors need considered. The large story heights present in the building allowed steel to be implemented with little adjustment. This meant that the cost of extra building skin was not as impactful as is typical in a cost comparison of the two materials, and also meant an increase in the amount of concrete and reinforcing and associated costs due to the higher floor to floor heights. If the building height had to be increased by 10', which may have occurred were the floor heights more conventional, the increase in the building skin alone would be \$1 million. A typical cost for the building superstructure is in the order of 10%. As shown in Table 3.1-2 the superstructure is slightly higher than normal, which may be a combination of the large floor heights and the large cantilevered portion of the slab on the East Elevation.

Percentage Breakdown of Building Costs				
	Original Cost	% Total	Redesign Cost	% Total
<b>Shell</b>				
Super Structure	\$ 8,066,675.00	12.9%	\$ 7,566,464.98	12.3%
Exterior Enclosure	\$ 9,900,923.00	15.9%	\$ 10,098,941.46	16.4%
Roofing	\$ 965,381.00	1.5%	\$ 965,381.00	1.6%
	Subtotal		Subtotal	
	\$ 62,332,586.00		\$ 61,695,082.49	

Table 3.1-2 Cost Breakdown

### 3.2 - Schedule

An advantage steel construction has over concrete is typically in the duration the building structure takes to build. A schedule was compiled using RS Means 2011 for the newly designed structure and the original schedule as a reference and then compared to the original schedule. Foundations, while reduced in size, were assumed to take the same duration as the number of drilled piers was increased from 71 to 73. Exterior skin and roofing schedules were similarly assumed to remain consistent with those from the original schedule.



Figure 3.2-1 Redesign Schedule

Figure 3.2-1 above shows the redesign schedule from Microsoft Project. Total project duration was decreased by a month due to the material change. The end date for the exterior skin originally was dated for 11/16/12 but it is estimated that with a steel structure this can be dropped to 10/17/12. The amount of work days required to complete the building structure was reduced from 161 days original estimated to 99 days which may have the potential to cause a larger impact on areas of the schedule that were not considered in the scope of this analysis, such as work done upon the interior.

### 3.3 - Summary

The results of the findings in the cost and schedule analysis are summarized in Table 3.3-1. The scheduled construction time was reduced by a month, which potentially larger impacts due to the completion of the structure 62 work days ahead of the estimate for the concrete construction.

Cost/Schedule Summary		
	Original	Redesign
Schedule	9 months	8 months
Cost	\$ 24,281,941	\$ 23,644,437

Table 3.3-1 Cost/Schedule Summary

The building cost associated with the changes made was also found to be reduced by \$1.2 million. Due to the unusually large floor to floor heights, in part present to accommodate the attachment to an existing structure, may have made steel such a competitive choice with regards to concrete in this application. While location factors were accounted for in the usage of RS Means, the fact that in this area concrete construction is typical may have led to cost increases in steel design not fully accounted for. Table 3.3-2 shows the factors looked at by the AECOM team when choosing a structural system, two of which that were highlighted being the cost and the experienced bidders. As was discussed earlier in Chapter 2 it is believed that vibration would not be as large a factor due to the irregular bay sizes and that the framing depth could be overcome with careful attention to coordination.

Structural System Comparison Chart						
	Composite		PT Concrete	Concrete		Ranking
	Steel			Skip Joist		Factor
Cost	2		3		1	
		20		30		10
Vibration	1		3		2	
		7		21		14
Ease of Future Modification	3		1		2	
		24		8		16
Weight of Structure (Ftdion Savings)	3		1		2	
		6		2		4
Same Subcontractor for Whole Structure	1		2		3	
		2		4		6
Smallest Column Size	3		1		2	
		6		2		4
Commonly Constructed System with Many Experienced Bidders	3		2		1	
		18		12		6
Structural Framing Depth	1		3		2	
		5		15		10
Fire Protection	1		3		2	
		5		15		10
<b>Total</b>	<b>18</b>	<b>93</b>	<b>19</b>	<b>109</b>	<b>17</b>	<b>80</b>

Table 3.3-2 AECOM System Comparison

In summary it would appear that steel could be a very competitive alternative to concrete in this situation in terms of building cost and schedule, though limitations in cost knowledge make it unclear exactly how competitive.

## Chapter 4 – Sustainability Study

The rooftop of the Judicial Center Annex has a distinct, multi-tiered shape that gives the building architectural character. It was also an area that the designers took advantage of to provide sustainable energy features that allowed the addition to gain LEED Gold accreditation. Between the penthouse and the lower roof the building features 6270 square feet of extensive green roof as well as photovoltaic panels installed on top of the lantern structures as can be seen in Figure 4-1.

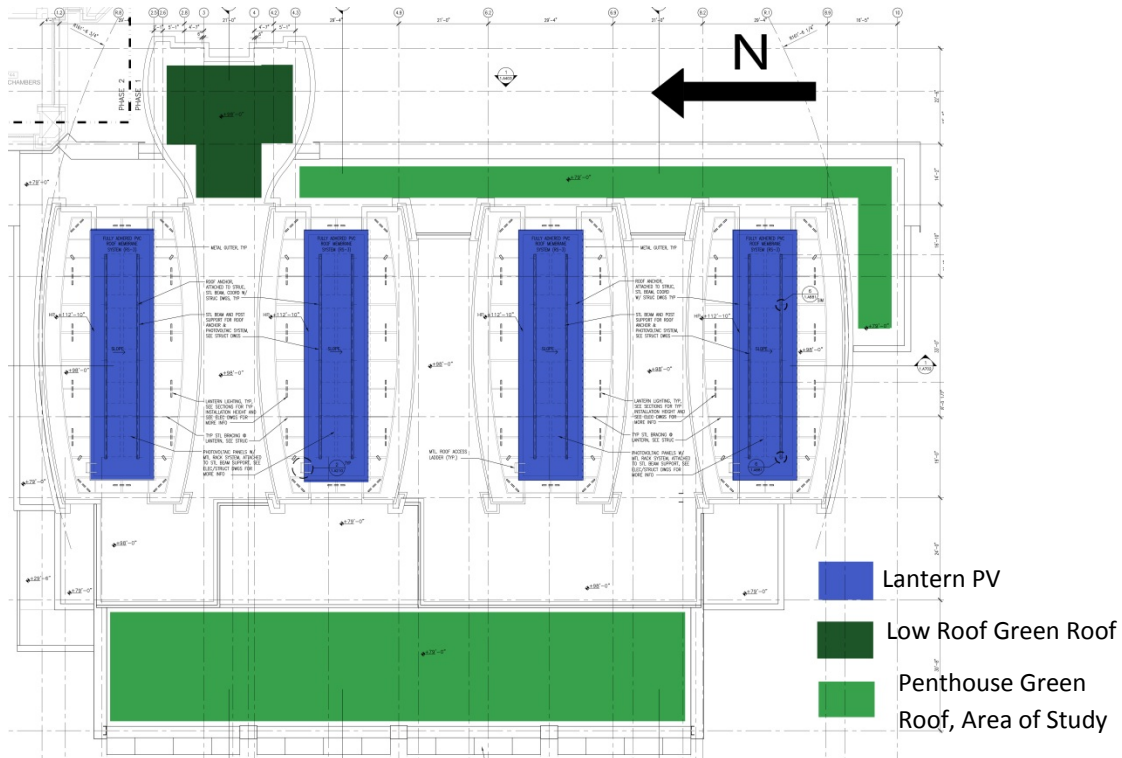


Figure 4-1: Sustainable Roof Features

This study was conducted to see if the area used as a green roof space would be better used through additional PV panels. This required both systems to be analyzed in terms of life cycle cost over the chosen 30 year span as PV Panels typically last 25-30 years, carbon output, LEED impact, and other less tangible factors. Additional areas of the LEED checklist will be explored to highlight achievable points.

### 4.1 – Green Roof

As stated, the JCA will feature an extensive green roof system in the green areas of Figure 4-1. An extensive system features a soil substrate of 4-6 inches of a lightweight growing medium as opposed to intensive systems which will have a heavier growing medium in depths ranging to 24". Extensive systems can be utilized on sloped roofs, are low-maintenance and drought-tolerant due to their makeup of grasses, mosses, and flowers. Intensive roofs can feature much more diverse fauna ranging from bushes to trees and require larger degree maintenance. Figure 4.1-1 shows what an extensive green roof might look like when fully installed.



Figure 4.1-1: Extensive Green Roof, nemo.uconn.edu



Figure 4.1-2: Autodesk Vasari Energy Model

Green roof systems typically cost from \$10-\$15 per square foot, twice as much as a normal roof system. However they reduce building energy costs by as much as 25% depending upon roof coverage, help curb the urban heat island effect and mitigate storm water runoff.

### Life-Cycle Assessment

For the life cycle analysis the cost of the system needed to be determined over a 30 year period using net present values with an interest rate of 5% to account for future expenses or gains. The system was priced at \$15 a square foot, on the high end of system costs. A maintenance rate of \$0.50 per square foot for the first year was included with the assumption that it would no longer require heavy maintenance after this point. After ten years it was assumed that 10% of the system would require replacement and after 20 years an additional 20% due to damages and disrepair. However the green roof typically protects the roof membrane which has a life cycle of 15 years which would not need to be replaced, which was priced at \$7.50 per square foot covered by the green roof. A summary of the system value and the prices is shown in Table 4.1-1.

Green Roof Cost				
	Cost	Yr	NPV Adj	Final Cost
Initial Cost	-94050		1	-94050.00
Maintenance	-3000	1	0.9524	-2857.20
Replacement	-9405	10	0.613	-5765.27
	-18810	20	0.377	-7091.37
Savings on Roof Repair	30,000	15	0.481	14430.00
Salvage	18810	30	0.231	4345.11
Total Cost				\$(90,988.73)

Table 4.1-1: Green Roof Life-Cycle Cost

### Direct Energy

The paper, *Cost-Effectiveness of Green Roofs*, was used to as a reference point to quantify cost savings for the analysis of the system. In this paper it is noted that only the top two floors see a significant energy reduction due to a lower cooling load, so a conservative value of 1% of the total buildings energy usage was determined to be saved due to the green roof as recommended by the paper. To determine the energy savings possible it was necessary to have an estimate for the amount of energy the building used. A model was created using AutoDesk Vasari, a program used for preliminary planning that can help give better insight into a buildings energy usage and green potential. The building mass was modeled and divided into levels; the garage was excluded as minimal energy use was anticipated. The spaces were assigned an open-office occupancy and a percentage of exterior glazing was estimated based off of exterior elevations of the JCA. Based upon the energy usage the green roof saved an estimated \$ 4,139 annually. The Vasari output is attached in Appendix T.

### Storm Water Treatment

The reduction in storm water is another benefit of a green roof system. Extensive roofs have the capability of reducing storm water by as much as 50%. To determine the annual reduction in run off the area of coverage was multiplied by the half the annual rainfall. Rockville, MD sees 43 inches of rain per year, which results in 80.4 kgal of water reduced annually. Fisher et al.(2008) indicated a market value of \$2.27 per kgal of storm water processed. This results in an annual savings of \$182.50.

### CO<sub>2</sub> Emissions

Electricity use can also be quantified in an equivalent weight in CO<sub>2</sub> emissions. According to Blackhurst et al.(2010) 1.5 lb. of CO<sub>2</sub>/kWh is the electricity emissions factor. Due to the reduction in energy use the

green roof results in a reduction in 47755 lbs. of CO<sub>2</sub> per year. The amount of CO<sub>2</sub> emissions released during green roof production and installation is 54.3 lbs. After seven years the system will have reduced more emissions than were involved in its creation.

Summarized in Table 4.1-2 are the relevant numbers as discussed in the three sections above. The cost benefit of a reduction in the Urban Heat Island effect is difficult to quantify as it is based upon the surrounding buildings as well and was not accounted for.

Extensive Green Roof			
Annual Energy Use Estimate	Estimated Reduction	Cost of Electricity	Annual Savings
kWh	kWh	\$/kWh	
3183686	31836.86	\$ 0.13	\$4,138.79
Carbon Reductions	Run-off Saved (kgal)	Storm Water Cost	Annual Savings
lbs CO <sub>2</sub>	kgal	\$/kgal	
47755.29	80.4	2.27	\$ 182.51
Total Annual Savings		\$	4,321.30
Pay Back Period		21.06 Years	

**Table 4.1-2: Green Roof Annual Savings and Payback Period**



## 4.2 – PV Panels



Figure 4.2-1: Sunpower T5 Solar Roof Tiles, Source: sunpowercopr.com

PV panels are made of a crystalline silicon material, a semi-conductor that has the ability to convert sunlight into electricity. Solar energy has become increasingly popular, resulting in more efficient systems that are much more cost effective. Additionally federal and state grants for solar products and producing renewable electricity make PV panels an attractive and feasible addition to most buildings.

PV panels vary with efficiency based upon the material used as the semi-conductor as well as by geographic location, tilt, and orientation. Sunpower is one of the leading manufacturers, making extremely efficient panels. Their T5 Solar Roof tiles shown in Figure 4.2-1 were chosen, as their efficiency can offset the poor tilt angle of 5 degrees. The tilt angle is often by default chosen as the latitude of the location of interest. The Solar Roof tiles require no penetration yet are highly resistant to wind forces and lightweight due to their interlocking design meaning little to no impact on the structural system, additional system specifications are included in Appendix U. This also results in a high density of panels with the potential for greater energy gains from a smaller area. To determine the amount of energy the system could produce the number of panels the space permitted had to be determined. A typical system uses panels in increments of eight, forming a string, a schematic wiring diagram for a string and for the system shown in Figure 4.2-2. Based upon the square footage available the larger western portion of the penthouse roof as seen in Figure 4-1 could hold 136 panels and the eastern portion of the roof could hold 40 panels. At 320 watts per panel this resulted in a 56.3 kW system.



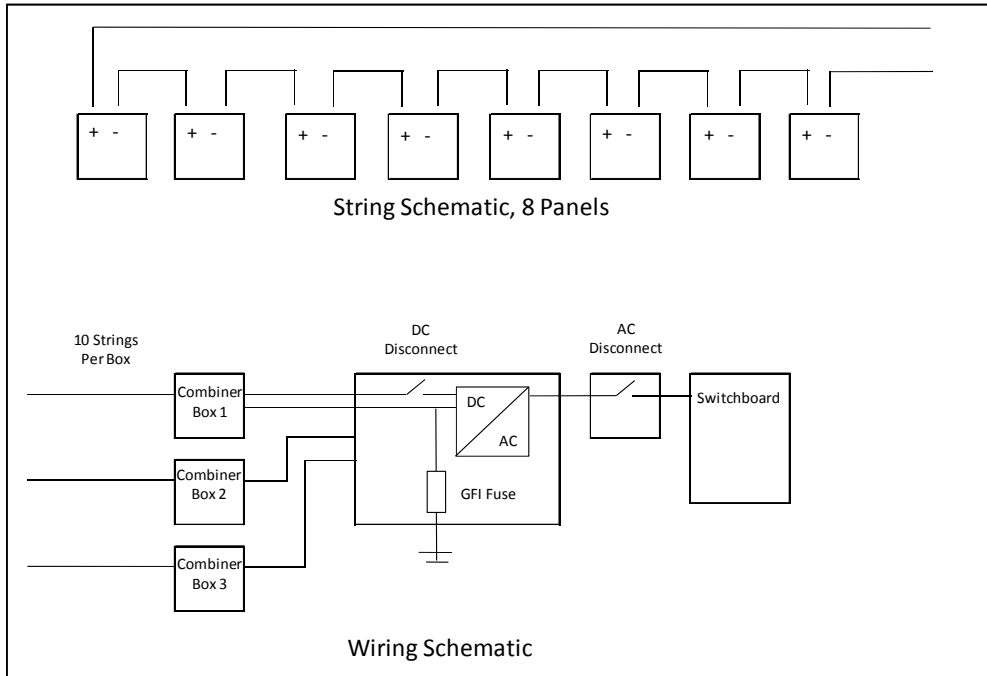


Figure 4.2-2: Schematic wiring diagram for PV Panels

**Life-Cycle Assessment**

System Advisory Model (SAM), software available from National Renewable Energy Laboratory can provide a life cycle for a given system with a large degree of sophistication. Federal and state tax credit and production incentives, location, tilt, azimuth, and electricity rates among other factors are accounted for. The shading factor was difficult to quantify, so a solar study was done using Vasari and resulted in an estimated value of 0.8 (1 = No shade, 0 = fully shaded). An example screen shot of the solar study is visible in Figure 4.2-3. The SAM life cycle devised a payback period of 27 years. For the full cash flow output from SAM see Appendix V.

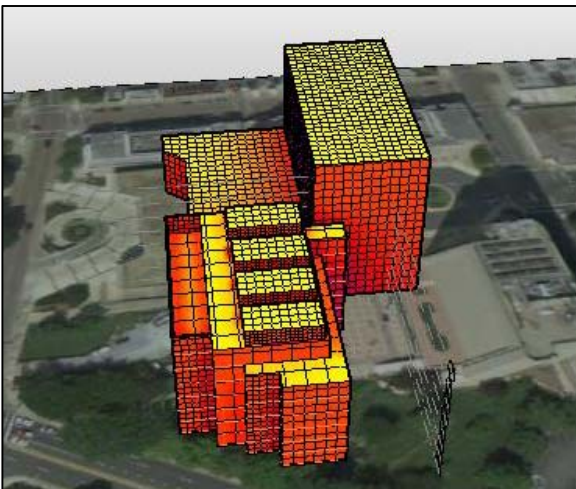


Figure 4.2-3: Solar Study

SAM Study	
Metric	Base
Net Annual Energy	55,522 kWh
LCOE Nominal	16.66 ¢/kWh
LCOE Real	12.78 ¢/kWh
First Year Revenue without System	(\$250,655.16)
First Year Revenue with System	(\$240,903.48)
First Year Net Revenue	\$9,751.68
After-tax NPV	(\$10,323.20)
Payback Period (Yrs)	27.0
DC-to-AC Capacity Factor	12.00%
First year kWhac/kWdc	1,048
System Performance Factor	0.81
Total Land Area	0.19 acres

Table 4.2-1: Systems Advisory Model Figures

## CO<sub>2</sub> Emissions

PV panels are a source of renewable energy and thus are often considered 'carbon neutral'. This is a misnomer however, as while they may not produce carbon while in use their manufacturing, deliver, and installation result in carbon emissions. *Carbon Footprint of Electricity Generation* claims the lifecycle carbon production of PV panels results in an equivalent CO<sub>2</sub> emission of 58 g/kWh. This results in the production of over 7000 lbs. of CO<sub>2</sub> annually.

### 4.3 LEED Investigation

The original LEED checklist was obtained courtesy of AECOM which was completed in 9/9/2008. The building has since received a Gold rating while it was originally striving for Silver during this planning period which is based upon LEED-NC Version 2.2.

Going through the LEED checklist it was determined that the green roof system could impact the earning of 7 credits, of which 5 were confirmed as very likely to be achieved by AECOM's design team. In the Sustainable Site section, credits 6.1 and 6.2 for Storm water Design were both earned which would be highly impacted by the green roof assembly. Credits 7.1 and 7.2, Heat Island Effect Roof, were also in large part earned due to the usage of a vegetated assembly, though a high albedo roof such as a thermoplastic polyolefin (TPO) membrane could be used in conjunction with the PV panels to possibly earn this credit. Credit 5.2, Site Development, requires that the vegetated open space in the project exceed the local zonings requirement by 25% and vegetated roofs count towards this. Additionally Water Efficiency credits 3.1 and 3.2 could be influenced if a grey water system were incorporated with the green roof.

The PV Panels only influenced one item on the LEED checklist, Energy and Atmosphere credit 2. This can award up to 3 LEED points based upon the percentage of renewable energy generated. The designed PV system earns approximately 1.5% of the annual energy usage, and when combined with the high roof PV panels would likely surpass 2.5% which is enough to earn a point. For 2 points they would need to produce 7.5% of the buildings energy use which is less likely, and finally 12.5% for 3 points which is unfeasible based upon the current study.

There are several additional credits that could be earned with little effort. Energy and Atmosphere credits 5, measurement and verification, is easily earned and potentially at no cost if the mechanical and electrical engineers are involved early on and align their systems so the quantities can be measured in a simple fashion by such means as placing all lighting circuits on one panel so that data can be broken down in a simple manner. Credit 6, green power, could be attained by contacting the local energy provider and exploring the possibilities of certified green power, however this may come at some cost as this energy would likely be cost slightly more.

Interestingly the structure could have a large impact on LEED credits Materials and Reuse 4.2 and 5.2. Credit 4.2 for recycled materials and 5.2 for local materials could be strongly impacted by the structural system. These require 20% of the base cost to be recycled or local respectively, and most of the

structure which currently accounts for 13% of the cost as seen in Table 3.1-2 would qualify as both of these.

#### 4.4 - Summary

In summary, due to the multitude of benefits, lower start-up cost and quicker payback period it was determined that the green roof is the more viable option and should be kept as designed. The green roof cost roughly half the initial investment the PV panels did and paid it back in 7 less years. Net carbon output was in the negative and storm water mitigation was improved. Urban heat island effects were reduced. Additionally the green roof heavily impacted 4 LEED credits with the possible influence of 3 more while the PV panels were only seen to account for 2 at most, Table 4.3-1 summarized this. The roof geometry caused shading which reduced the effectiveness of the PV panels in the areas accounted for, but depending on the planned system for the high roof a LEED point might still be earned for renewable energy.

Sustainability Summary		
	Photovoltaics	Green Roof
System Cost	\$ 215,769	\$90,989
Carbon Footprint ( tons CO <sub>2</sub> )	106.3	-505.0
Stormwater Mitigation (kgal)	-	80.4
Payback Period (yr)	27.0	21.1
Weight (psf)	3	20
Structural Impact	NA	Moderate
LEED Credits (gained[possible])	2[3]	4[7]

Table 4.4-1: Sustainability Summary

## Chapter 5 - Conclusion

This thesis has proven that for the Judicial Center Annex a steel structural system employing braced frames is a viable solution. Though cost data may not be entirely accurate, the system would have the potential to save money or compare favorably due in part to the large story heights. The increased schedule which may have further impact beyond the month that was shown to be saved would be another benefit of this system. The steel system was able to adequately maintain the architecture and floor layout with less perceived impact.

The seismic exploration was of great interest. The steel systems developed, like their predecessor in MD, were able to handle the situation, though a greater effort had to be made to deal with the much larger forces. Layout 3 was seen as the most economical, utilizing eccentric braced frames to reduce the cost of the lateral system by 21%. The impact of chevron frames in a seismic region was proven to be very large. Redundancy was also seen as beneficial; not only in terms of the  $p$  factor but in terms of better torsional performance which was seen to very adversely affect the building. Additionally the “cost” of detailing a system for an R value greater than 3 was seen.

The sustainability study showed that for this situation the green roofs were the appropriate choice. The tiered roof provided shade and prevented a large enough layout to produce enough electricity to quickly offset the initial cost. The low maintenance green roof was able to pay off its initial cost approximately 6 years earlier and provided other benefits in the form of storm water mitigation and a negative carbon emission. The green roof also had many more potential impacts upon the LEED accreditation process.

## References

Blackhurst, M., Hendrickson, C., Matthews, H. S. (2010). "Cost-effectiveness of green roofs." *J. of Arch. Eng.* 16(4), 136-143.

"Carbon Footprint of Electricity Generation," *postnote: Parliamentary Office of Science and Technology*. Number 268, Oct 2006.

Hanagan, Linda. "Steel Connections." AE 534. The Pennsylvania State University. University Park, PA. Fall 2011. Notes and Lectures.

Kibert, Charles J. Sustainable Construction: Green Building Design and Delivery. Hoboken, NJ: John Wiley & Sons, 2005.


Lepage, Andres. "Computer Modeling." AE 597A. The Pennsylvania State University. University Park, PA. Spring 2011. Notes and Lectures.


Memari, Ali. "Earthquake Engineering." AE 538. The Pennsylvania State University. University Park, PA. Fall 2011. Notes and Lectures.

Sunpower, Corp. "T5 Roof Tiles." < [ussunpowercorp.com](http://ussunpowercorp.com) > March 20<sup>th</sup> 2012.

Waier, P. R., ed. (2011). *RS Means Building Construction Cost Data 2011*, 69<sup>th</sup> ed., RS Means Company, Kingston, MA.

Appendix A – Typical Plans

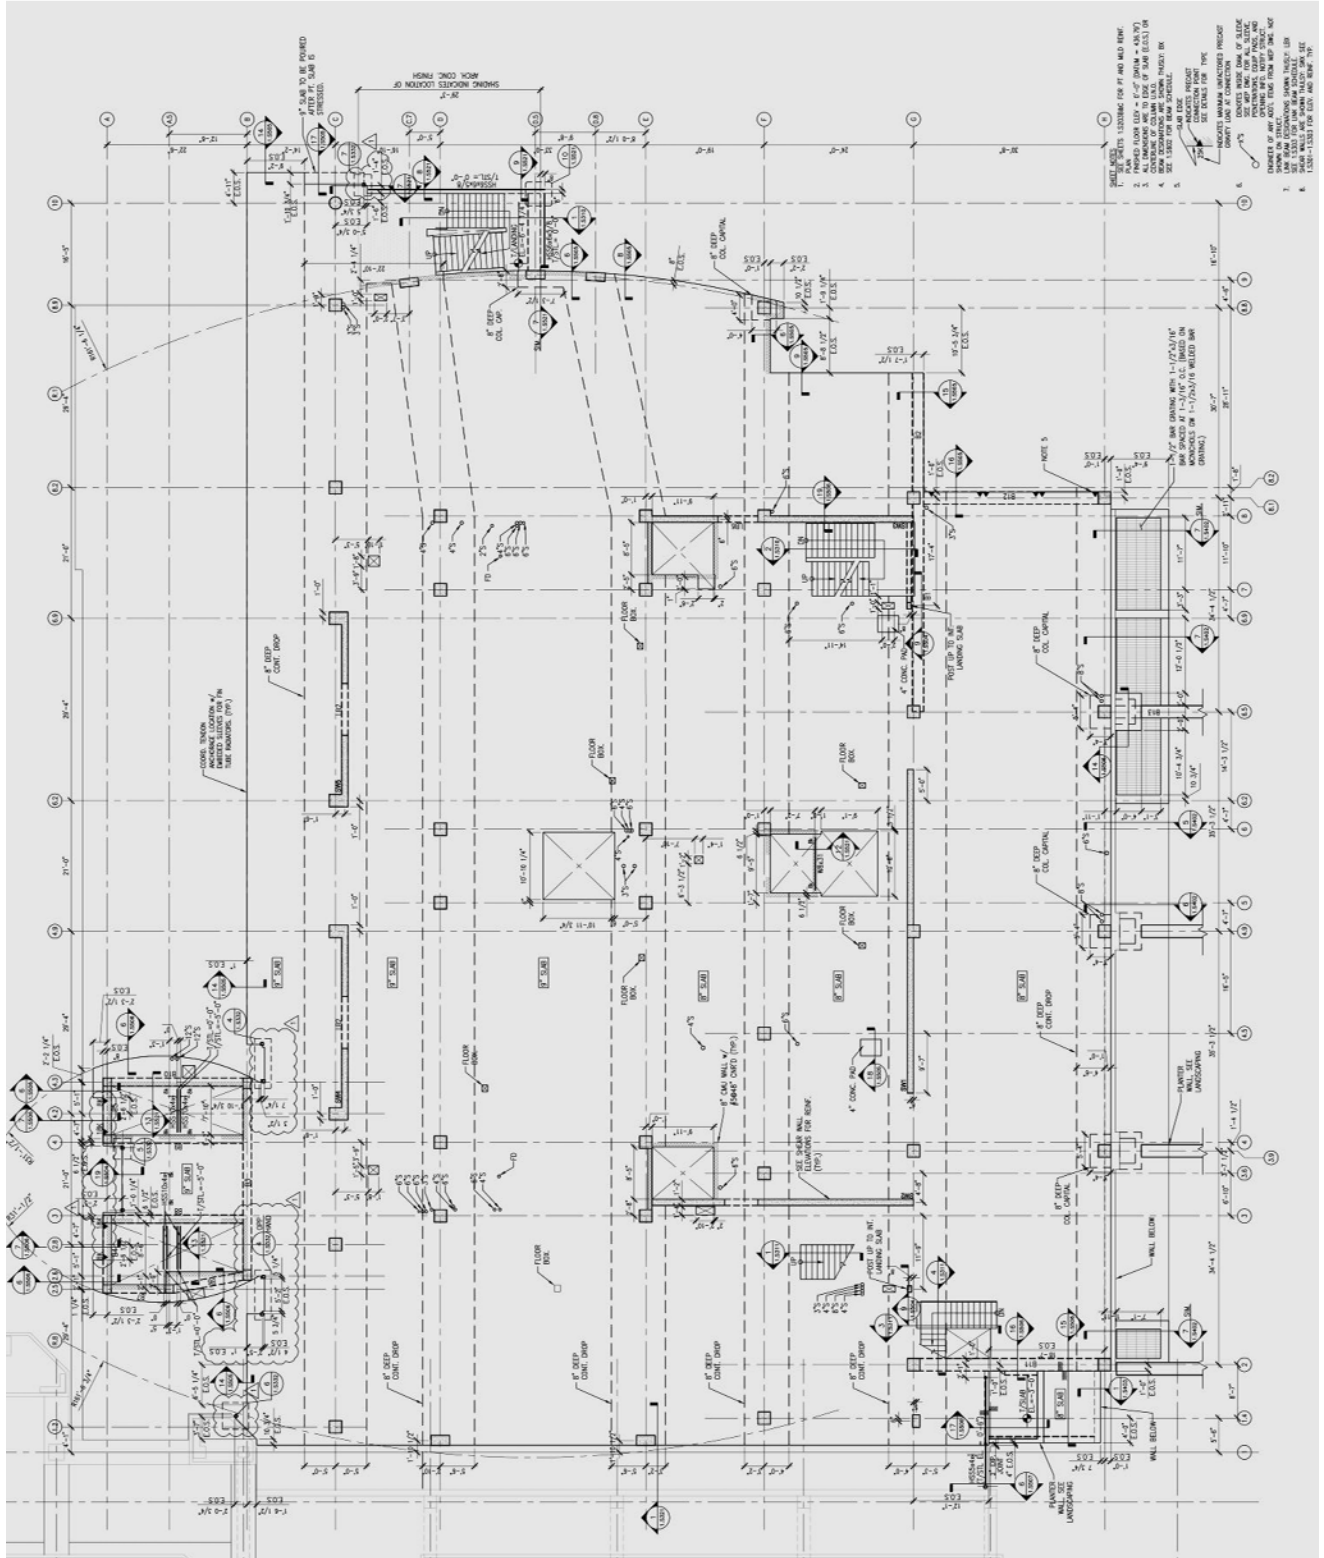

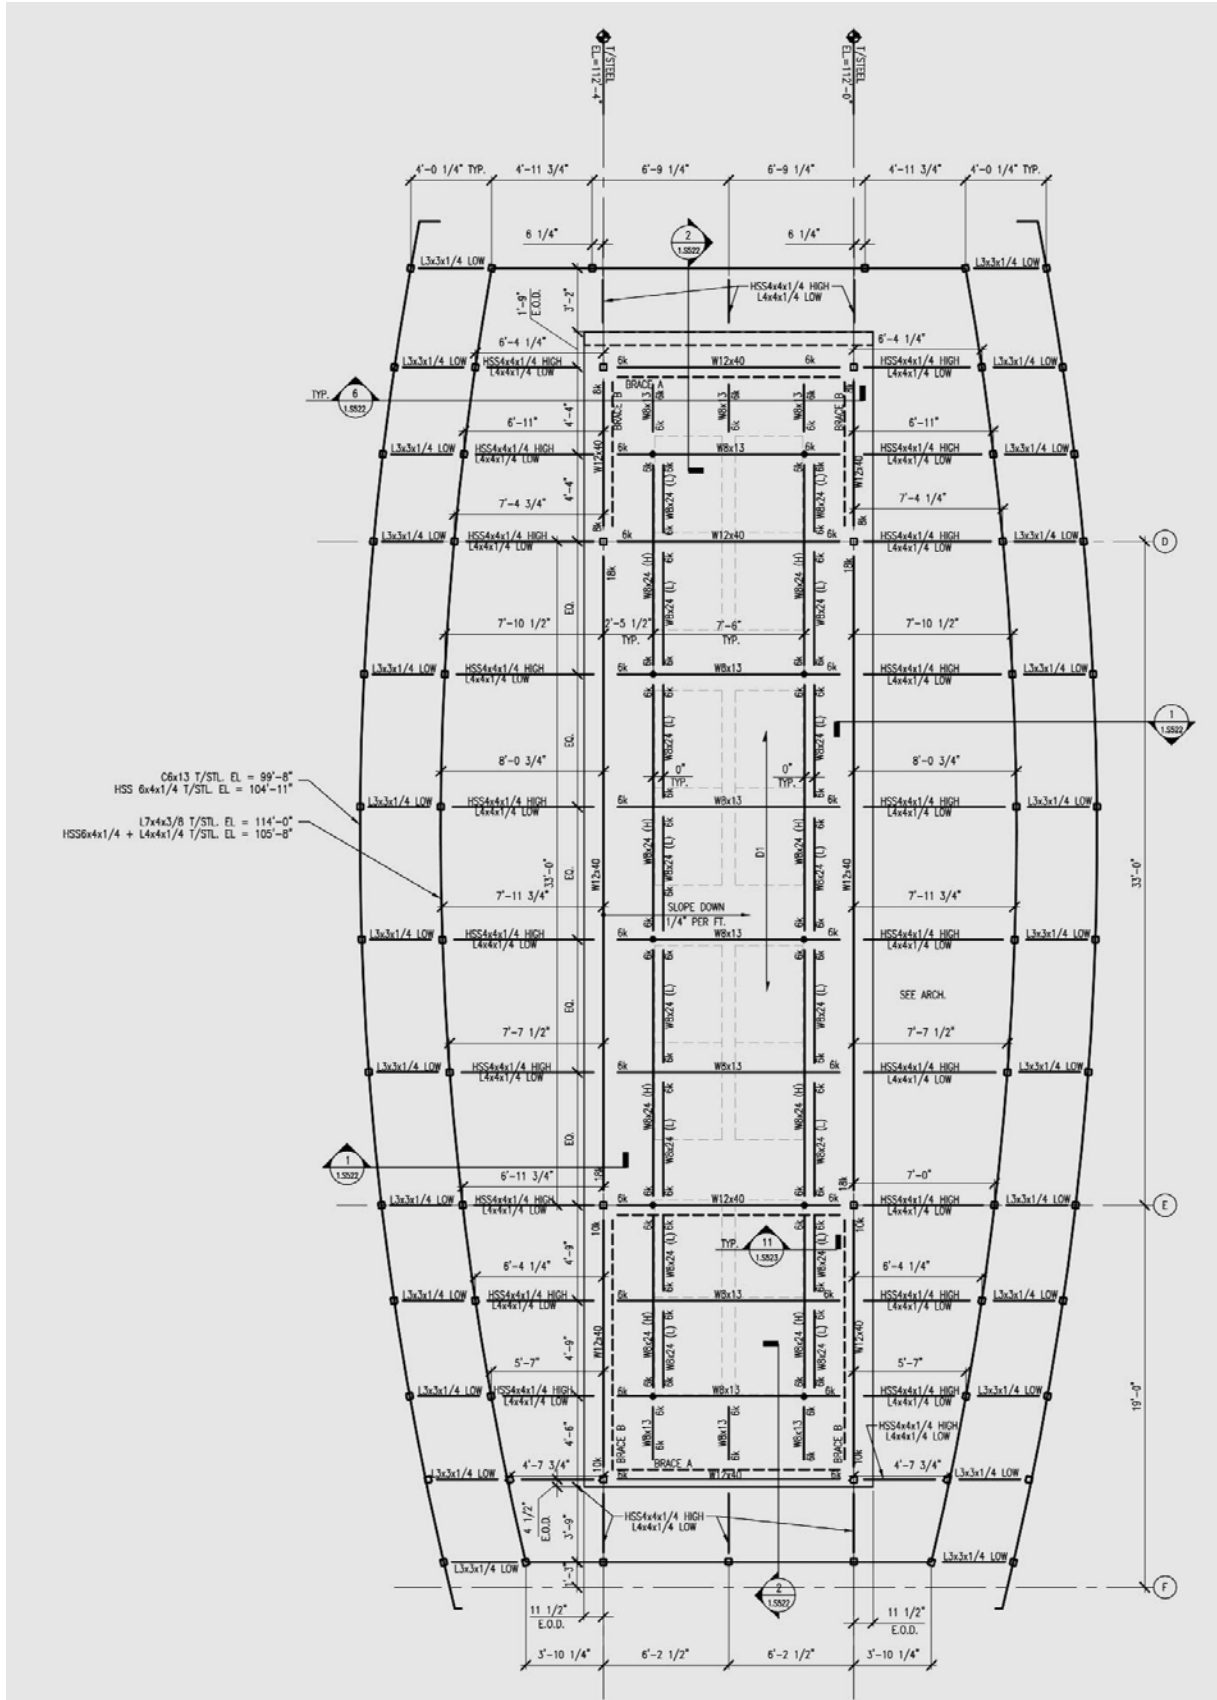



Appendix B – Wind Calculations

JAKE WIEST WIND

\* WHILE THE HIGHEST PT. ON THE BLDG IS 144', THE MAJORITY OF THE ROOF IS @ 100', WHICH WILL BE USED FOR SIMPLIFICATION

$V = 90 \text{ MPH}$  FIG. 6-1  
 $I = 1.15$  TAB 6-1  
 EXPOSURE B  
 $K_z = .99$  TAB 6-3  
 $K_{zt} = 1.0$   
 $K_d = .85$  TAB 6-4 MWFRS

IDEALIZED BLDG FOOTPRINT  
 120'

VELOCITY PRESSURE

$$q = .00256 K_z K_{zt} K_d V^2 I$$

$$= .00256 (.99) (1.0) (.85) (90)^2 (1.15)$$

$$= 20.1 \text{ psf FOR } h = 100 \text{ ft}$$

(REST ON EXCEL)

$T_n$  (FROM SEISMIC) = .678

$$f = K_T = \frac{1}{.678} = 1.47 > 1 \text{ Hz}$$

RIGID STRUCTURE

$$G = 0.85$$

$$GC_{pi} = \pm 0.18 : \text{FULLY ENCLOSED}$$

DESIGN WIND PRESSURE

$$P = q(GC_p - q_i(GC_{pi}))$$

WINDWARD P @ 100'

$$P = 20.1 (.85) (.8) - 20.1 (\pm .18)$$

$$= 13.7 \pm 3.6 \text{ psf}$$

(REST ON EXCEL)

C<sub>p</sub>

- WINDWARD -  $C_p = .8$
- SIDEWALL  $C_p = -.7$
- LEE NORMAL 180'  $154/180 = .83 = -.5$
- NORMAL 150'  $169/150 = 1.2 = -.46$

Roof  $C_p$ :  $109/150 = .67 \rightarrow$   
 $109/180 = .56 \rightarrow$

- 0 to  $W/2 = -1.04$
- $-1.048$
- $> W/2 = -.832$
- $-.876$



## Appendix C – Seismic Calculation (As Designed)

JAKE WIEST	SEISMIC
- OCCUPANCY CATEGORY III - IMPORTANCE FACTOR = 1.25 → SITE CLASS - D	
$S_D = .156$ (VALUES FROM UFGS SEISMIC Hazard CURVES + UNIFORM Hazard RESPONSE SPECTRA) $S_1 = .051$ (EST. VALUES FROM MAPS .16 & .05 RESPECTIVELY)	$F_a = 1.6$ (TABLE 11.4-1) $F_v = 2.4$ (TAB. 11.4-2)
$S_{MS} = F_a S_D = .156(1.6) = .2496$	
$S_{M1} = F_v S_1 = .051(2.4) = .1224$	
$S_{DS} = \frac{2}{3} S_{MS} = \frac{2}{3} (.2496) = .1664$ SDC = A	
$S_{D1} = \frac{2}{3} S_{M1} = \frac{2}{3} (.1224) = .0816$ SDC = B ← CONTROLS	
T. 12.8-2: $C_u = .02$ $\alpha = .75$	
$T_a = C_u h_n^\alpha = .02 (14)^{.75} = .6883$	$T_L = 8s$ $F = C_u T_a = 1.7 (.688) = 1.19$
$C_s = \frac{S_{DS}}{(R/I)} = \frac{.166}{(4/1.25)} = .0525$	$C_s = \frac{S_{D1}}{T(R/I)} = \frac{.0816}{14(4/1.25)} = .0214$
$C_s = .0214$	
$V = W C_s = 28000 \times .0214 = 600k$	

Appendix D – Steel Framing Hand Calculations

JAKE WIEST      COMPOSITE SLAB + MTL DECK ON COMPOSITE BMS + GIRDERS

USING BAY FROM PT DESIGN

LIVE LOAD = 100 psf  
DEADLOAD = 15 psf MEP → SUPERIMPOSED LOAD = 115 psf

AS UNSHORED CONGR. IS MORE ECONOMICAL, WOULD LIKE TO PICK A DECK THAT CAN BE PLACED 12' UNSHORED SO NO INFIL BEAMS NEED ADDED IN THE SMALLER BAYS.

2VL18 4/8" LW TOPPING CHECKED  
MAX UNSHORED: 12'9" > 12' ✓ (3 SPAN COND.)  
CARRIES 122 psf @ 12'-0" SPAN > 115 psf

GIVEN SLAB CONSTRAINTS  
MEAN 3 INFIL BEAMS IN LARGE BAY @ 10.25' SPACING

TOTAL SLAB DEPTH = 5"  
TOTAL SLAB WT. = 39 psf

BEAM DESIGN

LL = 100 psf       $U_{RED} = .25 + \frac{15}{33 \times 20.5} = .83 = 83 \text{ psf}$

DL = 39 + 15 + 10 = 64 psf  
↑ CORRECT      ↑ > 100 psf

BEAM (A)      BEAM (B)

$W_u = [1.2(64) + 1.6(83)] \frac{10.25 + 12}{2} = 2.83 \text{ klf}$        $W_u = [1.2(64) + 1.6(83)] 10.25 = 2.15 \text{ klf}$

$M_u = \frac{2.83(83)^2}{8} = 317 \text{ k-ft}$        $M_u = 293 \text{ k-ft}$

$d_{eff} = \frac{SPAN}{8} = \frac{33 \times 12}{8} = 99" \leq 2 \times \frac{1}{2} SPACING = \left(\frac{10.25 + 12}{2}\right) \times 12 = 133.5"$

USE 99" FOR BOTH

AS DEFLECTION WILL LIKELY CONTROL, DESIGN 1 BM FOR LARGER TRIB.

ASSUME  $a \approx 1''$ :  $Y_2 = 5 - .5 = 4.5''$

W14x38:  $\phi M_n = 425$   $Z_{Qn} = 386$   $386/17.2 = 22.4 \rightarrow 46$  STUDS/BM

W16x36:  $\phi M_n = 389$   $Z_{Qn} = 229$   $229/17.2 = 13.3 \rightarrow 28$  STUDS/BM

W18x35:  $\phi M_n = 397$   $Z_{Qn} = 194$   $194/17.2 = 11.3 \rightarrow 24$  STUDS/BM

W16x31:  $\phi M_n = 346$   $Z_{Qn} = 213$   $213/17.2 = 12.4 \rightarrow 26$  STUDS/BM TRY

Check  $a$ :  $a = \frac{213}{88(17.2)(.85)} = .74'' \checkmark$   
 $\uparrow f_c$   $\uparrow$  FORM

UNECHOED

$W_u = [1.2(39) + 1.6(20)] \left( \frac{10.25+12}{2} \right) + 1.2(31) = .914$  klf  
 $\uparrow$  NO REF OR BM  $\uparrow$  CONSTR  $\uparrow$  BM

$M_u = \frac{.914(33)^2}{8} = 124 < 203$  k-ft  $\checkmark$

NET CONC. DEFL.

$W = 89 \left( \frac{10.25+12}{2} \right) + 31 = .465$  klf  $\Delta = \frac{5(.465)(33)^4(1728)}{384(29000)(825)} = 1.14''$

$\Delta_{max} = \frac{33(12)}{240} = 1.65 \therefore$  ok


LL DEFL.

$W = 83 \left( \frac{10.25+12}{2} \right) = .923$   $\Delta = \frac{5(.923)(33)^4(1728)}{384(29000)(825)} = 1.02$

$\Delta_{max} = \frac{33(12)}{360} = 1.1 \therefore$  ok



GIRDER DESIGN

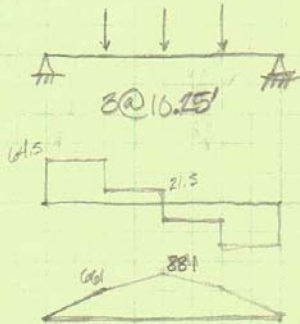

19'-0" SPAN ON OTHER SIDE OF GIRDER

$$P_D = 15.2k \leftarrow [64 \times 10.25] + 91 \times 26$$

$$P_L = 15.3k \leftarrow LL_{RED} = .25 + \frac{15}{141 \times (38+19)} = .5748$$

$$E7.5 \text{ Spaf} \times 10.25' \times 26' = 15.3k$$

$$P_U = 48k$$

$$M_U = 881 k-ft$$

$$b_{eff} = \frac{41 \times 12}{8} \times 2 = 123" \leq \left(\frac{19+83}{2}\right) 12 = 812" \therefore 123" \text{ CONTROLS}$$

$$Y2 = 4.5" \text{ (} a \times 1" \text{)}$$




TRY W21x68:

$$\phi M_n = 881 k-ft \quad \Sigma Q_n = 342 \quad 342 / 17.2 = 19.9 \rightarrow 40 \text{ STUDES/BM}$$

$$a = \frac{342}{89(23)(4)(.75)} = .96 \therefore \text{ok}$$

UNANCHORED

$$P_U = 1.2(15.3) + 1.6 \left( \frac{20 \times 10.25 \times 26'}{1000} \right) = 26.9$$




+  
MOMENT FROM SELF WT

$$W21x68: \phi M_n = 600 k-ft > 564.3 \therefore \text{ok}$$

$$\frac{.006(41)^2}{8} = 14.3 + 550 = 564.3 \text{ ft-k}$$

WET CONC. DEFL.

ASSUMPTION: SUPER POSITION  
OF DEFL AS EQUAL TO REAL



$$P = [(89 \times 10.25) + 35] 26' = 11.3 \text{ k}$$

$$\frac{Pa(3l^2 - 4a^2)}{24EI} + \frac{Pl^3}{48EI} + \frac{5wl^4}{384EI}$$

$$1728 < \left[ \frac{11.3(10.25)}{24(29000)(480)} (3(41)^2 - 4(10.25)^2) + \frac{11.3(41)^3}{48(29000)(480)} + \frac{5(.016)(41)^4}{384(29000)(480)} \right]$$

$$\Delta = 1.05''$$

$$\Delta_{\text{max}} = \frac{12 \times 41}{240} = 2.05'' \checkmark$$

LL DEFL.

SAME ASSUMPTION:


$$P = [(57.5 \times 10.25) 26' = 15.3 \text{ k}$$

$$\frac{1728}{29000(2600)} \left[ \frac{15.3(10.25)}{24} (3(41)^2 - 4(10.25)^2) + \frac{15.3(41)^3}{48} \right]$$

$$\Delta = 1.18''$$

$$\Delta_{\text{max}} = \frac{12 \times 41}{360} = 1.37'' \checkmark$$

Appendix E – RAM Designs

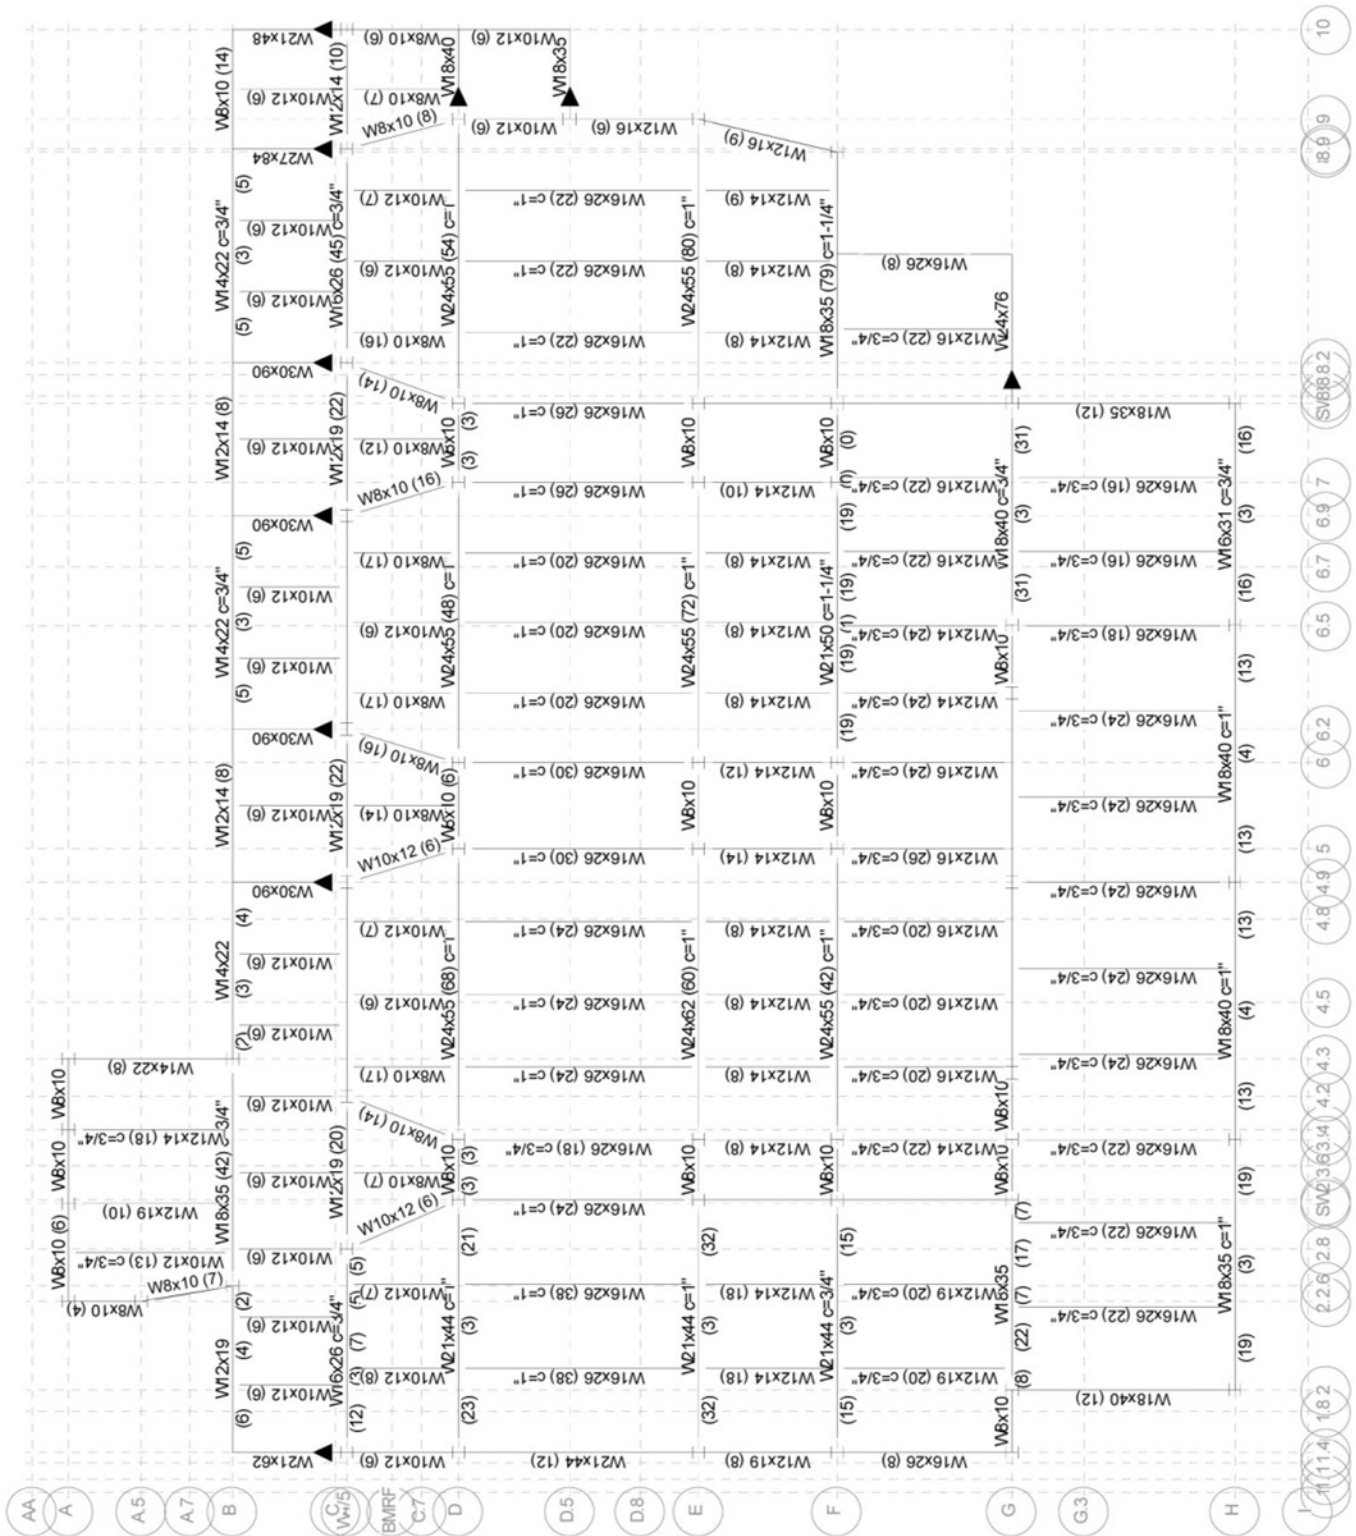

Appendix F – MD Preliminary Sizing

Braced Frame 2 - 50%								Size Selection							
Story Ht	Bay Length	Brace Length	Shear	Axial Force	Inc By Tor	Trial Size, A = P/F	Size	A	r	KL/r	Fe	Fcr	P	Optimized	
19	24	30.61	33.05	42.15	50.58	1.01	HSS6x6x3/8	7.58	2.28	161.11	11.03	9.67	65.97	HSS8x8x3/8	
17	24	29.41	103.6	126.96	152.35	3.05	HSS8x8x3/8	10.4	3.1	113.85	22.08	19.37	181.27	HSS8x8x3/8	
17	24	29.41	142.85	175.06	210.07	4.20	HSS9x9x3/8	11.8	3.51	100.55	28.31	23.30	247.47	HSS9x9x5/8	
17	24	29.41	186.4	228.42	274.11	5.48	HSS10x10x3/8	13.2	3.92	90.03	35.31	26.67	316.79	HSS9x9x5/8	
15.5	24	28.57	230.8	274.75	329.70	6.59	HSS9x9x5/8	18.7	3.4	100.84	28.15	23.21	390.66	HSS10x10x5/8	
14	24	27.78	268.32	310.64	372.76	7.46	HSS9x9x5/8	18.7	3.4	98.06	29.76	24.09	405.42	HSS10x10x5/8	
15	19	24.21	301.68	384.36	461.24	9.22	HSS9x9x5/8	18.7	3.4	85.44	39.21	28.15	473.79	HSS10x10x5/8	
10	19	21.47	301.68	340.91	409.10	8.18	HSS9x9x5/8	18.7	3.4	75.78	49.84	31.26	526.11	HSS10x10x5/8	

Braced Frame 3 - 50%								Size Selection							
Story Ht	Bay Length	Brace Length	Shear	Axial Force	Inc By Tor	Trial Size, A = P/F	Size	A	r	KL/r	Fe	Fcr	P	Optimized	
19	24	30.61	33.05	42.15	50.58	1.01	HSS6x6x3/8	7.58	2.28	161.11	11.03	9.67	65.97	HSS8x8x3/8	
17	24	29.41	103.6	126.96	152.35	3.05	HSS8x8x3/8	10.4	3.1	113.85	22.08	19.37	181.27	HSS8x8x3/8	
17	24	29.41	142.85	175.06	210.07	4.20	HSS9x9x3/8	11.8	3.51	100.55	28.31	23.30	247.47	HSS9x9x3/8	
17	24	29.41	186.4	228.42	274.11	5.48	HSS10x10x3/8	13.2	3.92	90.03	35.31	26.67	316.79	HSS9x9x3/8	
15.5	24	28.57	230.8	274.75	329.70	6.59	HSS9x9x5/8	18.7	3.4	100.84	28.15	23.21	390.66	HSS9x9x5/8	
14	24	27.78	268.32	310.64	372.76	7.46	HSS9x9x5/8	18.7	3.4	98.06	29.76	24.09	405.42	HSS9x9x5/8	
15	24	28.30	301.68	355.76	426.91	8.54	HSS10x10x5/8	21	3.8	89.37	35.83	26.88	508.00	HSS10x10x5/8	
10	24	26.00	301.68	326.82	392.18	7.84	HSS9x9x5/8	18.7	3.4	91.76	33.99	26.11	439.38	HSS10x10x5/8	

Braced Frame 4 - 25% Chevron (Assuming only half is in compr)								Size Selection							
Story Ht	Bay Length	Brace Length	Shear	Axial Force	Inc By Tor	Trial Size, A = P/F	Size	A	r	KL/r	Fe	Fcr	P	Optimized	
19	29.33	24.00	8.2625	13.52	16.23	0.32	HSS4x4x5/16	4.1	1.49	193.299	7.66	6.72	24.79		
17	29.33	22.45	25.90	39.65	47.58	0.95	HSS5x5x3/8	6.18	1.87	144.0727	13.79	12.09	67.26	HSS5x5x3/8	
17	29.33	22.45	35.71	54.67	65.61	1.31	HSS5x5x3/8	6.18	1.87	144.0727	13.79	12.09	67.26	HSS6x6x3/8	
17	29.33	22.45	43.6375	66.81	80.17	1.60	HSS6x6x3/8	7.58	2.28	118.1649	20.50	17.98	122.64	HSS6x6x3/8	
15.5	29.33	21.34	49.5875	72.15	86.58	1.73	HSS6x6x3/8	7.58	2.28	112.3055	22.69	19.69	134.34	HSS6x6x3/8	
14	29.33	20.27	57.58	79.61	95.53	1.91	HSS6x6x3/8	7.58	2.28	106.7088	25.14	21.38	145.89	HSS6x6x3/8	
15	29.33	20.98	64.8	92.69	111.23	2.22	HSS6x6x3/8	7.58	2.28	110.4087	23.48	20.26	138.21	HSS6x6x3/8	
10	29.33	17.75	64.8	78.43	94.12	1.88	HSS6x6x3/8	7.58	2.28	93.42101	32.80	25.57	174.46	HSS6x6x3/8	

Braced Frame 5 - 25% Chevron (Assuming only half is in compr)								Size Selection							
Story Ht	Bay Length	Brace Length	Shear	Axial Force	Inc By Tor	Trial Size, A = P/F	Size	A	r	KL/r	Fe	Fcr	P	Optimized	
19	29.33	24.00	8.2625	13.52	16.23	0.32	HSS4x4x5/16	4.1	1.49	193.30	7.66	6.72	24.79		
17	29.33	22.45	25.9	39.65	47.58	0.95	HSS5x5x3/8	6.18	1.87	144.07	13.79	12.09	67.26	HSS5x5x3/8	
17	29.33	22.45	35.713	54.67	65.61	1.31	HSS5x5x3/8	6.18	1.87	144.07	13.79	12.09	67.26	HSS6x6x3/8	
17	29.33	22.45	43.638	66.81	80.17	1.60	HSS6x6x3/8	7.58	2.28	118.16	20.50	17.98	122.64	HSS6x6x3/8	
15.5	29.33	21.34	49.588	72.15	86.58	1.73	HSS6x6x3/8	7.58	2.28	112.31	22.69	19.69	134.34	HSS6x6x3/8	
14	29.33	20.27	57.58	79.61	95.53	1.91	HSS6x6x3/8	7.58	2.28	106.71	25.14	21.38	145.89	HSS6x6x3/8	
15	29.33	20.98	64.8	92.69	111.23	2.22	HSS6x6x3/8	7.58	2.28	110.41	23.48	20.26	138.21	HSS6x6x3/8	
10	20	22.36	129.6	144.90	173.88	3.48	HSS8x8x3/8	10.4	3.1	86.56	38.20	27.79	260.11	HSS8x8x3/8	

Note: Bottom Floor Not Chevron

Braced Frame 1 - 50%								Size Selection							
Bay Length	Brace Length	Shear	Axial Force	Inc By Tor	Trial Size, A = P/F	Size	A	r	KL/r	Fe	Fcr	P	Optimized		
19	26	32.20	33.05	40.93	49.12	0.98	HSS6x6x3/8	7.58	2.28	169.4868	9.96	8.74	59.61	HSS8x8x3/8	
17	26	31.06	103.6	123.78	148.54	2.97	HSS8x8x1/2	13.5	3.04	122.6228	19.04	16.69	202.83	HSS8x8x3/8	
17	26	31.06	142.85	170.68	204.81	4.10	HSS8x8x1/2	13.5	3.04	122.6228	19.04	16.69	202.83	HSS9x9x1/2	
17	26	31.06	174.55	208.55	250.26	5.01	HSS9x9x1/2	15.3	3.45	108.0503	24.52	20.97	288.82	HSS9x9x1/2	
15.5	26	30.27	198.35	230.92	277.11	5.54	HSS9x9x5/8	18.7	3.4	106.834	25.08	21.35	359.26	HSS9x9x5/8	
14	26	29.53	230.32	261.59	313.90	6.28	HSS9x9x5/8	18.7	3.4	104.2223	26.35	22.15	372.83	HSS9x9x5/8	
15	26	30.02	259.2	299.24	359.09	7.18	HSS10x10x5/8	21	3.8	94.78946	31.85	25.13	475.04	HSS10x10x5/8	
10	26	27.86	259.2	277.71	333.25	6.67	HSS10x10x5/8	21	3.8	87.96877	36.99	27.33	516.59	HSS10x10x5/8	

Note: One Frame, Top Brace takes entire shear

Braced Frame 1: One Frame												
Column Betw Lines 6 and 6.5												
Floor	Ht	Length	Trib Area	Infl Area	DL(psf)	LL Reduction	LL	P	P From Vb	Total P	947.95	Optimized
Roof	19	26	482	1931	80	0.59	59.14	78.63	869.3169231	1083.87	W14x132	Optimized
Pent	17	26	482	1931	110	0.49	150.00	214.56	869.3169231	1151.69	W14x132	W14x82
5th	17	26	482	1931	80	0.45	44.71	282.38	869.3169231	1218.24	W14x132	W14x120
4th	17	26	482	1931	80	0.42	42.07	348.92	869.3169231	1283.92	W14x132	W14x120
3rd	15.5	26	482	1931	80	0.40	40.27	414.60	869.3169231	1349.47	W14x132	W14x120
2nd	14	26	482	1931	80	0.40	40.00	480.16	869.3169231	1415.03	W14x145	W14x176
1st	15	26	482	1931	80	0.40	40.00	545.71	869.3169231	1480.58	W14x145	W14x176
Terrace	10	26	482	1931	80	0.40	40.00	611.26	869.3169231		W14x159	W14x176

Braced Frame 1: One Frame												
Column 4.9												
Floor	Ht	Length	Trib Area	Infl Area	DL(psf)	LL Reduction	LL	P	P From Vb	Total P	981.03	Optimized
Roof	19	26	711	2844	80	0.53	53.13	111.72	869.3169231	1181.54	W14x132	Optimized
Pent	17	26	711	2844	110	0.45	150.00	312.22	869.3169231	1279.11	W14x132	W14x82
5th	17	26	711	2844	80	0.41	41.24	409.80	869.3169231	1375.81	W14x145	W14x120
4th	17	26	711	2844	80	0.40	40.00	506.49	869.3169231	1472.51	W14x145	W14x120
3rd	15.5	26	711	2844	80	0.40	40.00	603.19	869.3169231	1569.20	W14x159	W14x176
2nd	14	26	711	2844	80	0.40	40.00	699.88	869.3169231	1665.90	W14x159	W14x176
1st	15	26	711	2844	80	0.40	40.00	796.58	869.3169231	1762.59	W14x176	W14x176
Terrace	10	26	711	2844	80	0.40	40.00	893.28	869.3169231		W14x176	W14x176

Braced Frame 2 and 3												
Column 4.2/4.9 and 6.2/6.9												
Floor	Ht	Length	Trib Area	Infl Area	DL(psf)	LL Reduction	LL	P	P From Vb	Total P	450.43	Optimized
Roof	19	29.33	390	1560	80	0.63	62.98	65.12	385.3092397	560.41	W14x82	Optimized
Pent	17	29.33	390	1560	110	0.52	150.00	175.10	385.3092397	616.15	W14x90	W14x53
5th	17	29.33	390	1560	80	0.47	46.93	230.84	385.3092397	670.75	W14x90	W14x68
4th	17	29.33	390	1560	80	0.44	43.99	285.44	385.3092397	724.56	W14x90	W14x68
3rd	15.5	29.33	390	1560	80	0.42	41.98	339.25	385.3092397	777.80	W14x90	W14x68
2nd	14	29.33	390	1560	80	0.41	40.50	392.49	385.3092397	830.84	W14x99	W14x99
1st	15	29.33	390	1560	80	0.40	40.00	445.53	385.3092397	883.88	W14x99	W14x99
Terrace	10	29.33	390	1560	80	0.40	40.00	498.57	385.3092397		W14x99	W14x99

Braced Frame 2 and 3												
Column G/F												
Floor	Ht	Length	Trib Area	Infl Area	DL(psf)	LL Reduction	LL	P	P From Vb	Total P	1171.80	Optimized
Roof	19	24	503	2014	80	0.58	58.42	81.70	1096.104	1319.65	W14x145	Optimized
Pent	17	24	503	2014	110	0.49	150.00	223.55	1096.104	1459.49	W14x145	W14x82
5th	17	24	503	2014	80	0.44	44.30	294.12	1096.104	1527.90	W14x145	W14x120
4th	17	24	503	2014	80	0.42	41.71	363.38	1096.104	1596.30	W14x159	W14x120
3rd	15.5	24	503	2014	80	0.40	40.00	431.79	1096.104	1664.71	W14x159	W14x120
2nd	14	24	503	2014	80	0.40	40.00	500.20	1096.104	1733.12	W14x159	W14x176
1st	15	24	503	2014	80	0.40	40.00	568.61	1096.104		W14x176	W14x176
Terrace	10	24	503	2014	80	0.40	40.00	637.02	1096.104		W14x176	W14x176



## Appendix G – MD Story Drifts

Story	Height	QCX-100Y-30E Amplified by Cd/I				Δa = .015sx		
		δxe	δye	δx	δy			
Roof	19.00	2.95	1.09	7.67	2.83	1.79	0.34	3.42
Penthouse	17.00	2.26	0.96	5.98	2.50	1.33	0.65	3.06
Level5	17.00	1.75	0.71	4.55	1.85	1.12	0.49	3.06
Level4	17.00	1.32	0.52	3.43	1.35	1.17	0.52	3.06
Level3	15.50	0.87	0.32	2.26	0.83	0.96	0.36	2.79
Level2	14.00	0.50	0.18	1.30	0.47	0.62	0.26	2.52
Level1	15.00	0.26	0.08	0.68	0.21	0.88	0.21	2.70

Story	Height	QCX30Y100 Amplified by Cd/I				Δa = .015sx		
		δxe	δye	δx	δy			
Roof	19.00	0.99	3.56	2.57	9.26	0.65	1.51	3.42
Penthouse	17.00	0.74	2.98	1.92	7.75	0.39	1.92	3.06
Level5	17.00	0.59	2.24	1.53	5.82	0.39	1.61	3.06
Level4	17.00	0.44	1.62	1.14	4.21	0.42	1.61	3.06
Level3	15.50	0.28	1.00	0.73	2.60	0.29	1.20	2.79
Level2	14.00	0.17	0.54	0.44	1.40	0.23	0.86	2.52
Level1	15.00	0.08	0.21	0.21	0.55	0.21	0.55	2.70

Story	Height	QCX100Y30E Amplified by Cd/I				Δa = .015sx		
		δxe	δye	δx	δy			
Roof	19.00	2.80	1.08	7.28	2.81	1.59	0.44	3.42
Penthouse	17.00	2.19	0.91	5.69	2.37	1.27	0.60	3.06
Level5	17.00	1.70	0.68	4.42	1.77	1.34	0.42	3.06
Level4	17.00	1.26	0.52	3.28	1.35	1.09	0.57	3.06
Level3	15.50	0.84	0.30	2.18	0.78	0.94	0.39	2.79
Level2	14.00	0.48	0.15	1.25	0.39	0.65	0.23	2.52
Level1	15.00	0.23	0.06	0.60	0.16	0.60	0.16	2.70

Story	Height	QCX30Y100- Amplified by Cd/I				Δa = .015sx		
		δxe	δye	δx	δy			
Roof	19.00	0.87	3.56	2.26	9.26	0.52	1.66	3.42
Penthouse	17.00	0.67	2.92	1.71	7.69	0.39	1.82	3.06
Level5	17.00	0.52	2.22	1.35	5.77	0.36	1.64	3.06
Level4	17.00	0.38	1.59	0.99	4.13	0.34	1.53	3.06
Level3	15.50	0.25	1.00	0.65	2.60	0.26	1.25	2.79
Level2	14.00	0.15	0.52	0.39	1.35	0.18	0.81	2.52
Level1	15.00	0.08	0.21	0.21	0.55	0.21	0.55	2.70

Story	Height	QCX Direct Y Amplified by Cd/I				Δa = .015sx		
		δxe	δye	δx	δy			
Roof	19.00	-	3.55	-	9.23	-	1.56	3.42
Penthouse	17.00	-	2.95	-	7.67	-	1.85	3.06
Level5	17.00	-	2.24	-	5.82	-	1.64	3.06
Level4	17.00	-	1.61	-	4.13	-	1.59	3.06
Level3	15.50	-	1.00	-	2.60	-	1.20	2.79
Level2	14.00	-	0.54	-	1.40	-	0.88	2.52
Level1	15.00	-	0.20	-	0.52	-	0.52	2.70

Story	Height	QCX EY + Ecc Amplified by Cd/I				Δa = .015sx		
		δxe	δye	δx	δy			
Roof	19.00	-	3.55	-	9.23	-	1.53	3.42
Penthouse	17.00	-	2.96	-	7.70	-	1.82	3.06
Level5	17.00	-	2.26	-	5.88	-	1.66	3.06
Level4	17.00	-	1.62	-	4.21	-	1.59	3.06
Level3	15.50	-	1.01	-	2.63	-	1.25	2.79
Level2	14.00	-	0.53	-	1.38	-	0.78	2.52
Level1	15.00	-	0.23	-	0.60	-	0.60	2.70

Story	Height	QCX EY - Amplified by Cd/I				Δa = .015sx		
		δxe	δye	δx	δy			
Roof	19.00	-	3.56	-	9.26	-	1.61	3.42
Penthouse	17.00	-	2.94	-	7.64	-	1.92	3.06
Level5	17.00	-	2.20	-	5.72	-	1.59	3.06
Level4	17.00	-	1.59	-	4.13	-	1.61	3.06
Level3	15.50	-	0.97	-	2.52	-	1.20	2.79
Level2	14.00	-	0.51	-	1.33	-	0.78	2.52
Level1	15.00	-	0.21	-	0.55	-	0.55	2.70

Story	Height	QCX Direct X Amplified by Cd/I				Δa = .015sx		
		δxe	δye	δx	δy			
Roof	19.00	2.86	-	7.44	-	1.74	-	3.42
Penthouse	17.00	2.19	-	5.69	-	1.20	-	3.06
Level5	17.00	1.73	-	4.50	-	1.17	-	3.06
Level4	17.00	1.28	-	3.33	-	1.14	-	3.06
Level3	15.50	0.84	-	2.18	-	0.88	-	2.79
Level2	14.00	0.50	-	1.30	-	0.73	-	2.52
Level1	15.00	0.22	-	0.57	-	0.57	-	2.70

Story	Height	QCX EY + Ecc Amplified by Cd/I				Δa = .015sx		
		δxe	δye	δx	δy			
Roof	19.00	2.93	-	7.62	-	1.77	-	3.42
Penthouse	17.00	2.25	-	5.85	-	1.25	-	3.06
Level5	17.00	1.77	-	4.60	-	1.20	-	3.06
Level4	17.00	1.31	-	3.41	-	1.14	-	3.06
Level3	15.50	0.87	-	2.26	-	0.94	-	2.79
Level2	14.00	0.51	-	1.33	-	0.70	-	2.52
Level1	15.00	0.24	-	0.62	-	0.62	-	2.70

Story	Height	QCX EY - Ecc Amplified by Cd/I				Δa = .015sx		
		δxe	δye	δx	δy			
Roof	19.00	2.79	-	7.25	-	1.61	-	3.42
Penthouse	17.00	2.17	-	5.64	-	1.25	-	3.06
Level5	17.00	1.69	-	4.39	-	1.14	-	3.06
Level4	17.00	1.25	-	3.25	-	1.04	-	3.06
Level3	15.50	0.85	-	2.21	-	0.88	-	2.79
Level2	14.00	0.51	-	1.33	-	0.75	-	2.52
Level1	15.00	0.22	-	0.57	-	0.57	-	2.70

## Appendix H – Foundation Spreadsheets

Col Line 1.4			2			2.5			2.6			2.8			3			SW2		
G	Load	Db	H	Load	Db	A.5	Load	Db	B	Load	Db	SW4/5 - C	Load	Db	A	Load	Db	D	Load	Db
W10x33	74	2.5	W10x49 W10x45 W10x33	267	2.5	W10x33	45	2.5	W10x60 W10x49 W10x45	354	2.5	W10x60 W10x49 W10x39	350	2.5	W10x33	136	2.5	W12x72 W12x65 W12x53	502	3
F			G			A														
W10x60 W10x49 W10x45	352	2.5	W10x68 W10x54 W10x49	377	2.5	W10x33	63	2.5												
E																				
W10x77 W10x60 W10x49	438	2.5																		
D																				
W10x68 W10x54 W10x49	408	2.5																		
SW4/5 - C																				
W12x72 W12x65 W12x58	308	2.5																		
3.9			4			4.3			4.9			5			6			6.5		
H	Load	Db	A	Load	Db	B	Load	Db	H	Load	Db	F	Load	Db	F	Load	Db	H	Load	Db
W14x82 W14x68 W14x61	513	2.5	W10x33	117	2.5	W10x60 W10x49 W10x45	365	2.5	W10x88 W10x68 W10x49	521	3	W12x79 W12x65 W12x58	535	3	W12x79 W12x65 W12x53	521	3	W10x77 W10x60 W10x49	484	2.5
G						A						E			E			G		
W10x49 W10x45 W10x33	276	2.5				W10x33	65	2.5				W12x96 W12x79 W12x65	650	3	W12x96 W12x79 W12x65	630	3	W12x79 W12x65 W12x53	537	3
F												D			D					
W12x79 W12x65 W12x53	500	3										W12x87 W12x72 W12x65	602	3	W12x87 W12x72 W12x65	587	3			
E																				
W12x87 W12x72 W12x65	607	3																		
D																				
W12x87 W12x72 W12x58	563	3																		
7			SW3			8.2			8.8			8.9			9			10		
F	Load	Db	H	Load	Db	SW4/5 - C	Load	Db	F	Load	Db	SW4/5 - C	Load	Db	E	Load	Db	SW4/5 - C	Load	Db
W12x72 W12x65 W12x53	501	3	W10x49 W10x45 W10x39	238	2.5	W14x120 W14x99 W14x90	521	3	W10x49 W10x45 W10x39	247	2.5	W14x109 W14x90	501	3	W12x72 W12x65 W12x53	447	2.5	W14x53 W14x48	191	2.5
E			D												D.5					
W12x96 W12x72 W12x65	620	3	W12x87 W12x79 W12x65	580	3										W10x60 W10x54 W10x49	178	2.5			
D															D					
W12x87 W12x72 W12x65	576	3													W14x99 W14x90	570	3			

Bearing 80000 psf  
 Friction 800 psf

Db	L	Bearing	Skin	Total
2.5	35	392.70	188.50	581.19
3	35	565.49	226.19	791.68
3.5	35	769.69	263.89	1033.58
4	35	1005.31	301.59	1306.90
4.5	35	1272.34	339.29	1611.64
5	35	1570.80	376.99	1947.79
5.5	35	1900.66	414.69	2315.35
6	35	2261.94	452.39	2714.33
6.5	35	2654.64	490.09	3144.73
7	35	3078.76	527.79	3606.55

## Appendix I – SCBF Design

ASTM 508  
GRADE B

INVERTED V-CHEVRON-BEAM DESIGN      BRACE = HSS 8x8x1/2

MAX DEPTH = 36"

ASSUMED FORCE IN TENSION:  $P_t = R_y F_y A_g = 1.4(13.5)(46) = 869 \text{ k}$

"      IN COMPRESSION:  $P_c = .3P_n = .3(13.5)(28.2) = 114 \text{ k}$

UNBALANCED FORCE ON BM:  $Q_b = P_{cy} - P_{cy}$

$P_{cy} = 869 \left( \frac{17}{22.5} \right) = 657 \text{ k}$

$P_{cy} = 114 \left( \frac{17}{22.5} \right) = 86 \text{ k}$

$Q_b = 657 - 86 = 571 \text{ k}$

AXIAL FORCE IN BM:

$P_{cx} = 869 \left( \frac{14.7}{22.5} \right) = 568 \text{ k}$

$P_{cx} = 114 \left( \frac{14.7}{22.5} \right) = 75 \text{ k}$

$P_u = \frac{568 + 75}{2} = 322 \text{ k}$

MOMENT IN BM: (POINT LOADS APPROXIMATED AS DISTRIB. FOR SIMPLICITY)

ASSUME BM SELF WT = 350 PLF

DL = 80 PSF

LL = 150 PSF ← PENULTIMATE = WORST CASE

TRIB AREA = 15'

$M_D = (80 \times 15 + 350)(29.33)^2 / 8 = 167 \text{ k-ft}$

$M_L = (150 \times 15)(29.33)^2 / 8 = 242 \text{ k-ft}$

$M_Q = 571(29.33) / 4 = 4189 \text{ k-ft}$

$M_u = 1.2M_D + .5M_L + 1.0M_Q = 4544 \text{ k-ft}$

TRY 38x354

$$\lambda_f = b_f/2t_f = 8.85 \quad \lambda_p = .38 \sqrt{\frac{29000}{50}} = 9.15 \quad \text{: FLANGE COMPACT}$$

$$\lambda_w = W_{tw} = 25.7 \quad \lambda_p = 3.76 \sqrt{\frac{29000}{50}} = 70.6 \quad \text{: WEB COMPACT}$$

$$L_b = \frac{29.53}{2} - \frac{d_c}{2} = 14.7 - 14.2/2 = 14.1'$$

TABLE 3-2

$$L_p = 13.2 \quad \phi M_p = 5830$$

$$L_r = 49.8 \quad \phi M_r = 3260$$

$$\phi M_n = 5278 \text{ k-ft}$$

COMPRESSIVE STR.

$$\frac{K L_c}{r_x} = \frac{29.53(12)}{14.5} = 24.3$$

$$\phi F_{cr} = 38.2 \quad \text{TABLE 4-22}$$

$$\frac{K L_y}{r_y} = \frac{14.7(12)}{3.74} = 47.2$$

$$\phi P_{nc} = 3973 \text{ k}$$

SECOND ORDER EFFECTS

$$P_{e1} = \pi^2 EI / (KL)^2 = 50832$$

$$P_r = 322$$

$$M_{rx} = 1.01(4544) = 4589$$

$$C_m = 1$$

$$B_1 = \frac{1}{1 - 322/50832} = 1.01$$

COMBO LOADING

$$P_r/P_c = 322/3973 = .081 < .2 \quad \therefore \frac{P_r}{2P_c} + \left[ \frac{M_{rx}}{M_{cx}} + \frac{M_{ry}}{M_{cy}} \right] < 1.0$$

$$= \frac{.081}{2} + \frac{4589}{5278} = .91 < 1 \quad \checkmark$$

$$\text{SHEAR: } V_u = 57V/2 + 1.2 [(0.8(15+318)(29.53)/2] + .5 [(1.15(15)(29.53)/2]$$

$$= 329 \text{ k}$$

$$\text{TABLE 3-2: } \phi V_n = 1240 \text{ k} \quad \checkmark$$

LATERAL BRACE REQ:

$$P_{br} = .02 M_{rx} L_d / h_o = .02 (4589)(12) / 33.5 = 38 \text{ k} \quad \leftarrow \text{MIN. BRACE STR @ MIDSPAN}$$

BRACE TO BEAM CONNECTION

BRACE = HSS 8 x 8 x 1/2  
 BM = W33 x 354  
 PL = A36 STL

$T_u = 869$

BRACE TO GUSSET WELD:  $D \leq \frac{F_u B t}{3.09 k/in} = \frac{58(.5)}{3.09} = 9.4$  SIXTEENTHS

TRY (4) 1/2" WELDS  $l_w = \frac{P_u}{4(1.392)D} = \frac{869}{4(1.392)(.5)} = 19.5"$

USE (4) 20" LONG, 1/2" FILLET WELDS

GUSSET PL THICKNESS

$t_{min} = \frac{P_u}{2\phi(.6F_u)L} = \frac{869}{2(.75)(.6(58))(20)} = .83$  TRY 1"


SHEAR LAG

$\phi R_t F_u A_e = R_y F_y A_g$   
 $.75(58)(1.5)A_e \geq 869$   
 $A_e \geq 15.4$

$A_e = A_n U$   
 $A_e = A_g - 2(1 + 1/8)t = 13.5 - 2(1.125)(.5) = 12.4$

$U > .85, U = .85$

$A_e = 10.54 < A_{e, req} = \frac{15.4}{.85} = 18.12$

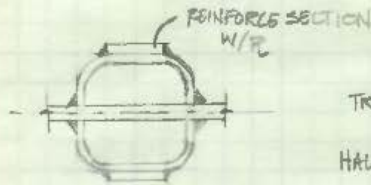

TRY 5/8" PL, WORKABLE FLAT = 5.75 in, MAX 5.25 in WIDE

$\bar{x}$	A	A $\bar{x}$
3	6.75	20.25
4.5125	3.28	14.15

$\bar{x} = 3.43 - \frac{1}{2} = 2.93$

$U = 1 - \frac{1}{20} = .85$

$\phi_e P_n = .75(1.3(12 + 1.2(6.50)))(.85)(58) = 887$  k ✓

WELD FOR COVER PL

MAX WELD =  $t - 1/16 = 9/16$  : USE 1/2"

$l_w = \frac{\phi R_t F_u A_n}{2(1.392)D} = 7.69$  USE 8" LONG, 1/2" FILLET WELDS



$\frac{KL}{r} = \frac{17.7 \times 12}{3.04} = 69.9 \leq 118$

$F_c = 68$   
 $F_{cr} = 34.7$   
 $P_{cr} = 1.1(1.4)(13.5)(34.7) = 721 \text{ k}$

$V = (89 + 721) \left( \frac{14.7}{22.5} \right) = 1039 \text{ k}$   
 $T = (89 - 721) \left( \frac{14.7}{22.5} \right) = 96.7 \text{ k}$   
 $M = V \left( \frac{46}{2} \right) = 1039 \left( \frac{35.6}{2} \right) = 18494 \text{ k-in}$

**WELD @ GUSSET/BEAM INTERFACE**

$S_w = \frac{I^2}{6} = \frac{76.3^2}{6} = 970 \text{ in}^3/\text{in}$   
 $f_v = \frac{1039}{970} = 13.6 \text{ k/in}$   
 $f_a = \frac{96.7}{76.3} = 1.27 \text{ k/in}$   
 $f_D = \frac{18494}{970} = 19.01 \text{ k/in}$

$f_{pe} = \sqrt{f_v^2 + (f_a + f_D)^2} = 24.4$   
 $f_{avg} = \frac{1}{2} \left( \sqrt{4f_v^2 + (f_a - f_D)^2} + \sqrt{f_v^2 + (f_a + f_D)^2} \right) = 23.5$   
 $\frac{24.4}{23.5} = 1.04 < 1.25$   
 $f_r = 1.25 f_{avg} = 29.4$

$D \geq \frac{29.4}{2(1.512)} = 10.6 \text{ SIXTEENTHS}$

FULL LENGTH  $\frac{3}{4}$ " WELD

## GUSSET COMPR. YIELDING

$$r = \frac{t}{\sqrt{12}} = .289 \text{ in}$$

$$\frac{KL}{r} = \frac{1.2(17)}{.289} = 70.6$$

$$\phi F_{cr} = 24.8 \text{ TABLE 4-22}$$

$$L_w = 2l_w \tan 30 + D = 31$$

$$\phi R_n = 770 \text{ k} > 721 \text{ k} \checkmark$$

## GUSSET TENSION YIELD

$$= .9(36)(31)(1) \\ = 1004 \checkmark$$

## CHECK BM WEB LOCAL YIELD

$$f_c = f_b + f_a = 1.27 + 19.01 = 20.3 \text{ k/in}$$

$$f_t = 17.7 \text{ k/in}$$

$$L_t = \left( \frac{f_c}{f_c + f_t} \right) l_g = \frac{17.7}{17.7 + 20.3} (76.8) = 35.5 \text{ in}$$

$$R_u = \frac{1}{2} L_t f_t = 314 \text{ k}$$

$$\phi R_n = 1.0 [(5k + N) F_{y,w} t_w] = (5 \times 2.88 + 35.5)(50)(1.16) = 2894 > 314 \checkmark$$

## BM WEB CRIPPLING

$$R_u = \frac{1}{2} (L_g - L_t) f_c = 414 \text{ k} \quad L_c = \left( \frac{f_c}{f_c + f_t} \right) l_g = 40.8$$

$$R_n = .8 t_w^2 \left[ 1 + 3 \left( \frac{N}{d} \right) \left( \frac{t_w}{t_f} \right)^{1.5} \right] \sqrt{\frac{E F_y t_f}{t_w}} \\ = .8 (1.16)^2 \left[ 1 + 3 \left( \frac{40.8}{35.6} \right) \left( \frac{1.16}{2.09} \right)^{1.5} \right] \sqrt{\frac{29000 (50) (2.09)}{1.16}} \times .75$$

$$\phi R_n = 3160 \text{ k} > 414 \checkmark$$

## FREE EDGE BUCKLING GUSSET

$$L_{fmax} = .79 t \sqrt{E / F_y} = 21.2$$

ADD  $3/8" \times 8 1/2"$  W/  $1/4"$  FLUET @ YIELD LINES



Appendix J – MRSA

Mode	Period	UX	UY	Cmi	(Cmi*Ux)^2	(Cmi*Uy)^2	Sa	/(R/I)
1	1.725041	0.5152	70.4698	0.072462	1.394E-07	2.608E-03	0.347818	0.072462046
2	1.60468	31.7643	1.2925	0.077897	6.122E-04	1.014E-06	0.373906	0.077897151
3	1.183462	41.2288	0.0039	0.105622	1.896E-03	1.697E-11	0.506987	0.105622318
4	0.471367	0.001	19.9877	0.208333	4.340E-12	1.734E-03	1	0.208333333
5	0.414642	14.7315	0.0005	0.208333	9.419E-04	1.085E-12	1	0.208333333
6	0.401094	0.0144	0.6507	0.208333	9.000E-10	1.838E-06	1	0.208333333
7	0.271695	5.7715	0.2072	0.208333	1.446E-04	1.863E-07	1	0.208333333
SUM		94.0267	92.6123		3.595E-03	4.345E-03		

Cmx 0.0600  
Cmy 0.0659

x=North y=South

W	15447.65						
MRSA	ELF			% Deduction	%Allowable	MRSA Vfir	With p = 1.3
Vbx	926.2405	Vbx	1622.518	0.570866118	0.85	1379.14	1792.882
Vby	1018.202	Vby	1622.518	0.627544472	0.85	1379.14	1792.882

### Appendix K – CA Layout 1 Preliminary Sizes

Braced Frame 2 - 50%							Size Selection							
Story Ht	Bay Length	Brace Length	Shear	Axial Force	Inc By Tor	Trial Size, A = P/F	Size	A	r	KL/r	Fe	Fcr	P	Optimized
19	24	30.61	134.1795	171.14	205.36	4.11	HSS8x8x1/2	13.5	3.04	120.83	19.60	17.19	208.89	W14x176
17	24	29.41	420.875	515.76	618.92	12.38	HSS12x12x5/8	25.7	4.62	76.39	49.05	32.63	754.81	W14x176
17	24	29.41	560.82	687.26	824.71	16.49	W14x132	38.8	3.76	93.86	32.49	26.25	916.79	W14x176
17	24	29.41	709.085	868.95	1042.74	20.85	W14x145	42.7	3.98	88.68	36.40	28.14	1081.29	W14x176
15.5	24	28.57	805.805	959.25	1151.10	23.02	W14x159	46.7	4	85.71	38.96	29.22	1228.15	W14x193
14	24	27.78	873.34	1011.07	1213.28	24.27	W14x159	46.7	4	83.35	41.19	30.08	1264.44	W14x193
15	19	24.21	899.405	1145.91	1375.09	27.50	W14x159	46.7	4	72.62	54.27	34.00	1429.08	W14x211
10	19	21.47	899.405	1016.37	1219.64	24.39	W14x145	42.7	3.98	64.74	68.30	36.80	1414.37	W14x132

Braced Frame 3 - 50%							Size Selection							
Story Ht	Bay Length	Brace Length	Shear	Axial Force	Inc By Tor	Trial Size, A = P/F	Size	A	r	KL/r	Fe	Fcr	P	Optimized
19	24	30.61	134.18	171.14	205.36	4.11	HSS8x8x1/2	13.5	3.04	120.83	19.60	17.19	208.89	W14x176
17	24	29.41	420.88	515.76	618.92	12.38	HSS12x12x5/8	25.7	4.62	76.39	49.05	32.63	754.81	W14x176
17	24	29.41	560.82	687.26	824.71	16.49	W14x132	38.8	3.76	93.86	32.49	26.25	916.79	W14x176
17	24	29.41	709.09	868.95	1042.74	20.85	W14x145	42.7	3.98	88.68	36.40	28.14	1081.29	W14x176
15.5	24	28.57	805.81	959.25	1151.10	23.02	W14x159	46.7	4	85.71	38.96	29.22	1228.15	W14x193
14	24	27.78	873.34	1011.07	1213.28	24.27	W14x159	46.7	4	83.35	41.19	30.08	1264.44	W14x193
15	24	28.30	899.41	1060.62	1272.75	25.45	W14x159	46.7	4	84.91	39.70	29.52	1240.54	W14x193
10	24	26.00	899.41	974.36	1169.23	23.38	W14x145	42.7	3.98	78.39	46.58	31.90	1226.03	W14x159

Braced Frame 4 - 25% Chevron (Assuming only half is in compr)							Size Selection							
Story Ht	Bay Length	Brace Length	Shear	Axial Force	Inc By Tor	Trial Size, A = P/F	Size	A	r	KL/r	Fe	Fcr	P	Optimized
19	29.33	24.00	33.544875	54.90	65.88	1.32	HSS6x6x3/8	7.58	2.28	126.3226	17.94	15.73	107.31	
17	29.33	22.45	105.22	161.08	193.30	3.87	HSS8x8x1/2	13.5	3.04	88.62367	36.44	28.16	342.09	HSS8x8x1/2
17	29.33	22.45	140.21	214.65	257.58	5.15	HSS8x8x1/2	13.5	3.04	88.62367	36.44	28.16	342.09	HSS8x8x1/2
17	29.33	22.45	177.27125	271.39	325.67	6.51	HSS8x8x1/2	13.5	3.04	88.62367	36.44	28.16	342.09	HSS8x8x1/2
15.5	29.33	21.34	201.45125	293.12	351.74	7.03	HSS8x8x1/2	13.5	3.04	84.22913	40.34	29.76	361.63	HSS8x8x1/2
14	29.33	20.27	218.335	301.85	362.22	7.24	HSS8x8x1/2	13.5	3.04	80.03159	44.69	31.30	380.33	HSS8x8x1/2
15	29.33	20.98	224.85125	321.64	385.97	7.72	HSS9x9x5/8	18.7	3.4	74.0388	52.21	33.49	563.62	HSS9x9x5/8
10	29.33	17.75	224.85125	272.15	326.58	6.53	HSS8x8x1/2	13.5	3.04	70.06576	58.30	34.92	424.28	HSS9x9x5/8

Note: No Top Bracing Currently Planned for Frames 4 and 5

Braced Frame 5 - 25% Chevron (Assuming only half is in compr)							Size Selection							
Story Ht	Bay Length	Brace Length	Shear	Axial Force	Inc By Tor	Trial Size, A = P/F	Size	A	r	KL/r	Fe	Fcr	P	Optimized
19	29.33	24.00	33.545	54.90	65.88	1.32	HSS6x6x3/8	7.58	2.28	126.32	17.94	15.73	107.31	
17	29.33	22.45	105.22	161.08	193.30	3.87	HSS8x8x1/2	13.5	3.04	88.62	36.44	28.16	342.09	HSS8x8x1/2
17	29.33	22.45	140.21	214.65	257.58	5.15	HSS8x8x1/2	13.5	3.04	88.62	36.44	28.16	342.09	HSS8x8x1/2
17	29.33	22.45	177.27	271.39	325.67	6.51	HSS8x8x1/2	13.5	3.04	88.62	36.44	28.16	342.09	HSS8x8x1/2
15.5	29.33	21.34	201.45	293.12	351.74	7.03	HSS8x8x1/2	13.5	3.04	84.23	40.34	29.76	361.63	HSS8x8x1/2
14	29.33	20.27	218.34	301.85	362.22	7.24	HSS8x8x1/2	13.5	3.04	80.03	44.69	31.30	380.33	HSS8x8x1/2
15	29.33	20.98	224.85	321.64	385.97	7.72	HSS9x9x5/8	18.7	3.4	74.04	52.21	33.49	563.62	HSS9x9x5/8
10	20	22.36	449.7	502.78	603.34	12.07	HSS10x10x5/8	21	3.8	70.61	57.40	34.72	656.30	HSS10x10x5/8

Note: Bottom Floor Not Chevron

Braced Frame 1 - 50%							Size Selection							
Bay Length	Brace Length	Shear	Axial Force	Inc By Tor	Trial Size, A = P/F	Size	A	r	KL/r	Fe	Fcr	P	Optimized	
19	26	32.20	134.1795	166.19	199.43	3.99	HSS8x8x1/2	13.5	3.04	127.1151	17.71	15.53	188.75	W14x193
17	26	31.06	420.875	502.86	603.43	12.07	HSS12x12x5/8	25.7	4.62	80.68688	43.96	31.06	718.48	W14x193
17	26	31.06	560.82	670.06	804.07	16.08	W14x132	38.8	3.76	99.14186	29.12	24.37	850.99	W14x193
17	26	31.06	709.085	847.21	1016.65	20.33	W14x145	42.7	3.98	93.66166	32.63	26.33	1011.75	W14x193
15.5	26	30.27	805.805	938.13	1125.76	22.52	W14x145	42.7	3.98	91.26519	34.36	27.19	1045.07	W14x193
14	26	29.53	873.34	991.90	1190.28	23.81	W14x176	51.8	4.02	88.1482	36.84	28.33	1320.71	W14x193
15	26	30.02	899.405	1038.35	1246.02	24.92	W14x176	51.8	4.02	89.60198	35.65	27.80	1295.99	W14x193
10	26	27.86	899.405	963.64	1156.36	23.13	W14x159	46.7	4	83.57033	40.98	30.01	1261.12	W14x193

Note: One Frame, Top Brace takes entire shear

Braced Frame 1: One Frame												
Column Betw Lines 6 and 6.5												
Floor	Ht	Length	Trib Area	Inf Area	DL(psf)	LL Reduction	LL	P	P From Vb	Total P	Size Selection	Optimized
Roof	19	26	482	1931	80	0.59	59.14	72.09	3014.736375	3086.83	91.4	3315.74
Pent	17	26	482	1931	110	0.49	150.00	171.87	3014.736375	3186.60	91.4	3461.34
5th	17	26	482	1931	80	0.45	44.71	228.91	3014.736375	3243.65	91.4	3461.34
4th	17	26	482	1931	80	0.42	42.07	285.32	3014.736375	3300.06	91.4	3461.34
3rd	15.5	26	482	1931	80	0.40	40.27	341.30	3014.736375	3356.03	91.4	3461.34
2nd	14	26	482	1931	80	0.40	40.00	397.21	3014.736375	3411.95	91.4	3461.34
1st	15	26	482	1931	80	0.40	40.00	453.12	3014.736375	3467.86	91.4	3461.34
Terrace	10	26	482	1931	80	0.40	40.00	509.03	3014.736375	3523.77	91.4	3461.34
Braced Frame 1: One Frame												
Column 4.9												
Floor	Ht	Length	Trib Area	Inf Area	DL(psf)	LL Reduction	LL	P	P From Vb	Total P	Size Selection	Optimized
Roof	19	26	711	2844	80	0.53	53.13	104.21	3014.736375	3118.94	91.4	3315.74
Pent	17	26	711	2844	110	0.45	150.00	251.38	3014.736375	3266.12	91.4	3461.34
5th	17	26	711	2844	80	0.41	41.24	334.30	3014.736375	3349.04	91.4	3461.34
4th	17	26	711	2844	80	0.40	40.00	416.78	3014.736375	3431.51	91.4	3461.34
3rd	15.5	26	711	2844	80	0.40	40.00	499.25	3014.736375	3513.99	91.4	3461.34
2nd	14	26	711	2844	80	0.40	40.00	581.73	3014.736375	3596.46	91.4	3461.34
1st	15	26	711	2844	80	0.40	40.00	664.20	3014.736375	3678.94	101	3983.86
Terrace	10	26	711	2844	80	0.40	40.00	746.68	3014.736375	3761.42	91.4	3874.69
Braced Frame 4 and 5												
Column 4.2/4.9 and 6.2/6.9												
Floor	Ht	Length	Trib Area	Inf Area	DL(psf)	LL Reduction	LL	P	P From Vb	Total P	Size Selection	Optimized
Roof	19	29.33	390	1560	80	0.63	62.98	59.08	1336.228192	1395.31	42.7	1511.58
Pent	17	29.33	390	1560	110	0.52	150.00	139.81	1336.228192	1476.04	42.7	1585.68
5th	17	29.33	390	1560	80	0.47	46.93	186.40	1336.228192	1522.63	42.7	1585.68
4th	17	29.33	390	1560	80	0.44	43.99	232.42	1336.228192	1568.65	42.7	1585.68
3rd	15.5	29.33	390	1560	80	0.42	41.98	278.05	1336.228192	1614.27	42.7	1657.90
2nd	14	29.33	390	1560	80	0.41	40.50	323.38	1336.228192	1659.61	42.7	1686.79
1st	15	29.33	390	1560	80	0.40	40.00	368.62	1336.228192	1704.85	46.7	1812.29
Terrace	10	29.33	390	1560	80	0.40	40.00	413.86	1336.228192	1750.09	46.7	1967.66
Braced Frame 2 and 3												
Column 6/F												
Floor	Ht	Length	Trib Area	Inf Area	DL(psf)	LL Reduction	LL	P	P From Vb	Total P	Size Selection	Optimized
Roof	19	24	503	2014	80	0.58	58.42	75.05	3265.964406	3341.02	101	3678.86
Pent	17	24	503	2014	110	0.49	150.00	179.17	3265.964406	3445.14	101	3837.30
5th	17	24	503	2014	80	0.44	44.30	238.60	3265.964406	3504.57	101	3837.30
4th	17	24	503	2014	80	0.42	41.71	297.38	3265.964406	3563.35	101	3837.30
3rd	15.5	24	503	2014	80	0.40	40.00	355.73	3265.964406	3621.69	101	3948.44
2nd	14	24	503	2014	80	0.40	40.00	414.08	3265.964406	3680.04	101	4052.11
1st	15	24	503	2014	80	0.40	40.00	472.43	3265.964406	3738.39	101	3983.86
Terrace	10	24	503	2014	80	0.40	40.00	530.77	3265.964406	3796.74	101	4286.46

## Appendix L – CA Layout 1 Story Drifts

Story	Height	Amplified by Cd/I			Δx	Δy	Δa = .015sx
		δxe	δye	δx			
Roof	19.00	3.16	1.19	12.64	4.76	2.76	0.52
Penthouse	17.00	2.47	1.06	9.88	4.24	1.96	0.81
Level 5	17.00	1.98	0.85	7.92	3.40	1.92	0.80
Level 4	17.00	1.50	0.65	6.00	2.60	1.96	0.88
Level 3	15.50	1.01	0.43	4.04	1.72	1.72	0.72
Level 2	14.00	0.58	0.25	2.32	1.00	1.20	0.60
Level 1	15.00	0.28	0.10	1.12	0.40	1.12	0.40

Story	Height	Amplified by Cd/I			Δx	Δy	Δa = .015sx
		δxe	δye	δx			
Roof	19.00	4.02	1.97	16.08	7.88	2.44	0.36
Penthouse	17.00	3.41	1.88	13.64	7.52	2.84	1.08
Level 5	17.00	2.70	1.46	10.80	5.84	2.76	1.48
Level 4	17.00	2.01	1.09	8.04	4.36	2.72	1.52
Level 3	15.50	1.33	0.71	5.32	2.84	2.44	1.24
Level 2	14.00	0.72	0.40	2.88	1.60	1.76	0.88
Level 1	15.00	0.28	0.18	1.12	0.72	1.12	0.72

Story	Height	Amplified by Cd/I			Δx	Δy	Δa = .015sx
		δxe	δye	δx			
Roof	19.00	1.04	4.02	4.16	16.08	0.84	2.44
Penthouse	17.00	0.83	3.41	3.32	13.64	0.64	2.84
Level 5	17.00	0.67	2.70	2.68	10.80	0.60	2.76
Level 4	17.00	0.52	2.01	2.08	8.04	0.72	2.72
Level 3	15.50	0.34	1.33	1.36	5.32	0.48	2.44
Level 2	14.00	0.22	0.72	0.88	2.88	0.40	1.76
Level 1	15.00	0.12	0.28	0.48	1.12	0.48	1.12

Story	Height	Amplified by Cd/I			Δx	Δy	Δa = .015sx
		δxe	δye	δx			
Roof	19.00	0.88	4.16	3.52	16.64	0.76	2.72
Penthouse	17.00	0.69	3.48	2.76	13.92	0.40	2.96
Level 5	17.00	0.59	2.74	2.36	10.96	0.56	2.76
Level 4	17.00	0.45	2.05	1.80	8.20	0.64	2.64
Level 3	15.50	0.35	1.39	1.40	5.56	0.40	2.32
Level 2	14.00	0.25	0.81	1.00	3.24	0.40	1.80
Level 1	15.00	0.15	0.36	0.60	1.44	0.60	1.44

Story	Height	Amplified by Cd/I			Δx	Δy	Δa = .015sx
		δxe	δye	δx			
Roof	19.00	-	4.48	-	17.92	-	3.32
Penthouse	17.00	-	3.65	-	14.60	-	3.00
Level 5	17.00	-	2.90	-	11.60	-	3.06
Level 4	17.00	-	2.14	-	8.56	-	3.32
Level 3	15.50	-	1.31	-	5.24	-	2.44
Level 2	14.00	-	0.70	-	2.80	-	1.76
Level 1	15.00	-	0.26	-	1.04	-	1.04

Story	Height	Amplified by Cd/I			Δx	Δy	Δa = .015sx
		δxe	δye	δx			
Roof	19.00	-	4.45	-	17.80	-	3.08
Penthouse	17.00	-	3.68	-	14.72	-	2.92
Level 5	17.00	-	2.95	-	11.80	-	2.96
Level 4	17.00	-	2.21	-	8.84	-	2.24
Level 3	15.50	-	1.65	-	6.60	-	2.79
Level 2	14.00	-	0.96	-	3.84	-	2.60
Level 1	15.00	-	0.31	-	1.24	-	1.24

Story	Height	Amplified by Cd/I			Δx	Δy	Δa = .015sx
		δxe	δye	δx			
Roof	19.00	-	4.55	-	18.20	-	3.36
Penthouse	17.00	-	3.71	-	14.84	-	2.76
Level 5	17.00	-	3.02	-	12.08	-	2.92
Level 4	17.00	-	2.29	-	9.16	-	2.92
Level 3	15.50	-	1.56	-	6.24	-	2.80
Level 2	14.00	-	0.86	-	3.44	-	2.36
Level 1	15.00	-	0.27	-	1.08	-	1.08

Story	Height	Amplified by Cd/I			Δx	Δy	Δa = .015sx
		δxe	δye	δx			
Roof	19.00	3.68	-	14.72	-	3.04	3.42
Penthouse	17.00	2.92	-	11.68	-	2.56	3.06
Level 5	17.00	2.28	-	9.12	-	2.32	3.06
Level 4	17.00	1.70	-	6.80	-	2.36	3.06
Level 3	15.50	1.11	-	4.44	-	1.84	2.79
Level 2	14.00	0.65	-	2.60	-	1.36	2.52
Level 1	15.00	0.31	-	1.24	-	1.24	2.70

Story	Height	Amplified by Cd/I			Δx	Δy	Δa = .015sx
		δxe	δye	δx			
Roof	19.00	3.75	-	15.00	-	3.16	3.42
Penthouse	17.00	2.96	-	11.84	-	2.48	3.06
Level 5	17.00	2.34	-	9.36	-	2.40	3.06
Level 4	17.00	1.74	-	6.96	-	2.36	3.06
Level 3	15.50	1.15	-	4.60	-	1.96	2.79
Level 2	14.00	0.66	-	2.64	-	1.40	2.52
Level 1	15.00	0.31	-	1.24	-	1.24	2.70

Story	Height	Amplified by Cd/I			Δx	Δy	Δa = .015sx
		δxe	δye	δx			
Roof	19.00	3.11	-	13.44	-	2.72	3.42
Penthouse	17.00	2.43	-	9.72	-	2.08	3.06
Level 5	17.00	1.91	-	7.64	-	1.96	3.06
Level 4	17.00	1.42	-	5.68	-	1.96	3.06
Level 3	15.50	0.93	-	3.72	-	1.48	2.79
Level 2	14.00	0.56	-	2.24	-	1.20	2.52
Level 1	15.00	0.26	-	1.04	-	1.04	2.70

### Appendix M – CA Layout 2 Preliminary Sizing

Braced Frame 2 - 25%								Size Selection						
Story Ht	Bay Length	Brace Length	Shear	Axial Force	Inc By Tor	Trial Size, A = P/F	Size	A	r	KL/r	Fe	Fcr	P	Optimized
19	24	30.61	103.22	131.64	157.97	3.16	HSS12x12x5/8	25.7	4.62	79.51	45.28	31.49	728.47	HSS9x9x5/8
17	24	29.41	161.88	198.37	238.04	4.76	HSS12x12x5/8	25.7	4.62	76.39	49.05	32.63	754.81	HSS9x9x5/8
17	24	29.41	215.70	264.33	317.20	6.34	HSS12x12x5/8	25.7	4.62	76.39	49.05	32.63	754.81	HSS9x9x5/8
17	24	29.41	272.73	334.21	401.05	8.02	HSS12x12x5/8	25.7	4.62	76.39	49.05	32.63	754.81	HSS9x9x5/8
15.5	24	28.57	309.93	368.94	442.73	8.85	HSS12x12x5/8	25.7	4.62	74.21	51.98	33.43	773.18	HSS12x12x5/8
14	24	27.78	335.90	388.87	466.65	9.33	HSS12x12x5/8	25.7	4.62	72.17	54.95	34.17	790.24	HSS12x12x5/8
15	19	24.21	345.93	440.73	528.88	10.58	HSS12x12x5/8	25.7	4.62	62.88	72.40	37.45	866.18	HSS12x12x5/8
10	19	21.47	345.93	390.91	469.09	9.38	HSS12x12x5/8	25.7	4.62	55.77	92.03	39.83	921.27	HSS12x12x5/8

Braced Frame 7 - 25%								Size Selection						
Story Ht	Bay Length	Brace Length	Shear	Axial Force	Inc By Tor	Trial Size, A = P/F	Size	A	r	KL/r	Fe	Fcr	P	Optimized
19														
17	33	37.12	161.88	182.09	218.51	4.37	HSS12x12x5/8	25.7	4.62	96.42	30.79	25.34	586.05	HSS10x10x5/8
17	33	37.12	215.70	242.64	291.17	5.82	HSS12x12x5/8	25.7	4.62	96.42	30.79	25.34	586.05	HSS10x10x5/8
17	33	37.12	272.73	306.79	368.14	7.36	HSS12x12x5/8	25.7	4.62	96.42	30.79	25.34	586.05	HSS10x10x5/8
15.5	33	36.46	309.93	342.41	410.89	8.22	HSS12x12x5/8	25.7	4.62	94.70	31.92	25.95	600.31	HSS12x12x5/8
14	33	35.85	335.90	364.88	437.85	8.76	HSS12x12x5/8	25.7	4.62	93.11	33.02	26.53	613.56	HSS12x12x5/8
15	33	36.25	345.93	379.98	455.98	9.12	HSS12x12x5/8	25.7	4.62	94.15	32.29	26.15	604.85	HSS12x12x5/8
10	33	34.48	345.93	361.46	433.75	8.68	HSS12x12x5/8	25.7	4.62	89.56	35.68	27.81	643.32	HSS12x12x5/8

Frames 7 and 8 Discontinued at upper level

Braced Frame 3 - 25%								Size Selection						
Story Ht	Bay Length	Brace Length	Shear	Axial Force	Inc By Tor	Trial Size, A = P/F	Size	A	r	KL/r	Fe	Fcr	P	Optimized
19	24	30.61	103.22	131.64	157.97	3.16	HSS12x12x5/8	25.7	4.62	79.51	45.28	31.49	728.47	HSS12x12x5/8
17	24	29.41	161.88	198.37	238.04	4.76	HSS12x12x5/8	25.7	4.62	76.39	49.05	32.63	754.81	HSS12x12x5/8
17	24	29.41	215.70	264.33	317.20	6.34	HSS12x12x5/8	25.7	4.62	76.39	49.05	32.63	754.81	HSS12x12x5/8
17	24	29.41	272.73	334.21	401.05	8.02	HSS12x12x5/8	25.7	4.62	76.39	49.05	32.63	754.81	HSS12x12x5/8
15.5	24	28.57	309.93	368.94	442.73	8.85	HSS12x12x5/8	25.7	4.62	74.21	51.98	33.43	773.18	HSS12x12x5/8
14	24	27.78	335.90	388.87	466.65	9.33	HSS12x12x5/8	25.7	4.62	72.17	54.95	34.17	790.24	HSS12x12x5/8
15	24	28.30	345.93	407.93	489.52	9.79	HSS12x12x5/8	25.7	4.62	73.51	52.96	33.68	779.02	HSS12x12x5/8
10	24	26.00	345.93	374.75	449.70	8.99	HSS12x12x5/8	25.7	4.62	67.53	62.76	35.82	828.56	HSS12x12x5/8

Braced Frame 8 - 25%								Size Selection						
Story Ht	Bay Length	Brace Length	Shear	Axial Force	Inc By Tor	Trial Size, A = P/F	Size	A	r	KL/r	Fe	Fcr	P	Optimized
19														
17	21	27.02	161.88	208.27	249.92	5.00	HSS10x10x5/8	21	3.8	85.32	39.32	29.36	554.97	HSS12x12x5/8
17	21	27.02	215.70	277.52	333.02	6.66	HSS10x10x5/8	21	3.8	85.32	39.32	29.36	554.97	HSS12x12x5/8
17	21	27.02	272.73	350.89	421.06	8.42	HSS10x10x5/8	21	3.8	85.32	39.32	29.36	554.97	HSS12x12x5/8
15.5	21	26.10	309.93	385.20	462.24	9.24	HSS10x10x5/8	21	3.8	82.42	42.13	30.43	575.05	HSS12x12x5/8
14	21	25.24	335.90	403.70	484.44	9.69	HSS10x10x5/8	21	3.8	79.70	45.06	31.42	593.90	HSS12x12x5/8
15	21	25.81	345.93	425.11	510.13	10.20	HSS10x10x5/8	21	3.8	81.50	43.10	30.77	581.48	HSS12x12x5/8
10	21	23.26	345.93	383.14	459.77	9.20	HSS10x10x5/8	21	3.8	73.45	53.05	33.70	636.97	HSS12x12x5/8

Braced Frame 4 - 25% Chevron (Assuming only half is in compr)								Size Selection						
Story Ht	Bay Length	Brace Length	Shear	Axial Force	Inc By Tor	Trial Size, A = P/F	Size	A	r	KL/r	Fe	Fcr	P	Optimized
19	29.33	24.00	25.80	42.23	50.68	1.01	HSS5x5x3/8	6.18	1.87	154.019	12.07	10.58	58.85	
17	29.33	22.45	80.94	123.91	148.69	2.97	HSS8x8x1/2	13.5	3.04	85.61842	39.04	29.25	355.44	HSS8x8x1/2
17	29.33	22.45	107.85	165.11	198.14	3.96	HSS8x8x1/2	13.5	3.04	88.62367	36.44	28.16	342.09	HSS8x8x1/2
17	29.33	22.45	136.36	208.76	250.52	5.01	HSS8x8x1/2	13.5	3.04	88.62367	36.44	28.16	342.09	HSS8x8x1/2
15.5	29.33	21.34	154.96	225.48	270.57	5.41	HSS8x8x1/2	13.5	3.04	84.22913	40.34	29.76	361.63	HSS8x8x1/2
14	29.33	20.27	167.95	232.19	278.63	5.57	HSS8x8x1/2	13.5	3.04	80.03159	44.69	31.30	380.33	HSS8x8x1/2
15	29.33	20.98	172.96	247.42	296.90	5.94	HSS8x8x1/2	13.5	3.04	82.80655	41.74	30.29	367.97	HSS8x8x1/2
10	29.33	17.75	172.96	209.35	251.22	5.02	HSS8x8x1/2	13.5	3.04	70.06576	58.30	34.92	424.28	HSS8x8x1/2

Note: No Top Bracing Currently Planned for Frames 4 and 5

Braced Frame 1 - 25%								Size Selection						
Story Ht	Bay Length	Brace Length	Shear	Axial Force	Inc By Tor	Trial Size, A = P/F	Size	A	r	KL/r	Fe	Fcr	P	Optimized
19	26	32.20	206.43	255.68	306.81	6.14	HSS10x10x5/8	21	3.8	101.6921	27.68	23.47	443.66	HSS10x10x5/8
17	26	31.06	161.88	193.41	232.09	4.64	HSS10x10x5/8	21	3.8	98.09826	29.74	24.74	467.57	HSS10x10x5/8
17	26	31.06	215.70	257.72	309.26	6.19	HSS10x10x5/8	21	3.8	98.09826	29.74	24.74	467.57	HSS10x10x5/8
17	26	31.06	272.73	325.85	391.02	7.82	HSS10x10x5/8	21	3.8	98.09826	29.74	24.74	467.57	HSS10x10x5/8
15.5	26	30.27	309.93	360.82	432.98	8.66	HSS10x10x5/8	21	3.8	95.58828	31.32	25.63	484.49	HSS10x10x5/8
14	26	29.53	335.90	381.50	457.80	9.16	HSS10x10x5/8	21	3.8	93.25151	32.91	26.48	500.38	HSS10x10x5/8
15	26	30.02	345.93	399.37	479.24	9.58	HSS10x10x5/8	21	3.8	94.78946	31.85	25.92	489.91	HSS10x10x5/8
10	26	27.86	345.93	370.63	444.75	8.90	HSS10x10x5/8	21	3.8	87.96877	36.99	28.39	536.66	HSS10x10x5/8

Note: Two Rows of Braced Frames Except at Top Level

Braced Frame 5 - 25% Chevron (Assuming only half is in compr)								Size Selection							
Story Ht	Bay Length	Brace Length	Shear	Axial Force	Inc By Tor	Trial Size, A = P/F		Size	A	r	KL/r	Fe	Fcr	P	Optimized
19	29.33	24.00	25.804	42.23	50.68	1.01		HSS5x5x3/8	6.18	1.87	154.02	12.07	10.58	58.85	
17	29.33	22.45	80.938	123.91	148.69	2.97		HSS8x8x1/2	13.5	3.04	88.62	36.44	28.16	342.09	HSS8x8x1/2
17	29.33	22.45	107.85	165.11	198.14	3.96		HSS8x8x1/2	13.5	3.04	88.62	36.44	28.16	342.09	HSS8x8x1/2
17	29.33	22.45	136.36	208.76	250.52	5.01		HSS8x8x1/2	13.5	3.04	88.62	36.44	28.16	342.09	HSS8x8x1/2
15.5	29.33	21.34	154.96	225.48	270.57	5.41		HSS8x8x1/2	13.5	3.04	84.23	40.34	29.76	361.63	HSS8x8x1/2
14	29.33	20.27	167.95	232.19	278.63	5.57		HSS8x8x1/2	13.5	3.04	80.03	44.69	31.30	380.33	HSS8x8x1/2
15	29.33	20.98	172.96	247.42	296.90	5.94		HSS8x8x1/2	13.5	3.04	82.81	41.74	30.29	367.97	HSS8x8x1/2
10	20	22.36	345.93	386.76	464.11	9.28		HSS9x9x5/8	18.7	3.4	78.92	45.95	31.71	533.67	HSS9x9x5/8

Note: Bottom Floor Not Chevron

Braced Frame 6 - 25%							Size Selection							
	Bay Length	Brace Length	Shear	Axial Force	Inc By Tor	Trial Size, A = P/F	Size	A	r	KL/r	Fe	Fcr	P	Optimized
19							HSS10x10x5/8	21	3.8	93.72879	32.58	26.30	497.13	HSS10x10x5/8
17	24.33	29.68	161.88	197.48	236.97	4.74	HSS10x10x5/8	21	3.8	93.72879	32.58	26.30	497.13	HSS10x10x5/8
17	24.33	29.68	215.7	263.14	315.77	6.32	HSS10x10x5/8	21	3.8	93.72879	32.58	26.30	497.13	HSS10x10x5/8
17	24.33	29.68	272.73	332.70	399.24	7.98	HSS10x10x5/8	21	3.8	93.72879	32.58	26.30	497.13	HSS10x10x5/8
15.5	24.33	28.85	309.93	367.48	440.97	8.82	HSS10x10x5/8	21	3.8	91.0985	34.49	27.25	515.11	HSS10x10x5/8
14	24.33	28.07	335.9	387.54	465.05	9.30	HSS10x10x5/8	21	3.8	88.64346	36.43	28.15	532.01	HSS10x10x5/8
15	24.33	28.58	345.93	406.38	487.66	9.75	HSS10x10x5/8	21	3.8	90.25995	35.13	27.56	520.87	HSS10x10x5/8
10	26	27.86	345.93	370.63	444.75	8.90	HSS10x10x5/8	21	3.8	87.96877	36.99	28.39	536.66	HSS10x10x5/8

Braced Frame 1: Two Frames Column Betw Lines 6 and 6.5 AND Between 4.2 and 4.3												Size Selection						
Floor	Ht	Length	Trib Area	Infl Area	DL(psf)	LL Reduction	LL	P	P From Vb	Total P	Size	A	r	KL/r	Fe	Fcr	P	Optimized
Roof	19	52	482	1931	80	0.59	59.14	72.09	579.7569952	651.85	W14x90	26.5	3.7	61.62162	75.38	37.88	903.40	W14x90
Pent	17	52	482	1931	110	0.49	150.00	171.87	579.7569952	751.62	W14x90	26.5	3.7	55.13514	94.15	40.04	954.84	W14x90
5th	17	52	482	1931	80	0.45	44.71	228.91	579.7569952	808.67	W14x90	26.5	3.7	55.13514	94.15	40.04	954.84	W14x109
4th	17	52	482	1931	80	0.42	42.07	285.32	579.7569952	865.08	W14x99	29.1	3.71	54.98652	94.66	40.08	1049.77	W14x109
3rd	15.5	52	482	1931	80	0.40	40.27	341.30	579.7569952	921.06	W14x99	29.1	3.71	50.13477	113.87	41.61	1089.66	W14x109
2nd	14	52	482	1931	80	0.40	40.00	397.21	579.7569952	976.97	W14x99	29.1	3.71	45.28302	139.58	43.04	1127.17	W14x159
1st	15	52	482	1931	80	0.40	40.00	453.12	579.7569952	1032.88	W14x99	29.1	3.71	48.51752	121.59	42.09	1102.45	W14x159
Terrace	10	52	482	1931	80	0.40	40.00	509.03	579.7569952	1088.79	W14x99	29.1	3.71	32.34501	273.58	46.32	1213.06	W14x159

Braced Frame 1: Two Frames Column Betw Lines 6 and 6.5 AND Between 4.2 and 4.3												Size Selection						
Floor	Ht	Length	Trib Area	Infl Area	DL(psf)	LL Reduction	LL	P	P From Vb	Total P	Size	A	r	KL/r	Fe	Fcr	P	Optimized
Roof	19	52	482	1931	80	0.59	59.14	72.09	579.7569952	651.85	W14x90	26.5	3.7	61.62162	75.38	37.88	903.40	W14x90
Pent	17	52	482	1931	110	0.49	150.00	171.87	579.7569952	751.62	W14x90	26.5	3.7	55.13514	94.15	40.04	954.84	W14x90
5th	17	52	482	1931	80	0.45	44.71	228.91	579.7569952	808.67	W14x90	26.5	3.7	55.13514	94.15	40.04	954.84	W14x109
4th	17	52	482	1931	80	0.42	42.07	285.32	579.7569952	865.08	W14x90	26.5	3.7	55.13514	94.15	40.04	954.84	W14x109
3rd	15.5	52	482	1931	80	0.40	40.27	341.30	579.7569952	921.06	W14x90	26.5	3.7	50.27027	113.26	41.56	991.31	W14x109
2nd	14	52	482	1931	80	0.40	40.00	397.21	579.7569952	976.97	W14x90	26.5	3.7	45.40541	138.83	43.00	1025.63	W14x159
1st	15	52	482	1931	80	0.40	40.00	453.12	579.7569952	1032.88	W14x99	29.1	3.71	48.51752	121.59	42.09	1102.45	W14x159
Terrace	10	52	482	1931	80	0.40	40.00	509.03	579.7569952	1088.79	W14x90	26.5	3.7	32.43243	272.11	46.30	1104.22	W14x159

Braced Frame 4 and 5 Column 4.2/4.9 and 6.2/6.9												Size Selection						
Floor	Ht	Length	Trib Area	Infl Area	DL(psf)	LL Reduction	LL	P	P From Vb	Total P	Size	A	r	KL/r	Fe	Fcr	P	Optimized
Roof	19	29.33	390	1560	80	0.63	62.98	59.08	1027.86784	1086.95	W14x120	35.3	3.74	60.96257	77.01	38.10	1210.53	W14x74
Pent	17	29.33	390	1560	110	0.52	150.00	139.81	1027.86784	1167.68	W14x120	35.3	3.74	54.54545	96.20	40.22	1277.94	W14x74
5th	17	29.33	390	1560	80	0.47	46.93	186.40	1027.86784	1214.27	W14x120	35.3	3.74	54.54545	96.20	40.22	1277.94	W14x99
4th	17	29.33	390	1560	80	0.44	43.99	232.42	1027.86784	1260.29	W14x120	35.3	3.74	54.54545	96.20	40.22	1277.94	W14x99
3rd	15.5	29.33	390	1560	80	0.42	41.98	278.05	1027.86784	1305.91	W14x120	35.3	3.74	49.73262	115.72	41.73	1325.71	W14x99
2nd	14	29.33	390	1560	80	0.41	40.50	323.38	1027.86784	1351.25	W14x120	35.3	3.74	44.91979	141.85	43.14	1370.61	W14x159
1st	15	29.33	390	1560	80	0.40	40.00	368.62	1027.86784	1396.49	W14x132	38.8	3.76	47.87234	124.89	42.29	1476.63	W14x159
Terrace	10	29.33	390	1560	80	0.40	40.00	413.86	1027.86784	1441.73	W14x132	38.8	3.76	31.91489	281.00	46.41	1620.69	W14x159

Braced Frame 2 and 3 Column G/F												Size Selection						
Floor	Ht	Length	Trib Area	Infl Area	DL(psf)	LL Reduction	LL	P	P From Vb	Total P	Size	A	r	KL/r	Fe	Fcr	P	Optimized
Roof	19	24	503	2014	80	0.58	58.42	75.05	1256.140156	1331.19	W14x132	38.8	3.76	60.6383	77.84	38.21	1334.39	W14x120
Pent	17	24	503	2014	110	0.49	150.00	179.17	1256.140156	1435.31	W14x132	38.8	3.76	54.25532	97.23	40.32	1407.90	W14x120
5th	17	24	503	2014	80	0.44	44.30	238.60	1256.140156	1494.74	W14x145	42.7	3.98	51.25628	108.94	41.26	1585.68	W14x176
4th	17	24	503	2014	80	0.42	41.71	297.38	1256.140156	1553.52	W14x145	42.7	3.98	51.25628	108.94	41.26	1585.68	W14x176
3rd	15.5	24	503	2014	80	0.40	40.00	355.73	1256.140156	1611.87	W14x145	42.7	3.98	46.73367	131.05	42.62	1637.90	W14x176
2nd	14	24	503	2014	80	0.40	40.00	414.08	1256.140156	1670.22	W14x145	42.7	3.98	42.21106	160.64	43.89	1686.79	W14x211
1st	15	24	503	2014	80	0.40	40.00	472.43	1256.140156	1728.57	W14x159	46.7	4	45	141.34	43.12	1812.29	W14x211
Terrace	10	24	503	2014	80	0.40	40.00	530.77	1256.140156	1786.91	W14x145	42.7	3.98	30.15075	314.85	46.78	1797.93	W14x211

Braced Frame 7											Size Selection							
Column D/E											Size	A	r	Kl/r	Fe	Fcr	P	Optimized
Floor	Ht	Length	Trib Area	Infl Area	DL(psf)	LL Reduction	LL	P	P From Vb	Total P	W14x99	29.1	3.71	61.45553	75.78	37.94	993.52	W14x109
Roof	19	33	455	1820	80	0.60	60.16	68.29	913.5564773	981.84	W14x99	29.1	3.71	54.98652	94.66	40.08	1049.77	W14x109
Pent	17	33	455	1820	110	0.50	150.00	162.47	913.5564773	1076.03	W14x109	32	3.73	54.69169	95.69	40.18	1157.12	W14x145
5th	17	33	455	1820	80	0.45	45.30	216.46	913.5564773	1130.01	W14x109	32	3.73	54.69169	95.69	40.18	1157.12	W14x145
4th	17	33	455	1820	80	0.43	42.58	269.82	913.5564773	1183.38	W14x109	32	3.73	54.69169	95.69	40.18	1157.12	W14x145
3rd	15.5	33	455	1820	80	0.41	40.72	322.77	913.5564773	1236.33	W14x109	32	3.73	49.86595	115.10	41.69	1200.61	W14x145
2nd	14	33	455	1820	80	0.40	40.00	375.55	913.5564773	1289.11	W14x120	35.3	3.74	44.91979	141.85	43.14	1370.61	W14x193
1st	15	33	455	1820	80	0.40	40.00	428.33	913.5564773	1341.89	W14x120	35.3	3.74	48.12834	123.56	42.21	1341.01	W14x193
Terrace	10	33	455	1820	80	0.40	40.00	481.11	913.5564773	1394.67	W14x120	35.3	3.74	32.08556	278.02	46.37	1473.32	W14x193

Braced Frame 8											Size Selection							
Column D.5/C											Size	A	r	Kl/r	Fe	Fcr	P	Optimized
Floor	Ht	Length	Trib Area	Infl Area	DL(psf)	LL Reduction	LL	P	P From Vb	Total P	W14x145	42.7	3.98	57.28643	87.22	39.33	1511.58	W14x109
Roof	19	21	663	2652	80	0.54	54.13	97.50	1435.58875	1533.09	W14x159	46.7	4	51	110.04	41.34	1737.54	W14x109
Pent	17	21	663	2652	110	0.46	150.00	234.74	1435.58875	1670.33	W14x159	46.7	4	51	110.04	41.34	1737.54	W14x109
5th	17	21	663	2652	80	0.42	41.82	312.25	1435.58875	1747.84	W14x159	46.7	4	51	110.04	41.34	1737.54	W14x109
4th	17	21	663	2652	80	0.40	40.00	389.16	1435.58875	1824.75	W14x159	46.7	4	51	110.04	41.34	1737.54	W14x145
3rd	15.5	21	663	2652	80	0.40	40.00	466.07	1435.58875	1901.66	W14x176	51.8	4.02	46.26866	133.70	42.76	1993.25	W14x145
2nd	14	21	663	2652	80	0.40	40.00	542.98	1435.58875	1978.57	W14x176	51.8	4.02	41.79104	163.88	44.01	2051.56	W14x211
1st	15	21	663	2652	80	0.40	40.00	619.89	1435.58875	2055.48	W14x176	51.8	4.02	44.77612	142.76	43.18	2013.16	W14x211
Terrace	10	21	663	2652	80	0.40	40.00	696.79	1435.58875	2132.38	W14x176	51.8	4.02	29.85075	321.21	46.85	2183.97	W14x211

**Appendix N – Brace Removal Tables**

X

	dmax	dmin	davg	dmax/dav	$\Delta 1$	$\Delta 2$	$\Delta_{avg}$	$\Delta_{max}/\Delta_{avg}$	
<b>Brace 4/5</b>									
Roof	4.24	3.30	3.77	1.12	0.91	0.60	0.76	1.2	PHOUSE
Penthouse	3.33	2.70	3.02	1.10	0.75	0.51	0.63	1.2	
Level 5	2.58	2.19	2.39	1.08	0.65	0.52	0.59	1.1	
Level 4	1.93	1.67	1.80	1.07	0.63	0.50	0.57	1.1	
Level 3	1.30	1.17	1.24	1.05	0.54	0.47	0.51	1.1	
Level 2	0.76	0.70	0.73	1.04	0.41	0.35	0.38	1.1	
Level 1	0.35	0.35	0.35	1.00	0.35	0.35	0.35	1.0	
Roof	4.27	3.31	3.79	1.13	0.98	0.60	0.79	1.2	5th
Penthouse	3.29	2.71	3.00	1.10	0.62	0.48	0.55	1.1	
Level 5	2.67	2.23	2.45	1.09	0.73	0.56	0.65	1.1	
Level 4	1.94	1.67	1.81	1.07	0.64	0.50	0.57	1.1	
Level 3	1.30	1.17	1.24	1.05	0.54	0.47	0.51	1.1	
Level 2	0.76	0.70	0.73	1.04	0.41	0.35	0.38	1.1	
Level 1	0.35	0.35	0.35	1.00	0.35	0.35	0.35	1.0	
Roof	4.27	3.31	3.79	1.13	0.97	0.60	0.79	1.2	4th
Penthouse	3.30	2.71	3.01	1.10	0.62	0.48	0.55	1.1	
Level 5	2.68	2.23	2.46	1.09	0.65	0.52	0.59	1.1	
Level 4	2.03	1.71	1.87	1.09	0.72	0.54	0.63	1.1	
Level 3	1.31	1.17	1.24	1.06	0.55	0.47	0.51	1.1	
Level 2	0.76	0.70	0.73	1.04	0.41	0.35	0.38	1.1	
Level 1	0.35	0.35	0.35	1.00	0.35	0.35	0.35	1.0	
Roof	4.29	3.33	3.81	1.13	0.97	0.60	0.79	1.2	3rd
Penthouse	3.32	2.73	3.03	1.10	0.62	0.48	0.55	1.1	
Level 5	2.70	2.25	2.48	1.09	0.65	0.53	0.59	1.1	
Level 4	2.05	1.72	1.89	1.09	0.64	0.51	0.58	1.1	
Level 3	1.41	1.21	1.31	1.08	0.64	0.51	0.58	1.1	
Level 2	0.77	0.70	0.74	1.05	0.42	0.35	0.39	1.1	
Level 1	0.35	0.35	0.35	1.00	0.35	0.35	0.35	1.0	
Roof	4.27	3.31	3.79	1.13	0.96	0.59	0.78	1.2	2nd
Penthouse	3.31	2.72	3.02	1.10	0.61	0.48	0.55	1.1	
Level 5	2.70	2.24	2.47	1.09	0.66	0.53	0.60	1.1	
Level 4	2.04	1.71	1.88	1.09	0.63	0.50	0.57	1.1	
Level 3	1.41	1.21	1.31	1.08	0.55	0.46	0.51	1.1	
Level 2	0.86	0.75	0.81	1.07	0.50	0.40	0.45	1.1	
Level 1	0.36	0.35	0.36	1.01	0.36	0.35	0.36	1.0	
Roof	4.29	3.35	3.82	1.12	0.96	0.60	0.78	1.2	1st
Penthouse	3.33	2.75	3.04	1.10	0.63	0.49	0.56	1.1	
Level 5	2.70	2.26	2.48	1.09	0.64	0.53	0.59	1.1	
Level 4	2.06	1.73	1.90	1.09	0.64	0.51	0.58	1.1	
Level 3	1.42	1.22	1.32	1.08	0.54	0.47	0.51	1.1	
Level 2	0.88	0.75	0.82	1.08	0.42	0.35	0.39	1.1	
Level 1	0.46	0.40	0.43	1.07	0.46	0.40	0.43	1.1	



X	dmax	dmin	davg	dmax/dav	$\Delta 1$	$\Delta 2$	$\Delta_{avg}$	$\Delta_{max}/\Delta_{avg}$	
<b>Brace 1</b>									
Roof	4.14	3.32	3.73	1.11	0.88	0.54	0.71	1.2	PHOUSE
Penthouse	3.26	2.78	3.02	1.08	0.67	0.57	0.62	1.1	
Level 5	2.59	2.21	2.40	1.08	0.65	0.53	0.59	1.1	
Level 4	1.94	1.68	1.81	1.07	0.63	0.51	0.57	1.1	
Level 3	1.31	1.17	1.24	1.06	0.55	0.47	0.51	1.1	
Level 2	0.76	0.70	0.73	1.04	0.41	0.35	0.38	1.1	
Level 1	0.35	0.35	0.35	1.00	0.35	0.35	0.35	1.0	
Roof	4.16	3.37	3.77	1.10	0.87	0.52	0.70	1.3	5th
Penthouse	3.29	2.85	3.07	1.07	0.66	0.52	0.59	1.1	
Level 5	2.63	2.33	2.48	1.06	0.69	0.64	0.67	1.0	
Level 4	1.94	1.69	1.82	1.07	0.63	0.52	0.58	1.1	
Level 3	1.31	1.17	1.24	1.06	0.55	0.47	0.51	1.1	
Level 2	0.76	0.70	0.73	1.04	0.41	0.35	0.38	1.1	
Level 1	0.35	0.35	0.35	1.00	0.35	0.35	0.35	1.0	
Roof	4.20	3.41	3.81	1.10	0.90	0.55	0.73	1.2	4th
Penthouse	3.30	2.86	3.08	1.07	0.63	0.52	0.58	1.1	
Level 5	2.67	2.34	2.51	1.07	0.66	0.51	0.59	1.1	
Level 4	2.01	1.83	1.92	1.05	0.70	0.65	0.68	1.0	
Level 3	1.31	1.18	1.25	1.05	0.55	0.48	0.52	1.1	
Level 2	0.76	0.70	0.73	1.04	0.41	0.35	0.38	1.1	
Level 1	0.35	0.35	0.35	1.00	0.35	0.35	0.35	1.0	
Roof	4.20	3.38	3.79	1.11	0.93	0.57	0.75	1.2	3rd
Penthouse	3.27	2.81	3.04	1.08	0.62	0.48	0.55	1.1	
Level 5	2.65	2.33	2.49	1.06	0.65	0.53	0.59	1.1	
Level 4	2.00	1.80	1.90	1.05	0.63	0.51	0.57	1.1	
Level 3	1.37	1.29	1.33	1.03	0.60	0.58	0.59	1.0	
Level 2	0.77	0.71	0.74	1.04	0.42	0.36	0.39	1.1	
Level 1	0.35	0.35	0.35	1.00	0.35	0.35	0.35	1.0	
Roof	4.21	3.41	3.81	1.10	0.93	0.58	0.76	1.2	2nd
Penthouse	3.28	2.83	3.06	1.07	0.63	0.49	0.56	1.1	
Level 5	2.65	2.34	2.50	1.06	0.65	0.53	0.59	1.1	
Level 4	2.00	1.81	1.91	1.05	0.63	0.51	0.57	1.1	
Level 3	1.37	1.30	1.34	1.03	0.55	0.47	0.51	1.1	
Level 2	0.82	0.83	0.83	0.99	0.46	0.48	0.47	1.0	
Level 1	0.36	0.35	0.36	1.01	0.36	0.35	0.36	1.0	
Roof	4.19	3.35	3.77	1.11	0.94	0.58	0.76	1.2	1st
Penthouse	3.25	2.77	3.01	1.08	0.62	0.48	0.55	1.1	
Level 5	2.63	2.29	2.46	1.07	0.65	0.53	0.59	1.1	
Level 4	1.98	1.76	1.87	1.06	0.63	0.50	0.57	1.1	
Level 3	1.35	1.26	1.31	1.03	0.54	0.46	0.50	1.1	
Level 2	0.81	0.80	0.81	1.01	0.41	0.36	0.39	1.1	
Level 1	0.40	0.44	0.42	0.95	0.40	0.44	0.42	1.0	

X	dmax	dmin	davg	dmax/dav	$\Delta 1$	$\Delta 2$	$\Delta_{avg}$	$\Delta_{max}/\Delta_{avg}$	
<b>Brace 6</b>									
Roof	4.31	3.54	3.93	1.10	1.01	0.68	0.85	1.2	PHOUSE
Penthouse	3.30	2.86	3.08	1.07	0.70	0.64	0.67	1.0	
Level 5	2.60	2.22	2.41	1.08	0.66	0.54	0.60	1.1	
Level 4	1.94	1.68	1.81	1.07	0.63	0.51	0.57	1.1	
Level 3	1.31	1.17	1.24	1.06	0.55	0.47	0.51	1.1	
Level 2	0.76	0.70	0.73	1.04	0.41	0.35	0.38	1.1	
Level 1	0.35	0.35	0.35	1.00	0.35	0.35	0.35	1.0	
Roof	4.26	3.46	3.86	1.10	0.97	0.63	0.80	1.2	5th
Penthouse	3.29	2.83	3.06	1.08	0.63	0.48	0.56	1.1	
Level 5	2.66	2.35	2.51	1.06	0.72	0.66	0.69	1.0	
Level 4	1.94	1.69	1.82	1.07	0.63	0.52	0.58	1.1	
Level 3	1.31	1.17	1.24	1.06	0.55	0.47	0.51	1.1	
Level 2	0.76	0.70	0.73	1.04	0.41	0.35	0.38	1.1	
Level 1	0.35	0.35	0.35	1.00	0.35	0.35	0.35	1.0	
Roof	4.28	3.51	3.90	1.10	0.97	0.63	0.80	1.2	4th
Penthouse	3.31	2.88	3.10	1.07	0.63	0.49	0.56	1.1	
Level 5	2.68	2.39	2.54	1.06	0.66	0.55	0.61	1.1	
Level 4	2.02	1.84	1.93	1.05	0.71	0.66	0.69	1.0	
Level 3	1.31	1.18	1.25	1.05	0.55	0.48	0.52	1.1	
Level 2	0.76	0.70	0.73	1.04	0.41	0.35	0.38	1.1	
Level 1	0.35	0.35	0.35	1.00	0.35	0.35	0.35	1.0	
Roof	4.23	3.42	3.83	1.11	0.96	0.60	0.78	1.2	3rd
Penthouse	3.27	2.82	3.05	1.07	0.62	0.49	0.56	1.1	
Level 5	2.65	2.33	2.49	1.06	0.65	0.52	0.59	1.1	
Level 4	2.00	1.81	1.91	1.05	0.63	0.51	0.57	1.1	
Level 3	1.37	1.30	1.34	1.03	0.60	0.59	0.60	1.0	
Level 2	0.77	0.71	0.74	1.04	0.42	0.36	0.39	1.1	
Level 1	0.35	0.35	0.35	1.00	0.35	0.35	0.35	1.0	
Roof	4.24	3.44	3.84	1.10	0.96	0.60	0.78	1.2	2nd
Penthouse	3.28	2.84	3.06	1.07	0.62	0.49	0.56	1.1	
Level 5	2.66	2.35	2.51	1.06	0.66	0.53	0.60	1.1	
Level 4	2.00	1.82	1.91	1.05	0.63	0.51	0.57	1.1	
Level 3	1.37	1.31	1.34	1.02	0.55	0.48	0.52	1.1	
Level 2	0.82	0.83	0.83	0.99	0.46	0.48	0.47	1.0	
Level 1	0.36	0.35	0.36	1.01	0.36	0.35	0.36	1.0	
Roof	4.20	3.36	3.78	1.11	0.95	0.59	0.77	1.2	1st
Penthouse	3.25	2.77	3.01	1.08	0.62	0.48	0.55	1.1	
Level 5	2.63	2.29	2.46	1.07	0.65	0.52	0.59	1.1	
Level 4	1.98	1.77	1.88	1.06	0.63	0.51	0.57	1.1	
Level 3	1.35	1.26	1.31	1.03	0.54	0.46	0.50	1.1	
Level 2	0.81	0.80	0.81	1.01	0.41	0.36	0.39	1.1	
Level 1	0.40	0.44	0.42	0.95	0.40	0.44	0.42	1.0	

Y	dmax	dmin	davg	dmax/davg	$\Delta 1$	$\Delta 2$	$\Delta_{avg}$	$\Delta_{max}/\Delta_{avg}$	
<b>Brace 7</b>									
Roof	4.90	3.67	4.29	1.14	0.89	0.70	0.80	1.1	PHOUSE
Penthouse	4.01	2.97	3.49	1.15	0.81	0.76	0.79	1.0	
Level 5	3.20	2.21	2.71	1.18	0.84	0.56	0.70	1.2	
Level 4	2.36	1.65	2.01	1.18	0.81	0.54	0.68	1.2	
Level 3	1.55	1.11	1.33	1.17	0.66	0.47	0.57	1.2	
Level 2	0.89	0.64	0.77	1.16	0.51	0.37	0.44	1.2	
Level 1	0.38	0.27	0.33	1.17	0.38	0.27	0.33	1.2	
Roof	4.90	3.68	4.29	1.14	0.89	0.67	0.78	1.1	5th
Penthouse	4.01	3.01	3.51	1.14	0.82	0.54	0.68	1.2	
Level 5	3.19	2.47	2.83	1.13	0.83	0.81	0.82	1.0	
Level 4	2.36	1.66	2.01	1.17	0.81	0.55	0.68	1.2	
Level 3	1.55	1.11	1.33	1.17	0.66	0.46	0.56	1.2	
Level 2	0.89	0.65	0.77	1.16	0.51	0.39	0.45	1.1	
Level 1	0.38	0.26	0.32	1.19	0.38	0.26	0.32	1.2	
Roof	4.91	3.66	4.29	1.15	0.89	0.65	0.77	1.2	4th
Penthouse	4.02	3.01	3.52	1.14	0.83	0.52	0.68	1.2	
Level 5	3.19	2.49	2.84	1.12	0.84	0.55	0.70	1.2	
Level 4	2.35	1.94	2.15	1.10	0.79	0.82	0.81	1.0	
Level 3	1.56	1.12	1.34	1.16	0.67	0.48	0.58	1.2	
Level 2	0.89	0.64	0.77	1.16	0.51	0.38	0.45	1.1	
Level 1	0.38	0.26	0.32	1.19	0.38	0.26	0.32	1.2	
Roof	4.90	3.61	4.26	1.15	0.89	0.63	0.76	1.2	3rd
Penthouse	4.01	2.98	3.50	1.15	0.82	0.52	0.67	1.2	
Level 5	3.19	2.46	2.83	1.13	0.84	0.54	0.69	1.2	
Level 4	2.35	1.92	2.14	1.10	0.80	0.56	0.68	1.2	
Level 3	1.55	1.36	1.46	1.07	0.66	0.71	0.69	1.0	
Level 2	0.89	0.65	0.77	1.16	0.51	0.39	0.45	1.1	
Level 1	0.38	0.26	0.32	1.19	0.38	0.26	0.32	1.2	
Roof	4.91	3.53	4.22	1.16	0.89	0.60	0.75	1.2	2nd
Penthouse	4.02	2.93	3.48	1.16	0.83	0.52	0.68	1.2	
Level 5	3.19	2.41	2.80	1.14	0.83	0.54	0.69	1.2	
Level 4	2.36	1.87	2.12	1.12	0.81	0.54	0.68	1.2	
Level 3	1.55	1.33	1.44	1.08	0.67	0.47	0.57	1.2	
Level 2	0.88	0.86	0.87	1.01	0.50	0.59	0.55	1.1	
Level 1	0.38	0.27	0.33	1.17	0.38	0.27	0.33	1.2	
Roof	4.88	3.39	4.14	1.18	0.88	0.58	0.73	1.2	1st
Penthouse	4.00	2.81	3.41	1.17	0.82	0.51	0.67	1.2	
Level 5	3.18	2.30	2.74	1.16	0.83	0.52	0.68	1.2	
Level 4	2.35	1.78	2.07	1.14	0.80	0.53	0.67	1.2	
Level 3	1.55	1.25	1.40	1.11	0.67	0.45	0.56	1.2	
Level 2	0.88	0.80	0.84	1.05	0.50	0.37	0.44	1.1	
Level 1	0.38	0.43	0.41	0.94	0.38	0.43	0.41	1.1	

Y	dmax	dmin	davg	dmax/dav	$\Delta 1$	$\Delta 2$	$\Delta_{avg}$	$\Delta_{max}/\Delta_{avg}$	
<b>Brace 2</b>									
Roof	4.95	3.28	4.12	1.20	0.92	0.54	0.73	1.3	PHOUSE
Penthouse	4.03	2.74	3.39	1.19	0.83	0.58	0.71	1.2	
Level 5	3.20	2.16	2.68	1.19	0.84	0.53	0.69	1.2	
Level 4	2.36	1.63	2.00	1.18	0.81	0.53	0.67	1.2	
Level 3	1.55	1.10	1.33	1.17	0.66	0.45	0.56	1.2	
Level 2	0.89	0.65	0.77	1.16	0.51	0.38	0.45	1.1	
Level 1	0.38	0.27	0.33	1.17	0.38	0.27	0.33	1.2	
Roof	4.96	3.30	4.13	1.20	0.92	0.52	0.72	1.3	5th
Penthouse	4.04	2.78	3.41	1.18	0.82	0.51	0.67	1.2	
Level 5	3.22	2.27	2.75	1.17	0.86	0.64	0.75	1.1	
Level 4	2.36	1.63	2.00	1.18	0.81	0.53	0.67	1.2	
Level 3	1.55	1.10	1.33	1.17	0.66	0.45	0.56	1.2	
Level 2	0.89	0.65	0.77	1.16	0.51	0.38	0.45	1.1	
Level 1	0.38	0.27	0.33	1.17	0.38	0.27	0.33	1.2	
Roof	4.96	3.34	4.15	1.20	0.91	0.54	0.73	1.3	4th
Penthouse	4.05	2.80	3.43	1.18	0.82	0.50	0.66	1.2	
Level 5	3.23	2.30	2.77	1.17	0.84	0.54	0.69	1.2	
Level 4	2.39	1.76	2.08	1.15	0.83	0.65	0.74	1.1	
Level 3	1.56	1.11	1.34	1.17	0.67	0.46	0.57	1.2	
Level 2	0.89	0.65	0.77	1.16	0.50	0.37	0.44	1.1	
Level 1	0.39	0.28	0.34	1.16	0.39	0.28	0.34	1.2	
Roof	4.96	3.38	4.17	1.19	0.91	0.56	0.74	1.2	3rd
Penthouse	4.05	2.82	3.44	1.18	0.82	0.51	0.67	1.2	
Level 5	3.23	2.31	2.77	1.17	0.83	0.53	0.68	1.2	
Level 4	2.40	1.78	2.09	1.15	0.81	0.53	0.67	1.2	
Level 3	1.59	1.25	1.42	1.12	0.69	0.60	0.65	1.1	
Level 2	0.90	0.65	0.78	1.16	0.51	0.37	0.44	1.2	
Level 1	0.39	0.28	0.34	1.16	0.39	0.28	0.34	1.2	
Roof	4.95	3.41	4.18	1.18	0.89	0.57	0.73	1.2	2nd
Penthouse	4.06	2.84	3.45	1.18	0.83	0.51	0.67	1.2	
Level 5	3.23	2.33	2.78	1.16	0.83	0.53	0.68	1.2	
Level 4	2.40	1.80	2.10	1.14	0.81	0.53	0.67	1.2	
Level 3	1.59	1.27	1.43	1.11	0.66	0.46	0.56	1.2	
Level 2	0.93	0.81	0.87	1.07	0.54	0.52	0.53	1.0	
Level 1	0.39	0.29	0.34	1.15	0.39	0.29	0.34	1.1	
Roof	5.02	3.70	4.36	1.15	0.90	0.63	0.77	1.2	1st
Penthouse	4.12	3.07	3.60	1.15	0.83	0.55	0.69	1.2	
Level 5	3.29	2.52	2.91	1.13	0.85	0.56	0.71	1.2	
Level 4	2.44	1.96	2.20	1.11	0.82	0.57	0.70	1.2	
Level 3	1.62	1.39	1.51	1.08	0.67	0.49	0.58	1.2	
Level 2	0.95	0.90	0.93	1.03	0.52	0.41	0.47	1.1	
Level 1	0.43	0.49	0.46	0.93	0.43	0.49	0.46	1.1	

Y	dmax	dmin	davg	dmax/dav	$\Delta 1$	$\Delta 2$	$\Delta_{avg}$	$\Delta_{max}/\Delta_{avg}$	
<b>Brace 3</b>									
Roof	4.93	3.34	4.14	1.19	0.81	0.63	0.72	1.1	PHOUSE
Penthouse	4.12	2.71	3.42	1.21	0.93	0.54	0.74	1.3	
Level 5	3.19	2.17	2.68	1.19	0.83	0.53	0.68	1.2	
Level 4	2.36	1.64	2.00	1.18	0.81	0.54	0.68	1.2	
Level 3	1.55	1.10	1.33	1.17	0.66	0.46	0.56	1.2	
Level 2	0.89	0.64	0.77	1.16	0.51	0.37	0.44	1.2	
Level 1	0.38	0.27	0.33	1.17	0.38	0.27	0.33	1.2	
Roof	4.97	3.34	4.16	1.20	0.81	0.63	0.72	1.1	5th
Penthouse	4.16	2.71	3.44	1.21	0.83	0.51	0.67	1.2	
Level 5	3.33	2.20	2.77	1.20	0.97	0.56	0.77	1.3	
Level 4	2.36	1.64	2.00	1.18	0.81	0.54	0.68	1.2	
Level 3	1.55	1.10	1.33	1.17	0.66	0.46	0.56	1.2	
Level 2	0.89	0.64	0.77	1.16	0.51	0.37	0.44	1.2	
Level 1	0.38	0.27	0.33	1.17	0.38	0.27	0.33	1.2	
Roof	5.01	3.34	4.18	1.20	0.83	0.62	0.73	1.1	4th
Penthouse	4.18	2.72	3.45	1.21	0.82	0.51	0.67	1.2	
Level 5	3.36	2.21	2.79	1.21	0.85	0.54	0.70	1.2	
Level 4	2.51	1.67	2.09	1.20	0.95	0.57	0.76	1.3	
Level 3	1.56	1.10	1.33	1.17	0.67	0.46	0.57	1.2	
Level 2	0.89	0.64	0.77	1.16	0.51	0.37	0.44	1.2	
Level 1	0.38	0.27	0.33	1.17	0.38	0.27	0.33	1.2	
Roof	5.02	3.32	4.17	1.20	0.85	0.60	0.73	1.2	3rd
Penthouse	4.17	2.72	3.45	1.21	0.83	0.52	0.68	1.2	
Level 5	3.34	2.20	2.77	1.21	0.83	0.53	0.68	1.2	
Level 4	2.51	1.67	2.09	1.20	0.81	0.54	0.68	1.2	
Level 3	1.70	1.13	1.42	1.20	0.81	0.49	0.65	1.2	
Level 2	0.89	0.64	0.77	1.16	0.51	0.37	0.44	1.2	
Level 1	0.38	0.27	0.33	1.17	0.38	0.27	0.33	1.2	
Roof	5.01	3.32	4.17	1.20	0.87	0.60	0.74	1.2	2nd
Penthouse	4.14	2.72	3.43	1.21	0.81	0.52	0.67	1.2	
Level 5	3.33	2.20	2.77	1.20	0.84	0.53	0.69	1.2	
Level 4	2.49	1.67	2.08	1.20	0.80	0.54	0.67	1.2	
Level 3	1.69	1.13	1.41	1.20	0.67	0.46	0.57	1.2	
Level 2	1.02	0.67	0.85	1.21	0.63	0.40	0.52	1.2	
Level 1	0.39	0.27	0.33	1.18	0.39	0.27	0.33	1.2	
Roof	4.98	3.29	4.14	1.20	0.88	0.60	0.74	1.2	1st
Penthouse	4.10	2.69	3.40	1.21	0.81	0.50	0.66	1.2	
Level 5	3.29	2.19	2.74	1.20	0.83	-0.46	0.19	4.5	
Level 4	2.46	2.65	2.56	0.96	0.80	1.53	1.17	0.7	
Level 3	1.66	1.12	1.39	1.19	0.66	0.45	0.56	1.2	
Level 2	1.00	0.67	0.84	1.20	0.51	0.38	0.45	1.1	
Level 1	0.49	0.29	0.39	1.26	0.49	0.29	0.39	1.3	

Y	dmax	dmin	davg	dmax/dav	$\Delta 1$	$\Delta 2$	$\Delta_{avg}$	$\Delta_{max/\Delta_{avg}}$	
<b>Brace 8</b>									
Roof	5.13	3.28	4.21	1.22	0.95	0.59	0.77	1.2	PHOUSE
Penthouse	4.18	2.69	3.44	1.22	1.00	0.51	0.76	1.3	
Level 5	3.18	2.18	2.68	1.19	0.83	0.54	0.69	1.2	
Level 4	2.35	1.64	2.00	1.18	0.80	0.53	0.67	1.2	
Level 3	1.55	1.11	1.33	1.17	0.66	0.46	0.56	1.2	
Level 2	0.89	0.65	0.77	1.16	0.51	0.38	0.45	1.1	
Level 1	0.38	0.27	0.33	1.17	0.38	0.27	0.33	1.2	
Roof	5.15	3.28	4.22	1.22	0.94	0.59	0.77	1.2	5th
Penthouse	4.21	2.69	3.45	1.22	0.82	0.52	0.67	1.2	
Level 5	3.39	2.17	2.78	1.22	1.04	0.53	0.79	1.3	
Level 4	2.35	1.64	2.00	1.18	0.80	0.53	0.67	1.2	
Level 3	1.55	1.11	1.33	1.17	0.66	0.46	0.56	1.2	
Level 2	0.89	0.65	0.77	1.16	0.51	0.38	0.45	1.1	
Level 1	0.38	0.27	0.33	1.17	0.38	0.27	0.33	1.2	
Roof	5.17	3.28	4.23	1.22	0.92	0.59	0.76	1.2	4th
Penthouse	4.25	2.69	3.47	1.22	0.82	0.52	0.67	1.2	
Level 5	3.43	2.17	2.80	1.23	0.83	0.54	0.69	1.2	
Level 4	2.60	1.63	2.12	1.23	1.04	0.52	0.78	1.3	
Level 3	1.56	1.11	1.34	1.17	0.67	0.46	0.57	1.2	
Level 2	0.89	0.65	0.77	1.16	0.51	0.38	0.45	1.1	
Level 1	0.38	0.27	0.33	1.17	0.38	0.27	0.33	1.2	
Roof	5.18	3.27	4.23	1.23	0.91	0.59	0.75	1.2	3rd
Penthouse	4.27	2.68	3.48	1.23	0.83	0.51	0.67	1.2	
Level 5	3.44	2.17	2.81	1.23	0.83	0.54	0.69	1.2	
Level 4	2.61	1.63	2.12	1.23	0.81	0.54	0.68	1.2	
Level 3	1.80	1.09	1.45	1.25	0.91	0.44	0.68	1.3	
Level 2	0.89	0.65	0.77	1.16	0.51	0.38	0.45	1.1	
Level 1	0.38	0.27	0.33	1.17	0.38	0.27	0.33	1.2	
Roof	5.17	3.28	4.23	1.22	0.90	0.59	0.75	1.2	2nd
Penthouse	4.27	2.69	3.48	1.23	0.82	0.52	0.67	1.2	
Level 5	3.45	2.17	2.81	1.23	0.84	0.54	0.69	1.2	
Level 4	2.61	1.63	2.12	1.23	0.80	0.53	0.67	1.2	
Level 3	1.81	1.10	1.46	1.24	0.67	0.47	0.57	1.2	
Level 2	1.14	0.63	0.89	1.29	0.75	0.36	0.56	1.4	
Level 1	0.39	0.27	0.33	1.18	0.39	0.27	0.33	1.2	
Roof	5.18	3.25	4.22	1.23	0.90	0.59	0.75	1.2	1st
Penthouse	4.28	2.66	3.47	1.23	0.83	0.51	0.67	1.2	
Level 5	3.45	2.15	2.80	1.23	0.84	0.53	0.69	1.2	
Level 4	2.61	1.62	2.12	1.23	0.80	0.53	0.67	1.2	
Level 3	1.81	1.09	1.45	1.25	0.67	0.46	0.57	1.2	
Level 2	1.14	0.63	0.89	1.29	0.52	0.37	0.45	1.2	
Level 1	0.62	0.26	0.44	1.41	0.62	0.26	0.44	1.4	

**Appendix O – CA Layout 2, Story Drifts and Torsional Irregularity**

Torsional Irregularity X Direction									
Story	$\delta_{max}$	$\delta_{min}$	$\delta_{avg}$	$\delta_{max}/\delta_{avg}$	$\Delta 1$	$\Delta 2$	$\Delta_{avg}$	$\Delta_{max}/\Delta_{avg}$	$A_x$
Roof	4.01	3.24	3.625	1.11	1.01	0.62	0.82	1.2	0.85
Penthouse	3	2.62	2.81	1.07	0.60	0.49	0.55	1.1	0.79
Level 5	2.4	2.13	2.265	1.06	0.62	0.53	0.58	1.1	0.78
Level 4	1.78	1.6	1.69	1.05	0.59	0.49	0.54	1.1	0.77
Level 3	1.19	1.11	1.15	1.03	0.49	0.45	0.47	1.0	0.74
Level 2	0.7	0.66	0.68	1.03	0.37	0.33	0.35	1.1	0.74
Level 1	0.33	0.33	0.33	1.00	0.33	0.33	0.33	1.0	0.69

Torsional Irregularity Y Direction									
Story	$\delta_{max}$	$\delta_{min}$	$\delta_{avg}$	$\delta_{max}/\delta_{avg}$	$\Delta 1$	$\Delta 2$	$\Delta_{avg}$	$\Delta_{max}/\Delta_{avg}$	$A_x$
Roof	4.95	3.43	4.19	1.18	0.93	0.64	0.79	1.2	0.97
Penthouse	4.02	2.79	3.405	1.18	0.86	0.55	0.71	1.2	0.97
Level 5	3.16	2.24	2.7	1.17	0.86	0.58	0.72	1.2	0.95
Level 4	2.3	1.66	1.98	1.16	0.80	0.56	0.68	1.2	0.94
Level 3	1.5	1.1	1.3	1.15	0.65	0.46	0.56	1.2	0.92
Level 2	0.85	0.64	0.745	1.14	0.48	0.37	0.43	1.1	0.90
Level 1	0.37	0.27	0.32	1.16	0.37	0.27	0.32	1.2	0.93

Story	Height	$\delta_{xe}$	$\delta_{ye}$	QCX Amplified by Cd/I				$\Delta a = .015s_x$
				$\delta_x$	$\delta_y$	$\Delta x$	$\Delta y$	
Roof	19.00	3.68	-	14.72	-	3.24	-	3.42
Penthouse	17.00	2.87	-	11.48	-	2.28	-	3.06
Level 5	17.00	2.30	-	9.20	-	2.28	-	3.06
Level 4	17.00	1.73	-	6.92	-	2.16	-	3.06
Level 3	15.50	1.19	-	4.76	-	2.00	-	2.79
Level 2	14.00	0.69	-	2.76	-	1.36	-	2.52
Level 1	15.00	0.35	-	1.40	-	1.40	-	2.70

Story	Height	$\delta_{xe}$	$\delta_{ye}$	QCY Amplified by Cd/I				$\Delta a = .015s_x$
				$\delta_x$	$\delta_y$	$\Delta x$	$\Delta y$	
Roof	19.00	-	4.12	-	16.48	-	2.80	3.42
Penthouse	17.00	-	3.42	-	13.68	-	2.92	3.06
Level 5	17.00	-	2.69	-	10.76	-	2.84	3.06
Level 4	17.00	-	1.98	-	7.92	-	2.72	3.06
Level 3	15.50	-	1.30	-	5.20	-	2.24	2.79
Level 2	14.00	-	0.74	-	2.96	-	1.60	2.52
Level 1	15.00	-	0.34	-	1.36	-	1.36	2.70


Story	Height	$\delta_{xe}$	$\delta_{ye}$	QCXE Amplified by Cd/I				$\Delta a = .015s_x$
				$\delta_x$	$\delta_y$	$\Delta x$	$\Delta y$	
Roof	19.00	3.67	-	14.68	-	3.32	-	3.42
Penthouse	17.00	2.84	-	11.36	-	2.16	-	3.06
Level 5	17.00	2.30	-	9.20	-	2.28	-	3.06
Level 4	17.00	1.73	-	6.92	-	2.16	-	3.06
Level 3	15.50	1.19	-	4.76	-	1.92	-	2.79
Level 2	14.00	0.71	-	2.84	-	1.48	-	2.52
Level 1	15.00	0.34	-	1.36	-	1.36	-	2.70

Story	Height	$\delta_{xe}$	$\delta_{ye}$	QCYE Amplified by Cd/I				$\Delta a = .015s_x$
				$\delta_x$	$\delta_y$	$\Delta x$	$\Delta y$	
Roof	19.00	-	4.14	-	16.56	-	2.84	3.42
Penthouse	17.00	-	3.43	-	13.72	-	2.88	3.06
Level 5	17.00	-	2.71	-	10.84	-	2.88	3.06
Level 4	17.00	-	1.99	-	7.96	-	2.60	3.06
Level 3	15.50	-	1.34	-	5.36	-	2.40	2.79
Level 2	14.00	-	0.74	-	2.96	-	1.56	2.52
Level 1	15.00	-	0.35	-	1.40	-	1.40	2.70

Story	Height	$\delta_{xe}$	$\delta_{ye}$	QX100Y30E Amplified by Cd/I				$\Delta a = .015s_x$
				$\delta_x$	$\delta_y$	$\Delta x$	$\Delta y$	
Roof	19.00	3.67	1.28	14.68	5.12	3.24	0.96	3.42
Penthouse	17.00	2.86	1.04	11.44	4.16	2.20	0.88	3.06
Level 5	17.00	2.31	0.82	9.24	3.28	2.24	0.88	3.06
Level 4	17.00	1.75	0.60	7.00	2.40	2.27	0.84	3.06
Level 3	15.50	1.18	0.39	4.73	1.56	1.97	0.64	2.79
Level 2	14.00	0.69	0.23	2.76	0.92	1.40	0.52	2.52
Level 1	15.00	0.34	0.10	1.36	0.40	1.36	0.40	2.70

Story	Height	$\delta_{xe}$	$\delta_{ye}$	QX30Y100 Amplified by Cd/I				$\Delta a = .015s_x$
				$\delta_x$	$\delta_y$	$\Delta x$	$\Delta y$	
Roof	19.00	1.14	4.12	4.56	16.48	1.04	2.80	3.42
Penthouse	17.00	0.88	3.42	3.52	13.68	0.68	2.84	3.06
Level 5	17.00	0.71	2.71	2.84	10.84	0.68	2.92	3.06
Level 4	17.00	0.54	1.98	2.16	7.92	0.76	2.76	3.06
Level 3	15.50	0.35	1.29	1.40	5.16	0.52	2.16	2.79
Level 2	14.00	0.22	0.75	0.88	3.00	0.40	1.64	2.52
Level 1	15.00	0.12	0.34	0.48	1.36	0.48	1.36	2.70

**Appendix P – CA Layout 2 Brace Configuration**

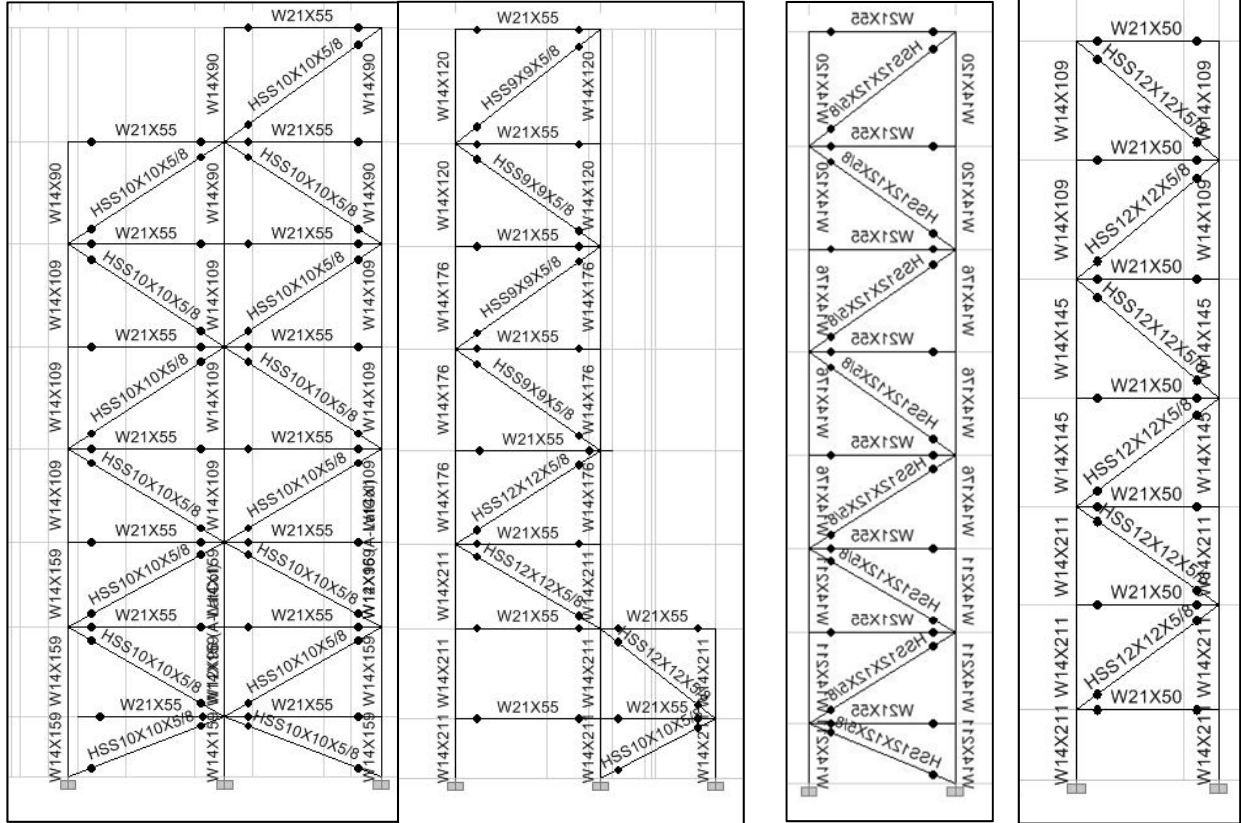


**BF 1/6**

**BF 2**

**BF 3**

**BF 8**

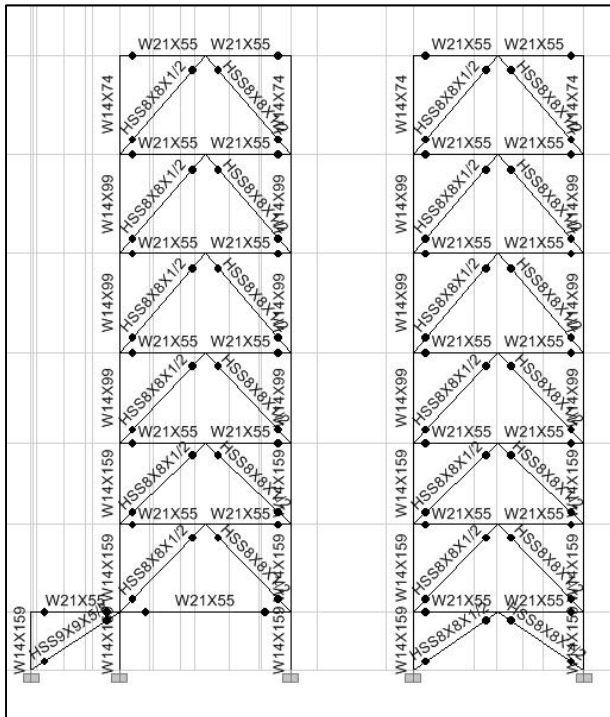

**BF 4/5**

**BF 7**



Appendix Q – Eccentric Braced Frame Design

LINK BM SHEAR

PHOUSE	78 k
3rd	121 k
4th	184 k
3rd	156 k
2nd	144 k
1st	108 k



HSS 9x9x5/8 →  $\phi P_n = 566 k$ ,  $F_{cr} = 33.3$   
 BRACE L = 21.1  
 STORY HT = 17  
 BAY LENGTH = 29.53

EBF DESIGN - 1st FLR (WORST CASE SHEAR)  
 TRY W18x86 - LENGTH = 4.33'

LINK BM

$V_D = \frac{.08 \times 4.33}{2}$        $V_U = 158.4 k$   
 $V_L = \frac{.1 \times 4.33}{2}$   
 $V_Q = 158 k$  ETABS

$M_D = \frac{.06 \times 4.33^2}{12}$        $M_U = 348.8 k$   
 $M_L = \frac{.1 \times 4.33^2}{12}$   
 $M_Q = 348 k \cdot ft$

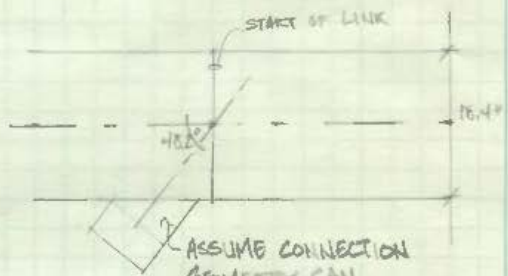ASSUME CONNECTION GEOMETRY CAN ACCOMMODATE HSS WHOSE CTR LINE CROSSES INSIDE LINK BUT CONNECTION REMAINS OUTSIDE

SLENDERNESS CHECK

$\lambda_p = 7.2$   
 $\lambda_{ps} = .3 \sqrt{\frac{E}{F_y}} = 7.22 \checkmark$   
 $\lambda_w = 83.4$   
 $C_u \leq 0.125$  (NO AXIAL)  
 $\lambda_{ps} = 3.14 \sqrt{\frac{E}{F_y}} (1 - 1.5 C_u) = 75.6 \checkmark$

SHEAR STR.

$.15 R_y = .15 F_y A_g = 190 k$   
 $P_u < .15 R_y$

$V_p = .6 F_y A_w = .6 (d_b - 2 t_f) t_w F_y = 243 k$   
 $\frac{2 M_p}{L} = \frac{2 F_y Z}{L} = \frac{2 (50) (186)}{52} = 358 k$

$$\phi V_n = .9(243) = 219 > 158.4 \checkmark$$

## LINK ROTATION ANGLE

$$\frac{V_{DC}}{M_P} = \frac{243(52)}{50 \times 186} = 1.36 < 1.6 \quad \text{LINK DOMINATED BY SHEAR YIELDING}$$

$$\text{ROTATION LIMIT} = .08$$

$$\gamma_P = \frac{1}{2} \theta_P : \theta_P = \frac{\Delta_P}{h}$$

$$\theta_P = \frac{1.36}{(14 \times 12)} = .0093$$

$$\gamma_P = \frac{29.33(12)}{52} (.0093) = .063 \checkmark$$

## LATERAL BRACING REQ.

$$R_u = .06 R_y F_y Z / h_o = .06 (1.1) (50) (186) / (17.6) = 84.7 \text{ k}$$

## STIFFENER REQUIREMENTS

$$w_{min} = b_f \frac{2t_w}{3} = \frac{11.1 - 2(.48)}{2} = 5.07 \text{ in}$$

$$t_{min} = .75 t_w \geq 3/8$$

$$= .36 \geq 3/8 \leftarrow \text{USE } 3/8$$

FULL DEPTH, 3/8 in x 5.07 in STIFFENERS ON EITHER SIDE OF LINK ELEMENT

## INTERMEDIATE STIFFENERS

FOR LINK ROTATION = .08 RADIANS

$$30 t_w - d/5 = 30(.48) - 18.4/5 = 10.72 \text{ in}$$

$$\text{LINK ROTATION} \leq .02$$

$$52 t_w - d/5 = 21.28 \text{ in}$$

INTERPOLATING  $\rightarrow$  13.71 in = MAX SPACING

$$t_{min} = t_w \geq 3/8 \rightarrow .48 \text{ in} \quad w_{min} = b_f/2 - t_w = 5.07 \text{ in}$$

FULL DEPTH,  $\frac{1}{2}$  in.  $\times$   $\frac{5}{8}$  in. INTERMEDIATE WEB STIFFENERS  
@ 18" O.C. ( $< 1371V$ )

STIFFENER TO WEB

$$D = \frac{F_y A_{st}}{2(1.392)[d - 2t_f - 2(2\frac{3}{16})]}$$

↖ WEB CLIP TO COMPLY W/ AWS D1.8

$$= \frac{36(.5 \times .125)}{2(1.392)[18.4 - 2(.77) - 2(2\frac{3}{16})]} = 2.73 \text{ SIXTEENTHS} \rightarrow \frac{3}{16}'s \text{ COMPLY W/ TABLE J2.4}$$

USE DOUBLE SIDED  $\frac{3}{16}$  in. FILET WELDS  
TO CONNECT STIFFENERS TO WEB

STIFFENER TO FLANGE


$$D = \frac{F_y A_{st}}{4(2)(1.392)(5\frac{1}{8} - .75)}$$

↖ ASSUMED CLIP

$$= 1.89 \text{ SIXTEENTHS} \rightarrow \frac{3}{16}'s \checkmark \text{ PER J2.4}$$

USE DOUBLE SIDED  $\frac{3}{16}$  in. FILET WELD  
TO CONNECT STIFFENERS TO FLANGE

BEAM OUTSIDE LINK



$$1.1R_y V_n = 1.1 \times 1.1 \times 243 = 294$$

$$P_E = \frac{1.1R_y V_n L}{2h} = 808 \text{ k}$$

$$M = \frac{294(52)}{2} = 7,644 \text{ k-in}$$

$$V_c = 28.7 \text{ k FROM E-TABS}$$

$$P_U = 308$$

$$M_U = 697$$

$$V_U = 28.7$$

$$\lambda_{nw} = \frac{h_y}{t_w} = 33.4$$

$$\lambda_p = 90.6 \quad \checkmark$$

$$L_b = L - \frac{c}{2} - 2 \left( \frac{d_c}{2} \right) = 29.33 - \frac{52}{2} - 2 \left( \frac{14.2}{2} \right)$$

$$= 11.9'$$

SECOND ORDER

$$P_{c1} = 21479 \text{ k}$$

$$B_1 = \frac{1}{1 - \frac{312}{21479}} = 1.01$$

$$M_{rx} = 643.37$$

$$P = 1.09 \times 10^{-3} \quad b_2 = 1.35 \times 10^{-3}$$


$$\frac{P_c}{P_c} = \frac{P P_c}{R_y} = .305$$

$$\frac{b_2 M_{rx}}{R_y} = .782$$

$$> 1.09 > 1.0$$

NO GOOD

MOMENT ON BM → FIND POINT BM DOESN'T NEED BRACING



$$1 = .305 + \frac{1.35 \times 10^{-3} M_{rx}}{1.1}$$

$$M_{rx} = 506 \text{ ft-k}$$



USE COVER PL

FIND REQUIRED MOMENT CAPACITY TO MAKE 637 k-ft WORK

$$1.0 \geq \frac{P_c}{\phi_c P_c} + \frac{8}{9} \frac{M_c}{\phi_b M_c}$$

$$= \frac{308}{1.1 \times 3300} + \frac{8}{9} \frac{(637)}{\phi_b M_c}$$

$$K_L L_c = 57$$

$$E_c = 36k$$

$$M_c = 817 = \phi_b Z$$

$$Z_{REQ} = 196 \quad 18 \times 86 \rightarrow 186$$

$$Z_{PL}^{REQ} \Rightarrow 196 - 86 = b(t)(d+t)$$


$$10 = 10(t)(18.4+t)$$

$$= 184t + t^2 - 10$$

$$t_{min} = .06"$$

PROVIDE 1/8" PL FROM LINK ZONE  
 TO 1.39' + d → 3'

USE 1/8" FILLET WELDS

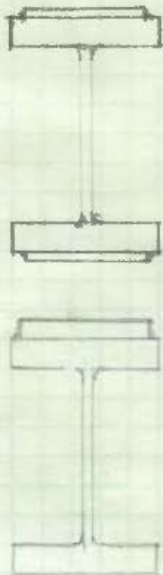

NOTE, BOTTOM PL WOULD LIKELY INTERFERE W/ CONNECTION, TRY JUST TOP PL.

TRY 10 x 1/4 A36 PL

$$10 \times .25 \times \frac{36}{50} + 25.2 = 27.2 = PNA \rightarrow 13.5in^2$$

$$13.5 - 1.8 - 8.55 = 3.15in^2 \quad 3.15 / .48 = 6.56in \text{ IN WEB}$$

↑ WEIGHTED AREA OF PL

SUM OF MOMENTS ABOUT PNA

$$.48(6.56) \left( \frac{6.56}{2} \right) + 10.3(.48) \left( \frac{10.3}{2} \right) + 8.55(10.3 + .77/2)$$

$$+ 8.55(6.56 + .77/2) + 1.8(6.56 + .77 + .25/2)$$

$$Z = 200in^3 > Z_{REQ} = 196$$

## Appendix R – Detailed Cost Breakdown

Gravity Beam							
	#	Length	Weight/LF	Total Wt	Bare Cost(\$/L.F)	Plus Labor and Equip	Total Cost
W8x10	146	1620	10	16309	14.6	21.6	34988.1
W10x33	7	154	33	5088	47.9	54.9	8455.6
W10x12	191	2991	12	36024	17.5	24.5	73171.8
W10x15	1	12.7	15	190	21.7	28.7	364.4
W10x22	6	106.3	22	2346	32.0	39.0	4145.8
W12x14	142	2514.6	14	35596	20.5	27.5	69216.4
W8x15	1	15.3	15	232	22.0	29.0	443.5
W12x40	1	22.5	40	896	57.7	64.7	1456.7
W12x16	66	1401.3	16	22459	23.2	30.2	42374.7
W10x17	2	42	17	713	24.6	31.6	1327.9
W8x18	10	156.1	18	2794	26.0	33.0	5144.0
W12x53	6	184	53	9767	77.0	84.0	15450.2
W12x65	1	30.67	65	1993	94.2	101.2	3104.5
W12x19	45	982.2	19	18617	27.5	34.5	33870.1
W8x21	16	255.3	21	5352	30.4	37.4	9547.5
W14x22	58	1103.7	22	24374	32.0	39.0	43068.2
W8x24	7	139.7	24	3364	34.9	41.9	5855.7
W12x26	9	171	26	4451	37.7	44.7	7651.0
W14x30	1	19.53	30	588	43.7	50.7	989.3
W14x48	1	24	48	1152	69.6	76.6	1838.4
W14x53	6	184	53	9767	77.0	84.0	15450.2
W14x61	6	198	61	12060	88.3	95.3	18873.0
W14x38	6	144	38	5488	55.3	62.3	8965.6
W16x26	157	4727.3	26	123539	37.9	44.9	212222.7
W16x31	53	1225.3	31	38065	45.0	52.0	63771.4
W16x45	1	12.33	45	558	65.6	72.6	895.4
W16x67	2	46.33	67	3106	97.2	104.2	4828.0
W18x35	25	669.8	35	23477	50.8	57.8	38730.3
W10x39	7	174.7	39	6835	56.7	63.7	11133.7
W8x40	1	33	40	1314	57.7	64.7	2136.3
W16x40	2	65	40	2608	58.2	65.2	4236.6
W18x40	24	590.8	40	23720	58.2	65.2	38529.6
W18x76	1	33	76	2504	110.0	117.0	3861.8
W21x44	86	2721.9	44	120407	64.1	71.1	193643.5
W12x45	2	54.7	45	2437	64.6	71.6	3916.6
W21x48	12	292.3	48	14024	69.6	76.6	22380.9
W21x62	12	300.3	62	18697	90.3	97.3	29212.8
W24x55	22	628.1	55	34625	79.9	86.9	54603.0
W24x62	10	337	62	20873	89.8	96.8	32624.9
W24x68	29	982	68	67165	99.2	106.2	104263.3
W24x76	18	557.7	76	42510	110.5	117.5	65543.4
W24x104	36	1405.5	104	146348	151.0	158.0	222043.1
W24x117	12	473.3	117	55397	169.7	176.7	83638.8
W24x103	1	34.5	103	3557	149.5	156.5	5399.2
W24x131	2	65.1	131	8532	190.0	197.0	12827.1
W24x146	1	34.7	146	5072	211.9	218.9	7597.3
W24x192	8	313.1	192	59987	277.8	284.8	89172.9
W27x84	3	81.2	84	6853	122.4	129.4	10505.3
W30x90	32	540.6	90	48562	130.3	137.3	74199.1
W30x99	1	20.5	99	2030	143.6	150.6	3087.0
W30x116	1	15.67	116	1823	168.7	175.7	2753.0
W33x118	4	62.7	118	7399	171.1	178.1	11167.5

Gravity Columns							
	#	Length	Weight/ft	Total Weight	Bare Cost(\$/L.F)	Plus Labor/Equip	Total Cost
W10x33	7	783	33	25839	47.85	54.85	42947.55
W10x39	2	72	39	2808	56.55	63.55	4575.6
W10x45	7	257	45	11565	65.25	72.25	18568.25
W10x49	13	531	49	26019	71.05	78.05	41444.55
W10x54	5	248	54	13392	78.3	85.3	21154.4
W10x60	7	294	60	17640	87	94	27636
W10x68	2	88.5	68	6018	98.6	105.6	9345.6
W10x77	2	78	77	6006	111.65	118.65	9254.7
W10x88	1	39	88	3432	127.6	134.6	5249.4
W12x53	6	216	53	11448	76.85	83.85	18111.6
W12x58	2	72	58	4176	84.1	91.1	6559.2
W12x65	12	526.5	65	34222.5	94.25	101.25	53308.125
W12x72	10	453	72	32616	104.4	111.4	50464.2
W12x79	7	265	79	20935	114.55	121.55	32210.75
W12x87	6	234	87	20358	126.15	133.15	31157.1
W12x96	2	78	96	7488	139.2	146.2	11403.6
W14x48	1	36	48	1728	69.6	76.6	2757.6
W14x53	1	88.5	53	4690.5	76.85	83.85	5394.075
W14x61	1	36	61	2196	88.45	95.45	2525.4
W14x68	1	49.5	68	3366	98.6	105.6	3870.9
W14x82	1	36	82	2952	118.9	125.9	3394.8
W14x90	4	157.5	90	14175	130.5	137.5	16301.25
W14x99	2	121.5	99	12028.5	143.55	150.55	13832.775
W14x109	1	36	109	3924	158.05	165.05	4512.6
W14x120	1	36	120	4320	174	181	4968
Misc.							
	#	Cost					
Shear Studs	8446	122467					
	Wt (kips)						
Lanterns	203	294350					
Total Tonnage of Steel	804				884		
Cost w Labor/Equip	\$2,672,441	10% Inc.	Totals:		\$3,233,654		



Lateral System						
<b>Rockville, MD</b>						
Braces						
	#	Length	Weight/ft	Total Weight	Bare Cost(\$/L.F)	Cost
HSS5x5x3/8	4	89.8	22.4	2011.52	38	3395
HSS6x6x3/8	22	465.5	27.5	12801.25	45	20971
HSS8x8x3/8	7	206.2	37.7	7773.74	60	12276
HSS9x9x3/8	2	58.8	42.8	2516.64	67	3926
HSS9x9x1/2	2	62.1	55.7	3458.97	85	5284
HSS9x9x5/8	6	174.7	67.8	11844.66	102	17868
HSS10x10x5/8	8	214.3	76.3	16351.09	114	24504
Beams						
	#	Length	Weight/ft	Total Weight	Bare Cost(\$/L.F)	Cost
W16x21	16	304	21	6384	36	10889
W18x40	16	384	40	15360	63	24115
W24x68	16	469.3	68	31912.4	103	48131
W24x94	16	416	94	39104	139	58024
Columns						
	#	Length	Weight/ft	Total Weight	Bare Cost(\$/L.F)	Cost
W14x53	4	144	53	7632	81	11701
W14x68	4	198	68	13464	103	20307
W14x82	6	216	82	17712	122	26447
W14x99	4	156	99	15444	147	22866
W14x120	6	297	120	35640	176	52391
W14x176	6	234	176	41184	256	59885
Total Tonnage	140.0% Increase			Totals:	154	
Cost	\$422,982				\$511,808	
<b>San Francisco, Existing Setup</b>						
Braces						
	#	Length	Weight/ft	Total Weight	Bare Cost(\$/L.F)	Cost
HSS8x8x1/2	20	436.4	48.85	21318	75	32890
HSS9x9x5/8	6	119.5	67.82	8104	102	12225
HSS10x10x5/8	1	22.4	76.33	1710	114	2562
W14x132	1	21	132	2772	193	4062
W14x159	1	21	159	3339	232	4867
W14x176	8	240	176	42240	256	61421
W14x193	13	390	193	75270	280	109223
W14x211	1	24.2	211	5106.2	306	7396
Beams						
	#	Length	Weight/ft	Total Weight	Bare Cost(\$/L.F)	Cost
W16x21	16	304	21	6384	36	10889
W18x40	16	384	40	15360	63	24115
W33x354	16	469.3	354	166132.2	509	238724
W24x94	16	58.8	94	5527.2	139	8201
Columns						
	#	Length	Weight/ft	Total Weight	Bare Cost(\$/L.F)	Cost
W14x109	4	144	109	15696	161	23152
W14x132	4	198	132	26136	193	38301
W14x145	4	144	145	20880	212	30514
W14x159	2	72	159	11448	232	16688
W14x193	4	156	193	30108	280	43689
W14x211	2	99	211	20889	306	30256
W14x233	2	99	233	23067	337	33349
W14x257	2	99	257	25443	371	36723
W14x342	4	156	342	53352	492	76696
W14x455	2	78	455	35490	652	50864
Total Tonnage	308.0% Increase			Totals:	339	
Cost	\$896,810				\$1,085,140	

San Francisco, Additional Frames						
Braces						
	#	Length	Weight/ft	Total Weight	Bare Cost(\$/L.F)	Cost
HSS8x8x1/2	26	624	48.85	30482	75	47029
HSS9x9x5/8	5	142	67.82	9630	102	14527
HSS10x10x5/8	17	510	76.33	38928	114	58338
HSS12x12x5/8	28	870	93.34	81206	139	120532
Beams						
	#	Length	Weight/ft	Total Weight	Bare Cost(\$/L.F)	Cost
W16x21	24	304	21	6384	36	10889
W18x40	24	384	40	15360	63	24115
W33x354	16	469.3	354	166132.2	509	238724
W24x94	16	58.8	94	5527.2	139	8201
Columns						
	#	Length	Weight/ft	Total Weight	Bare Cost(\$/L.F)	Cost
W14x74	4	144	74	10656	111	15996
W14x90	3	108	90	9720	134	14450
W14x99	4	198	99	19602	147	29023
W14x109	7	293	109	31937	161	47109
W14x120	4	144	120	17280	176	25402
W14x145	4	82	145	11890	212	17376
W14x159	7	273	159	43407	232	63276
W14x176	4	198	176	34848	256	50672
W14x193	2	78	193	15054	280	21845
W14x211	6	234	233	54522	337	78825
Total Tonnage	301 0% Increase			Totals:	331	
Cost	\$886,329				\$1,072,458	
San Francisco, Additional Frames, EBF						
Braces						
	#	Length	Weight/ft	Total Weight	Bare Cost(\$/L.F)	Cost
HSS9x9x5/8	33	820	67.82	55612	102	83890
HSS10x10x5/8	7	210	76.33	16029	114	24022
HSS12x12x5/8	32	960	93.34	89606	139	133001
Beams						
	#	Length	Weight/ft	Total Weight	Bare Cost(\$/L.F)	Cost
W16x21	24	304	21	6384	36	10889
W18x40	24	384	40	15360	63	24115
W18x86	16	469.3	86	40359.8	128	60127
W24x94	16	58.8	94	5527.2	139	8201
Columns						
	#	Length	Weight/ft	Total Weight	Bare Cost(\$/L.F)	Cost
W14x74	4	144	74	10656	111	15996
W14x90	3	108	90	9720	134	14450
W14x99	4	198	99	19602	147	29023
W14x109	7	293	109	31937	161	47109
W14x120	4	144	120	17280	176	25402
W14x145	4	82	145	11890	212	17376
W14x159	7	273	159	43407	232	63276
W14x176	4	198	176	34848	256	50672
W14x193	4	156	193	30108	280	43689
W14x211	4	156	233	36348	337	52550
Total Tonnage	237 0% Increase			Totals:	261	
Cost	\$703,787				\$851,583	

**Concrete**

		Sq Ft.	CY	f'c (psi)	Cost	Total
NW SOG	5"		30000 463	4500	\$133.00	\$61,574.07
LW Slab	3"		16560 153	3000	\$167.00	\$25,606.67
	6"		180000 3333	3000	\$167.00	\$556,666.67
	6.25"		27600 532	3000	\$167.00	\$88,912.04
Pumping				4019	\$28.00	\$112,534.07
Steel Trowel			210000 \$	0.72		\$151,200.00
			LF			
Saw Cuts			8000 \$	0.75		\$6,000.00
Vapor Barrier			30000 \$	0.32		\$9,600.00

		Ht	Length	CY	f'c (psi)	Cost	Total Cost
Basement Wall	12"		12	420	187	4500 \$133.00	\$24,826.67
Wall Footings	24"		1	420	31	4500 \$133.00	\$4,137.78
Pumping					187	\$29.00	\$5,413.33

		Sq Ft.	Cost		
Formwork	Walls	8400	\$ 1.89		\$15,876.00
	Slab/Footings	1000	\$ 1.89		\$1,890.00

		Sq Ft.	Cost	Included in Structural Steel	
Metal Deck	2VLI	216000	\$2.70		\$583,200.00
	3VLI	27600	\$3.20		\$88,320.00
	Roof Deck	15600	\$3.10		\$48,360.00

		Sq Ft.	Cost		Total
Reinforcing					
Welded Wire	6x6W2.1xW2.1	207600	\$0.75		\$155,700.00
	Ton	Cost	Waste		
Uncoated	10.08	\$1,012.00	10%		\$11,221.06
Reinforcing Stl					

		Sq Ft	Cost		
Chairs		180600 \$	0.35		\$63,210.00
<b>Total</b>					<b>\$1,553,242.02</b>

**Foundations**

	Diameter	#	CY	f'c	Cost	Total
Pier	2.5	47	299	4000 \$	135.00	\$40,374.34
	3	15	137	4000 \$	135.00	\$18,555.02
	5	11	280	4000 \$	135.00	\$37,797.25
Pumping			716	\$	28.00	\$20,061.82
	4.5	11	227	4000 \$	135.00	
Reinforcing	Tons	Cost	Waste			
	26.7 \$	1,508.00	10%			\$44,289.96


	Diameter	#	L.F.	Cost	Total
Auguring	36	62	2,170	\$ 38.00	\$82,460.00
	60	11	385	\$ 104.50	\$40,232.50


**Total**      **\$340,525.06**  
98

Appendix S – Original Schedule

ID	Task Mode	Task Name	Duration	Start	Finish	11								
						S	T	M	F	T	F	T		
1		Foundations	88 days?	Thu 11/17/11	Mon 3/19/12									
2		Area 1 NW	63 days?	Mon 11/21/11	Wed 2/15/12									
10		Area 2 NE	62 days?	Wed 11/30/11	Thu 2/23/12									
18		Area 3 SW	77 days?	Thu 11/17/11	Fri 3/2/12									
26		Area 4 SE	79 days?	Wed 11/30/11	Mon 3/19/12									
35		Building Structure	161 days?	Fri 2/24/12	Fri 10/5/12									
36		Terrace Level	27 days?	Fri 2/24/12	Mon 4/2/12									
54		Level 1	27 days?	Fri 3/9/12	Mon 4/16/12									
72		Level 2	27 days?	Fri 3/23/12	Mon 4/30/12									
90		Level 3	27 days?	Fri 4/6/12	Mon 5/14/12									
108		Level 4	27 days?	Fri 4/20/12	Mon 5/28/12									
126		Level 5	28 days?	Fri 5/4/12	Tue 6/12/12									
144		Penthouse	28 days?	Fri 5/18/12	Tue 6/26/12									
160		Penthouse Roof	22 days?	Mon 6/4/12	Tue 7/3/12									
173		Upper Roof	67 days?	Thu 7/5/12	Fri 10/5/12									
177		Stair 1	26 days	Thu 5/24/12	Thu 6/28/12									
183		Exterior Skin	97 days?	Thu 7/5/12	Fri 11/16/12									
184		West Elevation	55 days?	Thu 7/5/12	Wed 9/19/12									
189		East Elevation	52 days?	Thu 7/5/12	Fri 9/14/12									
194		South Elevation	56 days?	Thu 7/19/12	Thu 10/4/12									
199		North Elevation	72 days?	Thu 8/2/12	Fri 11/9/12									
204		Roof	87 days	Thu 7/19/12	Fri 11/16/12									

<p>Project: JCA Conc Sched Date: Thu 4/5/12</p>	
---	--

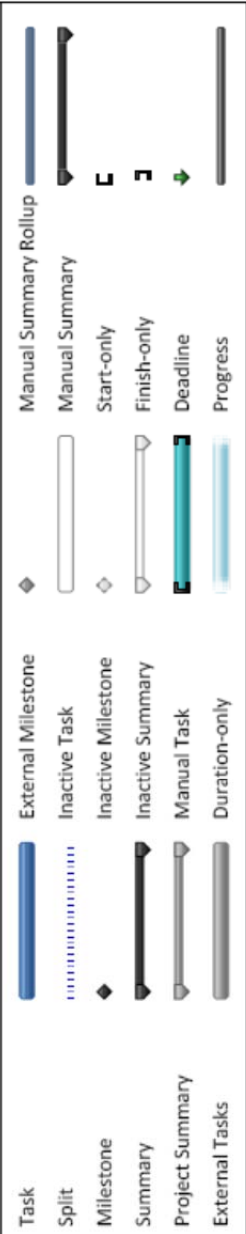

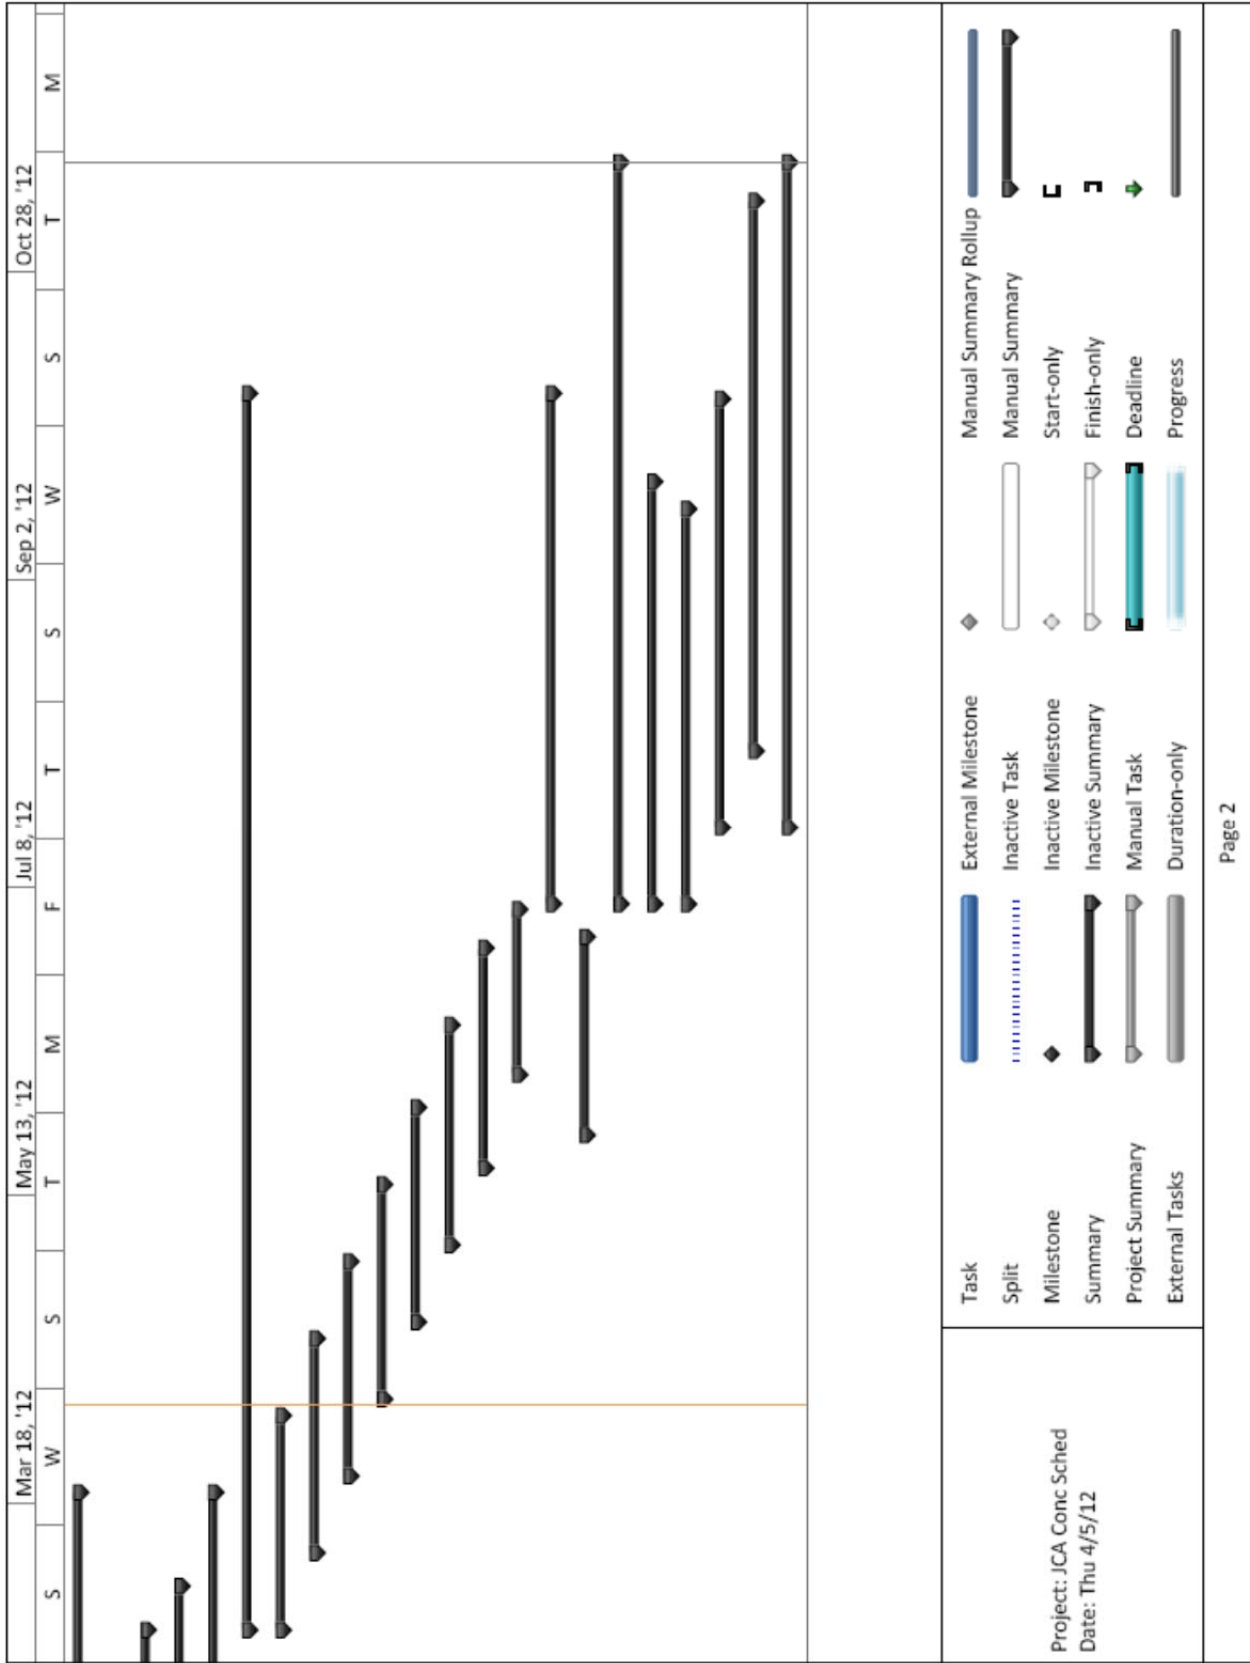
Project: JCA Conc Sched  
Date: Thu 4/5/12

## Appendix T – Vasari Energy Model

JCA

Analyzed at 4/1/2012 8:01:44 PM

### Mass

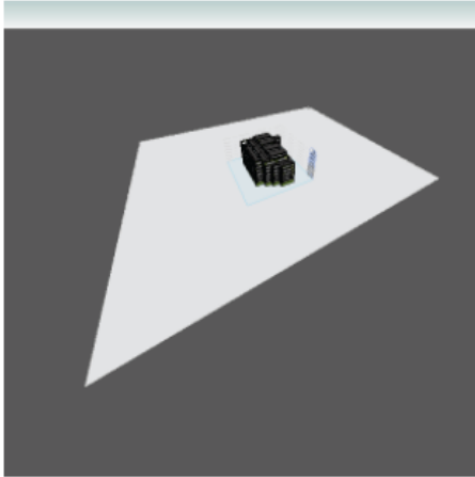

### Building Performance Factors

Location:	E Jefferson St & Maryland Ave, Rockville, MD 20850, USA
Weather Station:	48099
Outdoor Temperature:	Max: 93°F/Min: 4°F
Floor Area:	172,816 sf
Exterior Wall Area:	85,885 sf
Average Lighting Power:	1.01 W / ft <sup>2</sup>
People:	767 people
Exterior Window Ratio:	0.50
Electrical Cost:	\$0.13 / kWh
Fuel Cost:	\$0.97 / Therm

### Energy Use Intensity

Electricity EUI:	18 kWh / sf / yr
Fuel EUI:	25 kBtu / sf / yr
Total EUI:	88 kBtu / sf / yr

### Life Cycle Energy Use/Cost

Life Cycle Electricity Use:	95,510,580 kWh
Life Cycle Fuel Use:	1,315,437 Therms
Life Cycle Energy Cost:	\$6,110,403

\*30-year life and 6.1% discount rate for costs

### Renewable Energy Potential

Roof Mounted PV System (Low efficiency):	167,071 kWh / yr
Roof Mounted PV System (Medium efficiency):	334,142 kWh / yr
Roof Mounted PV System (High efficiency):	501,214 kWh / yr
Single 15' Wind Turbine Potential:	825 kWh / yr

\*PV efficiencies are assumed to be 5%, 10% and 15% for low, medium and high efficiency systems

Appendix U – Sunpower T5 Roof Tiles

SUNPOWER<sup>®</sup>

T5 SOLAR ROOF TILE  
EXCEPTIONAL EFFICIENCY & PERFORMANCE




Electrical Data			
Measured at Standard Test Conditions (STC): Irradiance 1000W/m <sup>2</sup> , AM 1.5, and cell temperature 25° C			
Peak Power *	P <sub>max</sub>	320 W (+5/-3%)	327 W (+5/-3%)
Rated Voltage	V <sub>mpp</sub>	54.7 V	54.7 V
Rated Current	I <sub>mpp</sub>	5.86 A	5.98 A
Open Circuit Voltage	V <sub>oc</sub>	64.8 V	64.9 V
Short Circuit Current	I <sub>sc</sub>	6.24 A	6.46 A
Maximum System Voltage	UL	600 V	
Temperature Coefficients	Power	-0.38% / K	
	Voltage (V <sub>oc</sub> )	-176.6 mV / K	
	Current (I <sub>sc</sub> )	3.5 mA / K	
NOCT		45° C +/- 2° C	
Series Fuse Rating		20 A	

Mechanical Data	
Solar Laminate	SunPower™ 320 Solar Laminate, or SunPower 327 Solar Laminate
Solar Cells	96 SunPower all-back contact monocrystalline
Front Glass	SunPower 320 Solar Laminate: High transmission tempered glass with anti-reflective (AR) coating SunPower 327 Solar Laminate: High transmission tempered glass with anti-reflective (AR) coating
Junction Box	IP-65 rated with 3 bypass diodes, 32 x 155 x 128 (mm)
Output Cables	1000 mm length cables / MultiContact (MC4) connectors
Frame	Polymer material with fiber reinforcement, PPE+PS
Tile Weight	47 lbs (21.3 kg)
Roof Coverage	95% N-S

Tested Operating Conditions	
Temperature	-40° F to +185° F (-40° C to +85° C)
Max load	50 psf 245kg/m <sup>2</sup> (2400 Pa) front and back – e.g. wind
Impact Resistance	Hail 1 in (25 mm) at 52mph (23 m/s)

Warranties and Certifications	
Warranty	25-year limited power warranty 10-year limited product warranty
Certifications	CSA listed (Tested to UL 1703), Class C Fire Rating
Built in the USA. Complies with the "Buy American" clause of The American Recovery and Reinvestment Act of 2009.	

\*Other laminates may be available upon request

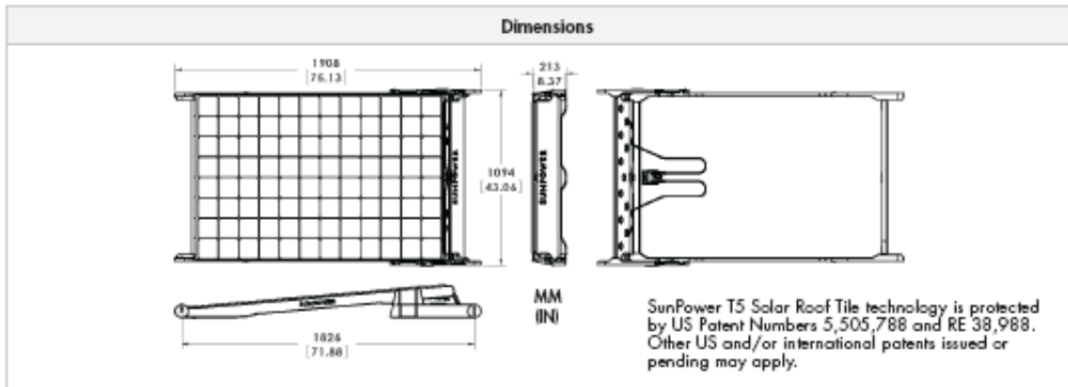

**CAUTION: READ SAFETY AND INSTALLATION INSTRUCTIONS BEFORE USING THE PRODUCT.**  
Visit [sunpowercorp.com](http://sunpowercorp.com) for details

SUNPOWER and the SUNPOWER logo are trademarks or registered trademarks of SunPower Corporation.  
© March 2011 SunPower Corporation. All rights reserved. Specifications included in this datasheet are subject to change without notice.

[sunpowercorp.com](http://sunpowercorp.com)  
Document # 001-07602 Rev\*\* /T5\_EN



## Appendix V – System Advisor Model Cash Flow

	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
Energy (kWh)	0	55,522	55,244	54,968	54,693	54,420	54,148	53,877	53,608	53,340	53,073	52,808	52,544	52,281	52,019	51,759
Energy Value (\$)	0	9,751.68	9,945.49	10,143.16	10,344.76	10,550.36	10,760.05	10,973.90	11,192.01	11,414.45	11,641.31	11,872.68	12,108.65	12,349.31	12,594.75	12,845.07
<b>Operating Expenses</b>																
Fixed O&M Annual	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Variable O&M	0	1,059.08	1,085.56	1,112.70	1,140.51	1,169.03	1,198.25	1,228.21	1,258.91	1,290.39	1,322.65	1,355.71	1,389.61	1,424.35	1,459.95	1,496.45
Insurance	0	1,121.90	1,149.95	1,178.70	1,208.17	1,238.37	1,269.33	1,301.06	1,333.59	1,366.93	1,401.10	1,436.13	1,472.03	1,508.83	1,546.55	1,585.22
Property Assessed Value	0	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48
Property Taxes	0	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61
Net Salvage Value	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Operating Costs	0	6,668.59	6,723.12	6,779	6,836.29	6,895.01	6,955.19	7,016.88	7,080.11	7,144.93	7,211.36	7,279.45	7,349.25	7,420.79	7,494.12	7,569.28
Deductible Expenses	0	-6,668.59	-6,723.12	-6,779	-6,836.29	-6,895.01	-6,955.19	-7,016.88	-7,080.11	-7,144.93	-7,211.36	-7,279.45	-7,349.25	-7,420.79	-7,494.12	-7,569.28
<b>Financing</b>																
Debt Balance	0	-224,380.48	-218,280.80	-211,815.13	-204,961.53	-197,696.71	-189,995.99	-181,833.24	-173,180.72	-164,009.05	-154,287.08	-143,981.80	-133,058.19	-121,479.17	-109,205.41	-96,195.22
Debt Interest Payment	0	13,462.83	13,096.85	12,708.91	12,297.69	11,861.80	11,399.76	10,909.99	10,390.84	9,840.54	9,257.23	8,638.91	7,983.49	7,288.75	6,552.32	5,771.71
Debt Repayment	0	6,099.68	6,465.66	6,853.60	7,264.82	7,700.71	8,162.75	8,652.52	9,171.67	9,721.97	10,305.29	10,923.60	11,579.02	12,273.76	13,010.19	13,790.80
Debt Total Payment	0	19,562.51	19,562.51	19,562.51	19,562.51	19,562.51	19,562.51	19,562.51	19,562.51	19,562.51	19,562.51	19,562.51	19,562.51	19,562.51	19,562.51	19,562.51
Federal IBI	0															
State IBI	0															
Utility IBI	0															
Other IBI	0															
Total IBI	0															
Federal CBI	0															
State CBI	0															
Utility CBI	0															
Other CBI	0															
Total CBI	0															
Federal PBI	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
State PBI	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Utility PBI	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Other PBI	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Total PBI	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Federal PTC	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
State PTC	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Federal ITC		67,314.14														
State ITC		0														
<b>Tax Effect on Equity (State)</b>																
State Depreciation Schedule (%)	0	20	32	19.2	11.52	11.52	5.76	0	0	0	0	0	0	0	0	0
State Depreciation	0	38,144.68	61,031.49	36,618.89	21,971.34	21,971.34	10,985.67	0	0	0	0	0	0	0	0	0
State Income Taxes	0	-4,079.33	-5,659.60	-3,927.48	-2,877.37	-2,850.97	-2,053.84	-1,254.88	-1,222.97	-1,188.98	-1,152.80	-1,114.29	-1,073.29	-1,029.67	-983.25	-933.87
State Tax Savings	0	4,079.33	5,659.60	3,927.48	2,877.37	2,850.97	2,053.84	1,254.88	1,222.97	1,188.98	1,152.80	1,114.29	1,073.29	1,029.67	983.25	933.87
<b>Tax Effect on Equity (Federal)</b>																
Federal Depreciation Schedule (%)	0	20	32	19.2	11.52	11.52	5.76	0	0	0	0	0	0	0	0	0
Federal Depreciation	0	38,144.68	61,031.49	36,618.89	21,971.34	21,971.34	10,985.67	0	0	0	0	0	0	0	0	0
Federal Income Taxes	0	-15,175.10	-21,053.72	-14,610.21	-10,703.82	-10,605.61	-7,640.30	-4,668.16	-4,549.44	-4,423.02	-4,288.42	-4,145.14	-3,992.65	-3,830.36	-3,657.69	-3,473.99
Federal Tax Savings	0	82,489.24	21,053.72	14,610.21	10,703.82	10,605.61	7,640.30	4,668.16	4,549.44	4,423.02	4,288.42	4,145.14	3,992.65	3,830.36	3,657.69	3,473.99
After Tax Cost	0	60,337.46	427.69	-7,803.83	-12,817.61	-13,000.94	-16,823.56	-20,656.35	-20,870.22	-21,095.44	-21,332.65	-21,582.54	-21,845.82	-22,123.27	-22,415.69	-22,723.93
After Tax Cashflow	0	66,867.19	7,087.19	-1,011.97	-5,890.76	-5,936.42	-9,618.64	-13,308.23	-13,376.05	-13,452.32	-13,537.63	-13,632.59	-13,737.87	-13,854.17	-13,982.24	-14,122.87
Payback	-224,380.48	81,981.58	22,322.51	14,351.52	9,608.60	9,706.95	6,177.40	2,649.62	2,753.33	2,858.87	2,966.30	3,075.63	3,186.90	3,300.14	3,415.39	3,532.67
Cumulative payback	-224,380.48	-142,398.90	-120,076.39	-105,724.87	-96,116.27	-86,409.32	-80,231.92	-77,582.30	-74,828.98	-71,970.10	-69,003.81	-65,928.18	-62,741.28	-59,441.14	-56,025.76	-52,493.09

16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
51,501	51,243	50,987	50,732	50,478	50,226	49,975	49,725	49,476	49,229	48,983	48,738	48,494	48,252	48,010
13,100.37	13,360.74	13,626.29	13,897.11	14,173.31	14,455.01	14,742.30	15,035.30	15,334.13	15,638.90	15,949.72	16,266.72	16,590.02	16,919.75	17,256.03
0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
1,533.86	1,572.21	1,611.52	1,651.80	1,693.10	1,735.43	1,778.81	1,823.28	1,868.86	1,915.59	1,963.48	2,012.56	2,062.88	2,114.45	2,167.31
0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
1,624.85	1,665.47	1,707.11	1,749.78	1,793.53	1,838.37	1,884.33	1,931.44	1,979.72	2,029.21	2,079.94	2,131.94	2,185.24	2,239.87	2,295.87
224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48	224,380.48
4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61	4,487.61
0	0	0	0	0	0	0	0	0	0	0	0	0	0	44,876.10
7,646.32	7,725.29	7,806.23	7,889.20	7,974.24	8,061.40	8,150.75	8,242.33	8,336.19	8,432.41	8,531.03	8,632.12	8,735.73	8,841.93	-35,925.31
-7,646.32	-7,725.29	-7,806.23	-7,889.20	-7,974.24	-8,061.40	-8,150.75	-8,242.33	-8,336.19	-8,432.41	-8,531.03	-8,632.12	-8,735.73	-8,841.93	35,925.31
-82,404.42	-67,786.17	-52,290.83	-35,865.77	-18,455.20	0	0	0	0	0	0	0	0	0	0
4,944.27	4,067.17	3,137.45	2,151.95	1,107.31	0	0	0	0	0	0	0	0	0	0
14,618.25	15,495.34	16,425.06	17,410.57	18,455.20	0	0	0	0	0	0	0	0	0	0
19,562.51	19,562.51	19,562.51	19,562.51	19,562.51	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
-881.34	-825.47	-766.06	-702.88	-635.71	-564.3	-570.55	-576.96	-583.53	-590.27	-597.17	-604.25	-611.5	-618.94	2,514.77
881.34	825.47	766.06	702.88	635.71	564.3	570.55	576.96	583.53	590.27	597.17	604.25	611.5	618.94	-2,514.77
0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
-3,278.59	-3,070.76	-2,849.73	-2,614.71	-2,364.84	-2,099.19	-2,122.45	-2,146.30	-2,170.75	-2,195.80	-2,221.48	-2,247.80	-2,274.78	-2,302.44	9,354.95
3,278.59	3,070.76	2,849.73	2,614.71	2,364.84	2,099.19	2,122.45	2,146.30	2,170.75	2,195.80	2,221.48	2,247.80	2,274.78	2,302.44	-9,354.95
-23,048.91	-23,391.57	-23,752.95	-24,134.12	-24,536.21	-5,397.92	-5,457.74	-5,519.06	-5,581.92	-5,646.34	-5,712.38	-5,780.06	-5,849.44	-5,920.56	24,055.59
-14,276.90	-14,445.22	-14,628.79	-14,828.61	-15,045.76	4,281.16	4,413.70	4,548.58	4,685.82	4,825.46	4,967.55	5,112.13	5,259.23	5,408.91	35,610.22
3,652.03	3,773.50	3,897.11	4,022.90	4,150.90	4,281.16	4,413.70	4,548.58	4,685.82	4,825.46	4,967.55	5,112.13	5,259.23	5,408.91	35,610.22
-48,841.06	-45,067.56	-41,170.45	-37,147.56	-32,996.66	-28,715.50	-24,301.80	-19,753.22	-15,067.40	-10,241.94	-5,274.38	-162.25	5,096.98	10,505.89	46,116.11

School Address:  
330 West Nittany Avenue  
State College, PA 16801

Academic Vita

Home Address:  
349 Dogtown Rd  
Centre Hall, PA 16828

# Jacob Wiest

Cell: 814.933.2844

Jdwiest@gmail.com

Home: 814.364.9260

---

## EDUCATION

---

### The Pennsylvania State University: Schreyer Honors College

Dean's List: Fall '07, Fall '08, Summer '09, Fall '09, Fall '10, Spring '11

University Park, PA

Expected Graduation: August 2012

- **The College of Engineering**

Masters of Architectural Engineering  
Bachelor of Architectural Engineering  
Architectural Studies Minor

---

## PROFESSIONAL EXPERIENCE

---

### AECOM

Structural Intern

Arlington, VA

Summer 2011

- Modeled structures and components via programs; provided hand calculations for analysis and design; answered submittals and RFI's; drafted drawings for Proposals

### Advanced Concrete (AE 431)

Grading Assistant

State College, PA

Spring 2012

- Worked closely with the professor to grade materials, conduct reviews, and educate students

### Research Assistant

- Aided MS Candidate and professor in conducting testing of concrete columns reinforced with ultra-high strength steel

State College, PA

Fall 2011/Spring 2012

---

## RELEVANT COURSE WORK

AE 430 – Indeterminate structures

AE 534 – Analysis and Design of Steel Connections

AE 403 – Advanced Steel Design

AE 538 – Earthquake Resistant Design of Buildings

AE 431 – Advanced Concrete Design

BE 462 – Design of Wood Structures

AE 432 – Design of Masonry Structures

CE 397A – Geotechnical Engineering

AE 597A – Computer Analysis of Structures

CE 548 – Structural Design for Dynamic Loads

---

## RESEARCH INTERESTS

**Seismic design of reinforced concrete and steel structures.**

---

## PROGRAM EXPERIENCE

RAM Structural, RAM Concept, RAM Elements, E-Tabs, SAP, AutoCAD, STAAD Pro, Revit, RISA

---

## ACTIVITIES

S:PACE (Student Partnership for Achieving Construction Excellence)

Club Member

State College, PA

Fall 2009 to Present

EERI-PSU (Earthquake Engineering Research Institute of Penn State)

Club Member

State College, PA

Fall 2010